COUNTY OF ALAMEDA

SANTA RITA JAIL

5325 BRODER BLVD, **DUBLIN, CA 94568**

SANTA RITA JAIL INTERIOR ACCESSIBILITY UPGRADES

CONSTRUCTION DOCUMENTS 05-01-2018

PROJECT INFORMATION

PROJECT TEAM

ALAMEDA COUNTY GENERAL SERVICE AGENCY 1401 LAKESIDE DRIVE OAKLAND, CALIFORNIA 94612 510-208-9700 WWW.ACGOV.ORG/GSA

COUNTY OF ALAMEDA SANTA RITA JAIL 1532 BRODER BLVD DUBLIN, CALIFORNIA 94568

ARCHITECT

CLIENT / OWNER

DLR GROUP 700 SOUTH FLOWER STREET, 22ND FLOOR LOS ANGELES, CALIFORNIA 90017 213-800-9400 WWW.DLRGROUP.COM

MECHANICAL

DLR GROUP 700 SOUTH FLOWER STREET, 22ND FLOOR LOS ANGELES, CALIFORNIA 90017 213-800-9400 WWW.DLRGROUP.COM

PLUMBING

DLR GROUP 700 SOUTH FLOWER STREET, 22ND FLOOR LOS ANGELES, CALIFORNIA 90017 213-800-9400 WWW.DLRGROUP.COM

| G0.1 | GENERAL NOTES, SYMBOLS AND ABBREVIATIONS |
|------|--|
| G0.4 | BARRIER LIST AND SOLUTIONS |
| G0.5 | BARRIER LIST AND SOLUTIONS |

.GENERAL. SETTLEMENT WORK

ARCHITECTURAL. SETTLEMENT WORK

SHEET INDEX

A1-25.1C DEMO & FLOOR PLAN - HOUSING UNIT 25 A1-33.1A DEMO & FLOOR PLAN - HOUSING UNIT 33 A1-34.1B DEMO & FLOOR PLAN - HOUSING UNIT 34 A1-35.2 DEMO & FLOOR PLAN - HOUSING UNIT 35 **DEMO & ENLARGED PLANS / INTERIOR ELEVATIONS DEMO & ENLARGED PLANS / INTERIOR ELEVATIONS** DOOR SCHEDULE, WALL TYPES AND DETAILS DEMO & ENLARGED PLANS / INTERIOR ELEVATIONS **DEMO AND ENLARGED PLANS / INTERIOR ELEVATIONS**

.MECHANICAL / PLUMBING

MECHANICAL & PLUMBING SYMBOLS, ABBREVIATIONS & SCHEDULE

| MS1.1 | MECHANICAL SITE PLAN |
|-----------|---|
| MP1-0.1A | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - CENTRAL CORE |
| MP1-1.2 | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 1 |
| MP1-6.1D | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 6 |
| MP1-7.1A | MECHANICAL & PLUMBING DEMO & FLOOR PLAN- HOUSING UNIT 7 |
| MP1-8.1B | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 8 |
| MP1-9.1C | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 9 |
| MP1-21.1B | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 21 |
| MP1-22.1A | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 22 |
| MP1-23.2 | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 23 |
| MP1-24.2 | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 24 |
| MP1-25.1C | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 25 |
| MP1-33.1A | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 33 |
| MP1-34.1B | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 34 |
| MP1-35.2 | MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 35 |
| | |
| MP2.1 | MECHANICAL & PLUMBING ENLARGED PLANS |
| MP2.2 | MECHANICAL & PLUMBING ENLARGED PLANS |
| MP2.3 | MECHANICAL & PLUMBING ENLARGED PLANS |
| | |
| MP5.1 | MECHANICAL & PLUMBING DETAILS |
| | |

MP5.2 MECHANICAL & PLUMBING DETAILS

AUTHORITIES HAVING JURISDICTION

DETENTION STANDARDS

Board of State and Community Corrections 2590 Venture Oaks Way Sacramento, CA 95833 (916) 445-6027





ABBREVIATIONS FACE BRICK CORROSION RESISTANT IAQ INDOOR AIR QUALITY NOISE CRITERIA REVOLUTIONS PER MINUTE UNDERGROUND ELECTRICAL FOOT CANDLE A AMP AMPERE COUNTERSINK IN ACCORDANCE WITH NORMALLY CLOSED REDUCED PRESSURE BACKFLOW PREVENTER UGT UNDERGROUND TELEPHONE FCMU FLUTED CONCRETE MASONRY UNIT COMPRESSED AIR COMBINATION SEWER INTERNATIONAL BUILDING CODE NURSE CALL UNIT HEATER REFRIGERANT SUCTION FLOOR CLEAN OUT FCO AREA ALARM PANEI CONDENSER WATER SUPPLY INTERCOM NATIONAL ELECTRIC CODE RAIN WATER LEADERS SENSOR UNDERWRITERS LABORATORIES FCU FAN COIL UNIT INSIDE DIAMETER NEMA NATIONAL ELECTRICAL MANUFACTURERS ASSN. S UNEX UNEXCAVATED AUTOMATIC AIR VENT CSK COUNTERSUNK FD FIRE DAMPER CSMU CALCIUM SILICATE MASONRY UNIT INVERT ELEVATION NEUT NEUTRAL UNFINISHED ANCHOR BOLT SANITARY SEWER FLOOR DRAIN ACRYLONITRILE-BUTADIENE-STYRENE ILLUMINATING ENGINEERING SOCIETY NIC NOT IN CONTRACT UNO UNLESS NOTED OTHERWISE CSP COMBINATION STANDPIPE SOAP DISH FIRE DEPARTMENT CONNECTION ACOUSTICAL CEILING CSTJ CONSTRUCTION JOINT FDC INSIDE FACE NORMALLY OPEN SOUTH FDN FOUNDATION ALTERNATING CURRENT CSWK CASEWORK ISOLATED GROUND NUMBER SPRINKLER LINE UNDERGROUND RESIDENTIAL DISTRIBUTION FDR FFFDFR ACC AIR COOLED CONDENSER COOLING TOWER INTAKE HOOD NITROUS OXIDE UTILITY SHELF SHOCK ABSORBER FIRE EXTINGUISHER ACCU AIR COOLED CONDENSING UNIT CERAMIC TILE ISOLATION JOINT NOM NOMINAL SUPPLY AIR UTILITY CURRENT TRANSFORMER FIRE EXTINGUISHER CABINET ACM ALUMINUM COMPOSITE MATERIAL NEUTRAL SENSOR UNIT VENTILATOR IN JOIST SPACE SANITARY WASTE FINISH FLOOR ACST ACOUSTIC CENTER INTERMEDIATE METAL CONDUIT NOT TO SCALE SECURITY VENT FINISH FLOOR ELEVATION AD ACCESS DOOR INCH COPPER SOLID CORE VOLT OPERATION AND MAINTENANCE FIRE HYDRANT AD AREA DRAIN CONDENSING UNIT INCLUDE (ING) SHOWER CURTAIN VACUUM O to O OUT TO OUT FHC FIRE HOSE CABINET ADDN ADDITION OR ADDITIONAL INSULATION SPECIAL COATING VALVE OVERALL FIG FIGURE INTERIOR ADJUSTABLE COMBINATION UNIT SEAT COVER DISPENSER SCD VACUUM OUTSIDE AIR FIN FINISH ADJACENT CABINET UNIT HEATER IRON PIPE SHOWER CURTAIN HOOKS VARIABLE AIR VOLUME OBSC OBSCURE FIX FIXTURE ADMIN ADMINISTRATION COLD WATER INDIRECT WASTE SCHED SCHEDULE VAPOR BARRIER ON CENTER FLOOR AF AIR FILTER CONDOM VENDOR SCR SHOWER CURTAIN ROD VINYL BASE JANITOR OUTSIDE DIAMETER FLASH FLASHING ABOVE FINISH FLOOR CWR CHILLED WATER RETURN STRUCTURAL CLAY TILE VENT BELOW FLOOR JUNCTION BOX OVERFLOW DRAIN FLEX FLEXIBLF AUTHORITY HAVING JURISDICTION CWS CHILLED WATER SUPPLY SCUT SCUTTLE VENTED COVE BASE JUNCTION OUTSIDE FACE FLUOR FLUORESCENT AHU AIR HANDLING UNIT CUBIC YARD SCW SOFT COLD WATER VITRIFIED CLAY PIPE JOIST OVERFLOW FLG FLOORING AREA INLET CYLINDER SOAP DISPENSER JOINT FILLER BOARD VINYL COMPOSITION TILI OWNER FURNISHED CONTRACTOR INSTALLED FLM FULL LENGTH MIRROR ALTERNATE SMOKE DAMPER JOINT VOLUME DAMPER - MANUAL OFFICE DRAIN FM FACTORY MUTUAL ALUM ALUMINUM SMOKE DETECTOR VELOCITY OFOI OWNER FURNISHED OWNER INSTALLED DEPTH KCJ KEYED CONSTRUCTION JOINT FIRE MAIN AMBIENT STORM DRAIN VENT VENTILATION OVERHEAD POWER DATA FLOW MEASURING EQUIPMENT KEENE'S CEMENT PLASTER ANCH ANCHOR STEAM EXHAUST VENT VENT VENTILATOR OVERHEAD TELEPHONE DRY BULB KNOCKDOWN AP ACCESS PANEL FACE OF SECONDARY VERTICAL OPENING DECIBEL KITCHEN HOOD FINISH OPENING APC ACOUSTICAL PANEL CEILING SECT SECTION VEST OPPOSITE VESTIBULE DEFORMED BAR ANCHOR KITCHEN HOOD EXHAUST FAN FACE OF CONCRETE APPROX APPROXIMATE SECY SECRETARY VINYL FLOOR OSD OVERFLOW STORM DRAIN DOUBLE FOF FACE OF FINISH KITCHEN HOOD SUPPLY FAN AR ACID RESISTING SENS SENSIBLE VARIABLE FREQUENCY DRIVE OS&Y OUTSIDE SCREW AND YOKE DIRECT CURRENT FOF FUEL OIL FILL KITCHEN ARCH ARCHITECTURAL SQUARE FOOT VERIFY IN FIELD OTCS OPEN TO CEILING SPACE DUST COLLECTOR FOM FACE OF MASONRY KNOCKOUT ASB ASBESTOS SUPPLY FAN VOLTMETER OVHD OVERHEAD DUMMY CONTROL JOINT FOR FUEL OIL RETURN KITCHEN SINK ASPH ASPHALT SFCMU SPLIT-FACED CONCRETE MASONRY UNIT VOLUME OXYGEN PENNY (AS NAIL 10D) KILOVOLT FOS AUTO AUTOMATIC FACE OF STUD STRUCTURAL FACING UNIT VENEER PLASTER DIRECT DIGITAL CONTROL KVA KILOVOLT AMPERES FOS FUEL OIL SUPPLY PAINT ACID VENT SINGLE VACUUM PUMP DEIONIZED WATER KVAR KILOVOLT AMPERES REACTIVE FOV FUEL OIL VENT POLE SGWB SECURITY GYPSUM BOARD AIR VENT VSMC VARIABLE SPEED MOTOR CONTROLLER DEG DEGREE FOW FACE OF WALL KW KILOWATT PRESSURE/TEMPERATURE TEST PORT AVERAGE SHOWER VINYL TILE DEPR DEPRESS(ION)(ED) FIREPROOFING KWH KILOWATT HOUR ACID WASTE PUMP SHEATH SHEATHING VTR VENT THROUGH ROOF DEPT DEPARTMENT FIRE PUMP DISCHARGE AMERICAN WIRE GAUGE PUBLIC ADDRESS SHM SECURITY HOLLOW METAL **ANGLE** VWC VINYL WALLCOVERING DETENTION FEET PER MINUTE AWP ACOUSTICAL WALL PANEL PAN B PANIC BOLT SHEET LAVATORY DRINKING FOUNTAIN FR FIRE RESISTIVE PARALLEL SHWSOFT HOT WATER WATER SERVICE LABORATORY COMPRESSED AIR DIESEL FUEL RETURN B to B BACK TO BACK **FRAME** PARTICLE BOARD SIMILAR WIDE; WIDTH LAB LABORATORY DIESEL FUEL SUPPLY FIBERGLASS REINFORCED PANEL BOILER BLOW OFF FRP PULL BOX SHORT LEG WASTE (PLUG) LAMINATE(D) DIESEL FUEL VENT FLOOR SINK BALANCING COCK PUSH BUTTON SEALANT WATT LEAVING AIR TEMPERATURE BCMU BURNISHED CONCRETE MASONRY UNIT DOOR GRILLE FLOW SWITCH PUSH BUTTON STATION WEST SHEET METAL LAVATORY DUCT HEATER FIRE/SMOKE DAMPER WIDE FLANGE BOARD PRECAST SPRINKLER MAIN POUND DISTILLED WATER BACK DRAFT DAMPER FOLDING SHOWER SEAT PUMPED CONDENSATE LUMBER SANITARY NAPKIN DISPOSAL WITH DUCTILE IRON BETWEEN FEET (FOOT) PAPER CUP DISPENSER SANITARY NAPKIN VENDOR WITHOUT POUNDS DIAMETER BACKFLOW PREVENTOR FIN TUBE POUNDS PER CUBIC FOOT STATIC PRESSURE (H2O) WET BULB LOADING DIAG DIAGONAL BELOW FLOOR FLOW TRANSMITTER PORCELAIN CERAMIC TILE STAND PIPE WALL COVERING LINEAR FOOT (FEET BOILER FEED DIFF DIFFUSER FTG FOOTING PRESSURE DROP STATIC PRESSURE WATER COLUMN LENGTH (LONG) BUTTERFLY VALVE DIM DIMENSION FUT FUTURE PUMP DISCHARGE WATER CLOSET LINEAR SPEC SPECIFICATIONS DISC SW DISCONNECT SWITCH FIRE VALVE CABINET BREAK HORSE POWER PLUMBING & DRAINAGE INSTITUTE SPRINKLER WATER COOLED CONDENSER LINO LINOLEUM DISC DISCONNECT FWC FABRIC WALL COVERING BREAKER PENTHOUSE SOUND PRESSURE LEVEL LOCKER DISCH DISCHARGE BUILDING LINE GRILLE PERFORATED WCO WALL CLEAN OUT SPECIAL LIVE LOAD DISTR DISTRIBUTION BLDG BUILDING PERP NATURAL GAS PERPENDICULAR SPL BLK SPLASH BLOCK WOOD LONG LEG HORIZONTAL DEAD LOAD BLOCK POWER FACTOR WDW GAUGE WINDOW LLV LONG LEG VERTICAL SQUARE DAMPER MOTOR BLKG BLOCKING GALLON PRESSURE GAGE STAINLESS STEEL WASH FOUNTAIN, WATER FOUNTAIN LOC LOCATION DMPR DAMPER BLKHD BULKHEAD PHASE GALV GALVANIZED LONG LONGITUDINAL STORM SHELTER AREA WH WALL HYDRANT DOWN BFAM POINT OF INTERSECTION WFMD WATER FLOW MEASURING DEVICE GRAB BAR SERVICE SINK LOX LIQUID OXYGEN DOWNSPOUT NOZZLE BENCH MARK PRESSURE INDICATOR GENERAL CONTRACTOR LPG LIQUEFIED PETROLEUM GAS SOLID SURFACE WATER HEATER DO OR " DITTO BOTTOM OF DUCT GRADE CLEAN OUT PORTABLE INSTRUMENT CONNECTION WHM WATT HOUR METER STAIR LOW PRESSURE STEAM RETURN DPFG DAMPROOFING BOTTOM OF FOOTING GCMU GLAZED CONCRETE MASONRY UNIT POST INDICATOR VALVE STORM SEWER WROUGHT IRON LOW PRESSURE STEAM SUPPLY DIFFERENTIAL PRESSURE SWITCH BOTTOM PLACE(S) GD GARBAGE DISPOSAL STAG'D STAGGERED WLR WATER LOOP RETURN LIVING ROOM BRDG BRIDGING BRG BEARING DOOR PLATE SOUND TRANSMISSION CLASS WLS WATER LOOP SUPPLY GENERAL LAWN SPRINKLER DRAIN PLAM:PL PLASTIC LAMINATE GENERATOR GEN WMG WATER MOTOR GONG LIFE SAFETY CODE STANDARD DOWNSPOUT BRACKET PLAS PLASTER GFA **GROSS FLOOR AREA** SINGLE TAPERED END WNSCT WAINSCOT STE BSMT BASEMENT DISTILLED WATER PLRG PLUMBING GFI GROUND FAULT INTERRUPTER STGR STRINGER WP WEATHERPROOF LINED TRANSFER DUCT DRY STANDPIPE BATH TUR GLASS FIBER REINFORCED CONCRETE PLYWD PLYWOOD WPB WHIRLPOOL BATH STL STEEL LIGHTING DETAIL BRITISH THERMAL UNIT GLYCOL-WATER HEATING RETURN PNEU PNEUMATIC STOR STORAGE WATERPROOF LOUVER DUCT THRU ROOF BRITISH THERMAL UNIT PER HOUR PANEL GLYCOL-WATER HEATING SUPPLY STR STRUCTURAL - STRUCTURE WPFG WATERPROOFING LABORATORY VACUUM DISHWASHER BUR BUILT UP ROOFING POC POINT OF CONNECTION SUBSTATION WATER RESISTANT GALVANIZED IRON LW LONG WAY DWG DRAWING BALL VALVE PORC PORCEI AIN GLUE LAMINATED SUBFL SUBFLOOR WASTE RECEPTACLE LWT LEAVING WATER TEMPERATURE DOWEL WSP WET STAND PIPE POT PATH OF TRAVEL GLASS SURF SURFACE DWR DRAWER PPM PARTS PER MILLION THOUSAND GLASS MASONRY UNIT SUSP SUSPENDED WEIGHT CONDUIT DXS DOUBLE EXTRA STRONG MIXED AIR PAIR WW WARM WHITE GND GROUND SHEET VINY COMBUSTION AIR MA MEDICAL COMPRESSED AIR GOVT GOVERNMENT PREFAB PREFABRICATED SOLENOID VALVE WWF WELDED WIRE FABRIC CABINET MAC MACHINE GALLONS PER HOUR PROJ PROJECTION SHORT WAY CANT CANTILEVE CAP CAPACITY CANTILEVER EXISTING XFMR TRANSFORMER MAG MAGNETIC GALLONS PER MINUTE PRESSURE REDUCING VALVE SWITCH EACH MAINT MAINTENANCE XMTR TRANSMITTER PIPE SUPPORT SWBD SWITCH BOARD GUARD RAIL CASING EXHAUST AIR man manual PROJECTION SCREEN GRADE SWP STEAM WORKING PORESSURE YARD CBD CHALKBOARD ENTERING AIR TEMPERATURE MAS MASONRY POUNDS PER SQUARE FOOT GRILLE SYM SYMMETRICAL YARD HYDRANT CONDENSATE DRAIN EXPANSION BOLT GLAVANIZED RIGID CONDUIT MATL MATERIAL POUNDS PER SQUARE INCH GRC **IMPEDANCE** CCTV CLOSED CIRCUIT TELEVISION ELECTRICAL CONTRACTOR MAU MAKEUP AIR UNIT GLASS REINFORCED CONCRETE PRESSURE SAFETY VALVE ZONE CONTROL VALVE COVER FLEVATION TEMPERED ELECTRIC DUCT HEATER MAV MANUAL AIR VENT PLASTER TRAP GRGP GLASS REINFORCED GYPSUM PLASTER CEM CEMENT THERMOSTAT ZONE VALVE BOX EACH END MAX MAXIMUM GALVANIZED RIGID STEEL POINT CENT CENTRIFUGAL T & B TOP & BOTTOM ENERGY EFFICIENCY RATIO MB MACHINE BOLT POTENTIAL TRANSFORMER GASOLINE CER CERAMIC EEW EMERGENCY EYEWASH T& G **TONGUE & GROOVE** MOP BASIN PAPER TOWEL DISPENSER GATE VALVE ΑT CUBIC FEET EEWS EMERGENCY EYEWASH/SHOWER TREAD MBD MARKER BOARD PTD/R COMBINATION TOWEL DISPENSER/RECEPTACLE GREASE WASTE THAT IS CFH CUBIC FEET PER HOUR TRANSFER AIR FACH FACE GYPSUM WALL BOARD MBH THOUSAND BTU PER HOUR PTN PARTITION NUMBER CUBIC FEET PER MINUTE EXHAUST FAN TEST AND BALANCE MBTUH THOUSAND BTU PER HOUR POLYVINYL CHLORIDE GYPSUM CORNER GUARD EFFICIENCY TANGENT MECHANICAL CONTRACTOR POINT OF VERTICAL INTERSECTION TERMINAL BOX CHANNEL ELECTRICAL HEATER MEDICINE CABINET POINT OF VERTICAL TANGENCY THE FOLLOWING ABBREVIATIONS CAST IRON EXTERIOR INSULATION AND FINISH SYSTEM TOWEL BAR MCA MINIMUM CIRCUIT AMPS SOUND POWER LEVEL ARE USED WITH GLAZING: **CURB INLET** EXPANSION JOINT HEIGHT TACK BOARD MCB MAIN CIRCUIT BREAKERJ PWR POWER CAST IN PLACE ELEVATION H1E HOOK ONE END TEMPERATURE CONTROL CLEAR FLOAT GLASS MCM THOUSAND CIRCULAR MILLS QUARRY TILF CAST IRON PIPE ELAS ELASTOMERIC TIME CLOCK HOSE BIB CLEAR INSULATING GLASS MANUAL VOLUME DAMPER QTR RND QUARTER ROUND CIRC CIRCULATING ELEC ELECTRIC(AL) TRANSFER DUCT HOLLOW CORE CLEAR TEMPERED FLOAT GLASS MDO MEDIUM DENSITY OVERLAY CONTROL JOINT RISER ELEV ELEVATOR TRENCH DRAIN HCR HOT / CHILLED WATER RETURN MECH MECHANICAL CTIG CLEAR TEMPERED INSULATING GLASS RETURN AIR CONTROL JOINT ABOVE TOTAL DYNAMIC HEAD EMER EMERGENCY HCS HOT / CHILLED WATER SUPPLY MEMB MEMBRANE LAMINATED GLASS RADIATOR CKT CIRCUIT EMD ESTIMATED MAXIMUM DEMAND HAND DRYER OR HAIR DRYER TELEPHONE PATTERN GLASS MET METAL RAD or R RADIUS CKT BK CIRCUIT BREAKER TEMP TEMPERED - TEMPORARY EMT ELECTRICAL METALLIC TUBING HDBD HARDBOARD PATTERN INSULATING GLASS MEZZ MEZZANINE RUBBER BASE CENTERLINE TEMP TEMPERATURE EMV EMERGENCY MIXING VALVE HDR HEADER MFR MANUFACTURER SPANDREL GLASS CIRCUIT LINE REMOVE CONTROL TERR TERRAZZO ENCL ENCLOSURE HDWD HARDWOOD TINTED FLOAT GLASS MFRG MANUFACTURING RCP REFLECTED CEILING PLAN TEXT CLG CEILING ENTR ENTRANCE TEXTURED HDWR HARDWARE MG MOTOR GENERATOR TINTED INSULATING GLASS CLOS CLOSET REINFORCED CONCRETE PIPE TGL TOGGLE EOMD END OF MAIN DRIP HEV HOSE END VALVE MANHOLE TINTED TEMPERED FLOAT GLASS RCU RECIPROCATING CHILLER JOINT THRESHOLD ELECTRO-PNEUMATIC HIGH INTENSITY DISCHARGE METAL HALIDE TTIG TINTED TEMPERED INSULATING GLASS CM CEILING MOUNTED TOWEL HOOK EXPLOSION PROOF HOLLOW METAL MOP HOLDER WG POLISHED WIRE GLASS REFRIGERANT DISCHARGE CORRUGATED METAL PIPE EPO EMERGENCY POWER OFF HOA HAND OFF AUTOMATIC THICK(NESS) MIN MINIMUM RECP RECEPTACLE CMU CONCRETE MASONRY UNIT EPOXY RESIN FLOORING HORIZ HORIZONTAL TMR TILT MIRROR UNIT MISC MISCELLANEOUS REFERENCE CO CLEAN OUT THERMOSTATIC MIXING VALVE EQUAL HEAT PUMP ML MOTORIZED LOUVER REFL REFLECTED CONDUIT ONLY EQUIP EQUIPMENT TOB TOP OF BEAM HIGH PRESSURE MLDG MOLDING CARBON DIOXIDE REFR REFRIGERAN TOP OF CONCRETE EXHAUST REGISTER HORSEPOWER MLO MAIN LUGS ONLY REFR REFRIGERATOR COLUMN TOP OF FOOTING EMERGENCY SHOWER HIGH PRESSURE STEAM RETURN MLWK MILLWORK COM COMMON REG REGISTER EXTRA STRONG TOIL TOILET HIGH PRESSURE SODIUM MO MASONRY OPENING REINF REINFORCEMENT COMB COMBINATION TOP TOP OF PAVING ESP EXTERNAL STATIC PRESSURE HIGH PRESSURE STEAM SUPPLY HPS MPG MEDIUM PRESSURE GAS REM REMOVABLE COMM COMMUNICATIONS ESTIMATE HANDRAIL TOS TOP OF STEEL MPR MEDIUM PRESSURE STEAM RETURN REQ(D) REQUIRE(D)COMP COMPOSITE TOW TOP OF WALL EXPANSION TANK HOUR MPS MEDIUM PRESSURE STEAM SUPPLY RESIL RESILIENT COMP COMPRESSOR UNIT EACH WAY TPV TRAP PRIMER HEADSTUD MR MIRROR COMPR COMPRESSIBLE RETAINING (WALL) EWCELECTRIC WATER COOLER HOLLOW STRUCTURAL SECTION MR/S MIRROR WITH SHELF REVISIONS CONC CONCRETE TRANS TRANSVERSE EWHELECTRIC WATER HEATER HSTR HIGH STRENGTH MS MAGNETIC STARTER RETURN FAN CONF CONFERENCE EWT ENTERING WATER TEMPERATURE HEIGHT TRD TREAD MTD MOUNTED RUBBER FLOOR CONFIG CONFIGURATION EXC EXCAVATE TEMPERATURE SENSOR HTG HEATING MTG MOUNTING RFM RECESSED FLOOR MAT CONN CONNECT EXH EXHAUST HTR HEATER TOTAL STATIC PRESSURE MTL METAL CONN CONNECTION RELATIVE HUMIDITY TEMPERATURE TRANSMITTER EXIST EXISTING HTWR HIGH TEMP HOT WATER RETURN MTWR MEDIUM TEMP HOT WATER RETURN RELIEF HOOD CONST CONSTRUCTION EXP EXPANSION TERRAZZO TILE HTWS HIGH TEMP HOT WATER SUPPLY MTWS MEDIUM TEMP HOT WATER SUPPLY CONT CONTINUOUS REHEAT COIL TOILET TISSUE DISPENSER EXP EXPOSED HUM HUMIDIFIER MUL MULLION ROBE HOOK CONTR CONTRACTOR OR CONTRACT EXPL EXPLOSION HEATING VENTILATING UNIT TELEVISION MV MERCURY VAPOR REFRIGERANT HOT GAS CONV CONVECTOR TW EXTERIOR HEATING VENTILATING AND AIR CONDITIONING TACK WALL MV MEDICAL VACUUM ROUGH IN AND CONNECT CORR CORRIDOR TYP TYPICAL DOMESTIC HOT WATER HW FAHRENHEIT MW MARKER WALL RISE IN JOIST SPACE CP CONDENSER PUMP DOMESTIC HOT WATER RECIRCULATING FIRELINE COVER PLATE REFRIGERANT LIQUID NITROGEN LOW TEMP HOT WATER RETURN FURNACE ROOM URINAI CPS CYCLES PER SECOND HWS LOW TEMP HOT WATER SUPPLY NORTH FIRE ALARM

GENERAL NOTES

CONDENSER WATER RETURN

1. GENERAL NOTES APPLY TO ALL DRAWINGS 2. ALL DIMENSIONS ARE ACTUAL AND ARE TO FACE OF METAL

CARPET

ADJ

AMB

BFR

BKR

BLK

BOD

BOF

BOTT

BRKT

CAB

3. GENERAL CONTRACTOR SHALL COORDINATE ALL MECHANICAL CHASE SIZES WITH MECHANICAL

UNLESS NOTED OTHERWISE.

SUBCONTRACTOR.

4. WALL OPENINGS FOR FIRE DAMPERS SHALL BE FRAMED PER THE FIRE DAMPER MANUFACTURER'S RECOMMENDATIONS.

STUDS, FACE OF MASONRY OR CENTERLINE OF COLUMN,

- 5. ELECTRICAL PLANS INDICATE THE GENERAL DESIGN AND ARRANGEMENT OF PIPES, CONDUIT, WIRING, EQUIPMENT SYSTEMS, ETC. INFORMATION SHOWN IS DIAGRAMMATIC IN CHARACTER AND DOES NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING AND EXISTING CONDITION I OCATION OF THESE ITEMS MAY BE ADJUSTED CONDITIONAL UPON THE SATISFACTORY COMPLIANCE WITH ALL OTHER REQUIREMENTS.
- 6. ALL WALL PENETRATIONS AT RATED WALL LOCATIONS REQUIRED FOR PIPES, CONDUIT, DUCTING ETC, SHALL BE SEALED TO STOP PASSAGE OF FIRE AND / OR SMOKE WITH FIRE SAFING AND APPROVED FIRESTOPPING SEALANT PER DETAILS ON SHEETS GX.XX.
 - 7. THE GENERAL CONTRACTOR SHALL COORDINATE CUT-OUTS FOR CASEWORK, MILLWORK, OR OTHER EQUIPMENT AS REQUIRED.
 - 8. ALL ASPECTS OF THE WORK AND ITEMS NOT SPECIFICALLY MENTIONED, BUT WHICH ARE NECESSARY TO MAKE A COMPLETE WORKING INSTALLATION, SHALL BE INCLUDED, AND INDICATED IN THE CONTRACTORS BID.
 - 9. NO ASBESTOS OR PCB CONTAINING MATERIALS SHALL BE USED ON THIS PROJECT.
 - 10. THE GENERAL CONTRACTOR AND ALL SUBCONTRACTORS ARE RESPONSIBLE FOR PROPER REMOVAL AND DISPOSAL OF ALL DEBRIS GENERATED BY CONSTRUCTION OF THIS PROJECT. THE REMOVAL AND DISPOSAL OF ALL CONSTRUCTION DEBRIS SHALL BE IN FULL COMPLIANCE WITH ALL FEDERAL, STATE AND LOCAL REGULATIONS. THE PREMISES SHALL BE KEPT CLEAN AND FREE FROM ALL WASTE MATERIALS.

11. GENERAL CONTRACTOR SHALL PROTECT NEW CONSTRUCTION FROM DAMAGE BY ALL TRADES. ALL SUCH DAMAGE CAUSED BY THE CONTRACTOR DURING THE COURSE OF THIS WORK SHALL BE REPAIRED OR REPLACED AT THE CONTRACTORS EXPENSE. 12. CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFICATION OF ALL DIMENSIONS AND FIELD

FRESH AIR

MATERIALS OR EQUIPMENT. 13. ALL PIPING AND CONDUITS SHALL BE CONCEALED WITHIN WALLS, UNDERGROUND, ABOVE CEILINGS OR IN ARCHITECT APPROVED UTILITY SPACES IN ALL CASES UNLESS SPECIFICALLY NOTED OTHERWISE ON THE DRAWINGS, EXPOSED ITEMS MUST BE LOCATED IN AREAS APPROVED BY THE ARCHITECT, EXPOSED ITEMS SHALL BE INSTALLED AND FINISHED TO PROVIDE MINIMAL VISUAL IMPACT, ALL EXPOSED ITEMS ARE TO BE PAINTED TO MATCH THE ADJACENT SURFACES

UNLESS SCHEDULED FOR AN ACCENT COLOR.

CONDITIONS PRIOR TO ORDERING OR INSTALLING

- 14. FLOOR SPOT ELEVATIONS ARE SHOWN THUS: 0'-0"
- 15. ARCHITECTURAL FINISH FLOOR ELEVATIONS 0'-0" EQUALS ACTUAL SITE REFERENCE OF FINISH FLOOR:
- 16. PLAN SYMBOL INDICATES WALL TYPE SEE SHEET A0.2 FOR DESCRIPTION OF WALL TYPES
- 17. SCRIBE GYPSUM BOARD OF WALLS AND PARTITIONS TO IRREGULARITIES OF STRUCTURE AND ROOF DECK ABOVE.
- 18. PROVISIONS SHALL BE MADE AT FULL HEIGHT NON-BEARING WALLS FOR 2- INCH VERTICAL MOVEMENT OF THE BUILDING STRUCTURE WITHOUT TRANSFER OF COMPRESSIVE LOADS TO WALL. FILL IRREGULARITIES BETWEEN TOP OF WALL AND DECK ABOVE WITH FIRE SAFING INSULATION OR FIRE STOPPING MATERIALS AS REQUIRED TO MEET FIRE RATING OF RESPECTIVE WALLS. FILL AT SMOKE PARTITIONS WITH MATERIALS CAPABLE OF RESISTING THE PASSAGE OF SMOKE. SEE
- DETAILS ON CODE RATING DETAIL SHEETS. 19. NOTE: SLOPE REQUIREMENTS FOR THIS PROJECT TO MEASURED FOR ACCESSIBILITY BY MEANS OF A 2' SMART LEVEL. NO OTHER METHOD WILL BE ACCEPTED TO VERIFY COMPLIANCE, CONTRACTOR WILL REMOVE DEFICIENT WORK AT THEIR EXPENSE.

20. ELECTRICAL SCOPE OF WORK FOR THIS PROJECT CONSIST OF RE-USE AND RE-ROUTING OF EXISTING ONLY. THERE WILL BE NO NEW ELECTRICAL RUNS.

HEAT EXCHANGER

HERTZ

HZ

N2O NITROUS OXIDE

N/A NOT APPLICABLE

21. CALL BOXES AND COMMUNICATION DEVICES NOTED AS BARRIERS ARE BASED ON ACCESSIBILITY HEIGHT CODI REQUIREMENTS. SCOPE OF WORK FOR THIS PROJECT CONSIST OF RELOCATING MOUNTING HEIGHT OF COMMUNICATION DEVICES AT LOCATIONS NOTED ON

?)—— — COLUMN LINE ROOM NAME ? WATER CLOSET/LAVATORY COMBINATION DESCRIPTION 9' - 0" **DEMOLITION NOTES**

UNIT COOLER

UG UNDERGROUND

ROUND

RO ROUGH OPENING

A. DEMOLITION GENERAL NOTES APPLY TO ALL DEMOLITION SHEETS. B. COORDINATE DEMOLITION AND PHASING EFFORTS WITH ARCHITECT, ENGINEERS AND OWNER'S REPRESENTATIVES. EVERY EFFORT SHALL BE MADE TO MINIMIZE DISRUPTION OF THE FACILITIES OPERATIONS AND TO PROVIDE BUILDING USER'S SAFETY. EXCESSIVE NOISE OR VIBRATION SHALL BE PRE-APPROVED AND COORDINATED WITH OWNER'S REPRESENTATIVE. C. COORDINATE DISRUPTION OF UTILITY SERVICES WITH OWNER AND AS SPECIFIED

CONSTRUCT TEMPORARY CONSTRUCTION PARTITIONS WITHIN EXISTING BUILDING WHICH OFFER A

ONE-HOUR ENCLOSURE TO ISOLATE DEMOLITION AND CONSTRUCTION WORK FROM GENERAL PUBLIC

GENERAL SYMBOLS

DETAIL NUMBER

WALL SECTION

DETAIL REFERENCE

BUILDING SECTION

BUILDING ELEVATION

INTERIOR ELEVATION

CASEWORK

ELEVATION

BARRIER KEYNOTE

LEGEND/KEY NOTE

ROOM NUMBER

DOOR NUMBER

WALL TYPE

WINDOW NUMBER

REVISION NUMBER

TOP - CEILING TYPE

BOTTOM - CEILING HEIGHT

CEILING TAG

CROSS REFERENCE

SHEET ON WHICH DRAWN

SIMILAR OR TYPICAL REFERENCE

SIMILAR OR TYPICAL REFERENCE

GRAVEL/BALLAST

CONCRETE

STEEL

PRECAST CONCRETE

GYM FLOOR

(CONTINUOUS BLOCKING)

(NON-CONTINUOS BLOCKING)

WOOD

WOOD

STONE

SHINGLES

BRICK VENEER

_____ METAL STUDS

STEEL (LARGE SCALE)

GYPSUM WALL BOARD

BATT INSULATION

PROTECTION BOARD

LARGE SCALE)

TILE (LARGE SCALE)

PLYWOOD (LARGE SCALE)

(LARGE SCALE)

RIGID INSULATION

ACOUSTICAL TILE (LARGE SCALE)

CONCRETE MASONRY UNIT

| /// /// | GLASS


(TRIM/FINISH)

- AND AS DEEMED NECESSARY BY OWNER AND CODE OFFICIAL HAVING JURISDICTION. COORDINATE LOCATIONS WITH OWNER AND MAINTAIN MEANS OF EGRESS THROUGHOUT THE WORK. MAINTAIN A SECURE AND WEATHER-TIGHT ENCLOSURE. F. VERIFY EXISTING CONDITIONS, DIMENSIONS, AND ELEVATIONS AND NOTIFY ARCHITECT OF
- G. REMOVE EXISTING WALLS, DOORS, MILLWORK, PLUMBING FIXTURES, CEILINGS, SOFFITS, MARKERBOARDS, ETC. IN THEIR ENTIRETY AND AS REQUIRED TO EXECUTE DEMOLITION AND CONSTRUCTION WORK DESCRIBED ON THE DRAWINGS. H. THE OWNER SHALL RESERVE THE RIGHT TO SALVAGE ANY MATERIALS.
- PROVIDE PROTECTION FOR EXISTING BUILDING MATERIALS AND EQUIPMENT FROM DAMAGE DUE TO DEMOLITION OR CONSTRUCTION-RELATED INCIDENT PERFORMED UNDER THIS CONTRACT. I. REPAIR OR REPLACE ITEMS DAMAGED AS A RESULT OF DEMOLITION OR CONSTRUCTION TO MATCH EXISTING FINISH AND /OR CONDITION. K. EXISTING MATERIALS SHALL NOT BE REUSED UNLESS NOTED OTHERWISE OR AS AUTHORIZED BY
- L. VERIFY AND MAINTAIN LOCATION OF EXISTING POWER, COMMUNICATION AND DATA CABLES TO PREVENT INTERRUPTION OF SERVICE. M. PATCH FLOOR, WALL AND CEILING PENETRATIONS RESULTING FROM REMOVAL OR REROUTING OF NEW OR EXISTING PIPING, DUCTWORK, CONDUIT, ETC. AS REQUIRED TO MAINTAIN FIRE SEPARATIONS.
- MATCH FINISH OF NEW OR EXISTING ADJACENT SURFACES. N. CAP DISCONNECTED MECHANICAL PIPING LINES WITHIN WALL OR FLOOR. PATCH AND FINISH AS REQUIRED TO MATCH NEW OR EXISTING ADJACENT SURFACES. O. SEE MECHANICAL AND PLUMBING DRAWINGS AND NOTES FOR FURTHER SEQUENCING AND SCOPE OF
- P. WHERE CMU WALLS ARE INDICATED TO BE REMOVED; PREPARE ADJACENT WALLS TO RECEIVE NEW PATCH/FINISH BY REMOVING CMU IN TOOTH-IN PATTERN BOTH SIDES OF DEMOLITION FOR CONTRACTOR TO TOOTH IN NEW CMU PATCHES. Q. WHERE PLASTER/STUD WALLS ARE INDICATED TO BE REMOVED; PREPARE ADJACENT WALLS TO

BEYOND DEMOLITION.

RECEIVE NEW PATCH/FINISH BY SAWCUTTING ADJACENT PLASTER FINISH A MINIMUM OF 12 INCHES

MONITOR REVIEWED FOR ACCESS COMPLIANCE PER SETTLEMENT AGREEMENT DATE: 4/16/2018 HIBSER YAMAUCHI Architects, Inc

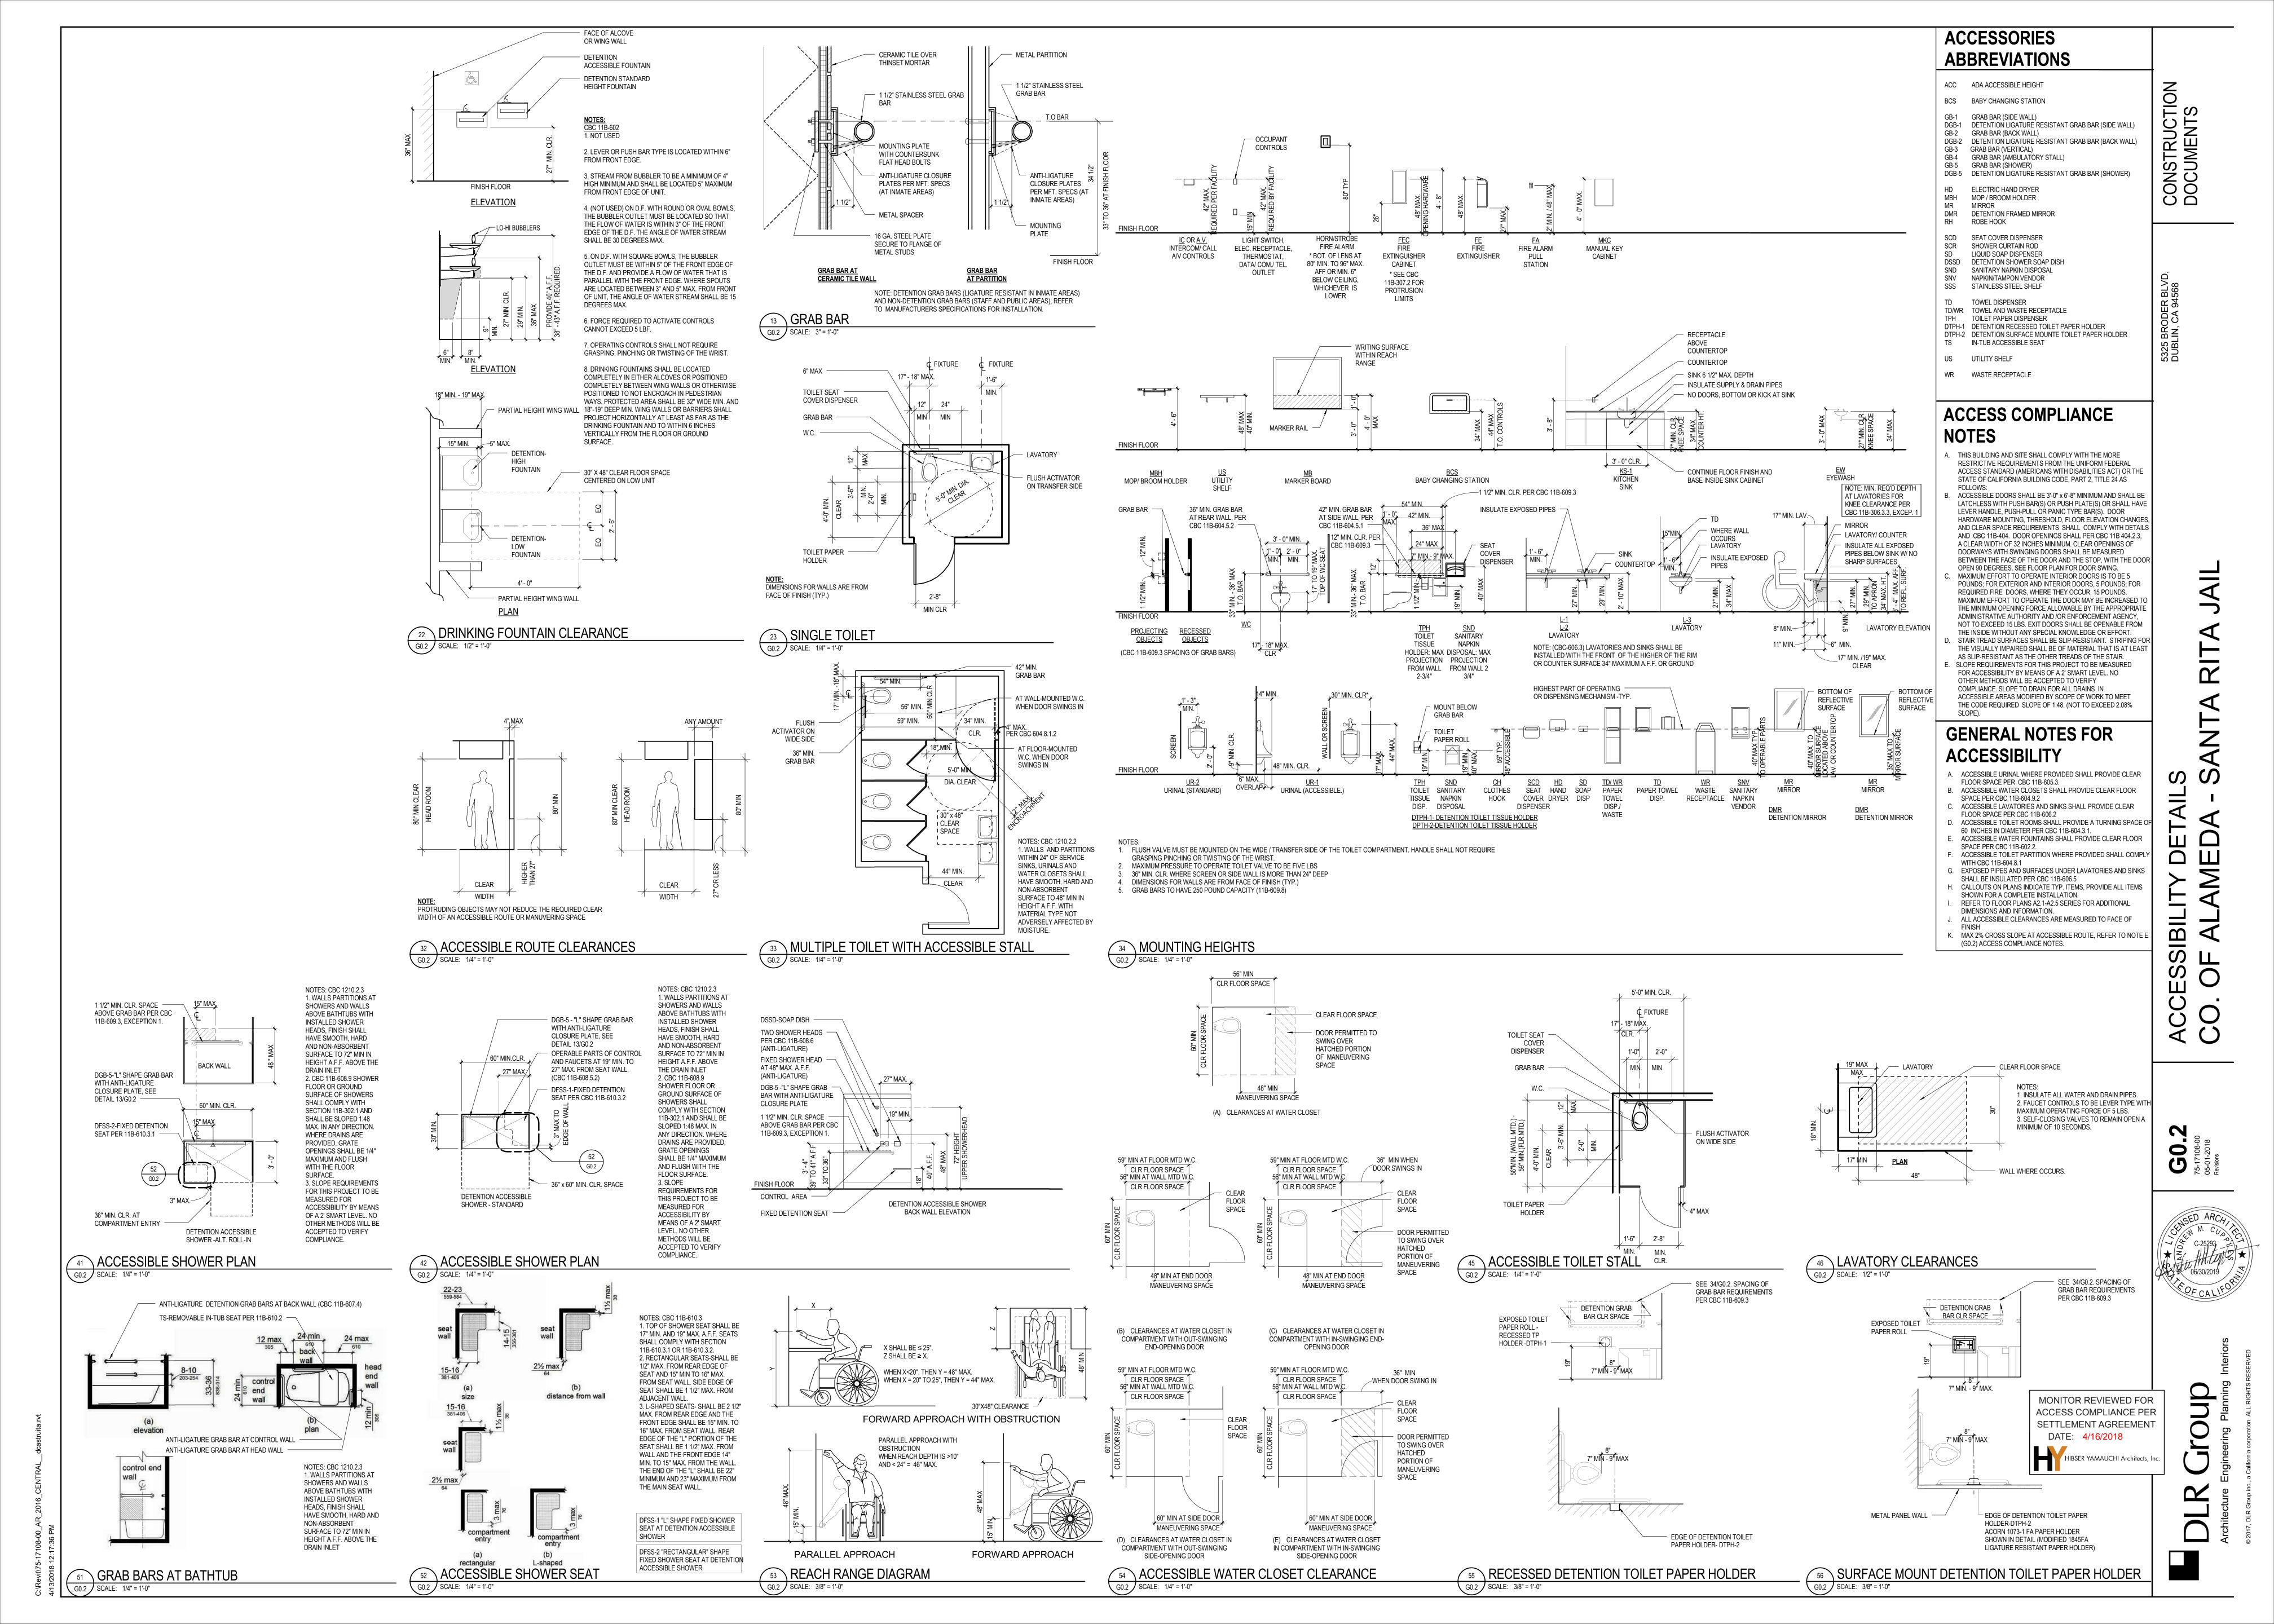

DOOR AND GATE CLOSER SHALL BE ADJUSTED FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO 12 DEGREES POSITION FROM THE LATCH IS 5

AT PRIMARY ENTRANCE. 'ISA' SIGN 6"X6"

SECONDS MINIMUM. COMPLY W/

ACCESSIBLE ENTRANCE SIGN

LEVER DOOR HANDLE / PANIC BAR

SMOOTH, UNINTERRUPTED DURABLE SURFACE.

CBC 11B-404.2.8.1

TYP. THIS LOCATION.

WHERE OCCURS

(CBC 11B-404.2.10) 10" HIGH MIN SMOOTH UNINTERRUPTED DURABLE SURFACE

- BOTTOM RAIL OF DOOR

1/2" MAXIMUM

- ALUMINUM THRESHOLD (OR AS NOTED)

- INTERNATIONAL FEMALE / MAI SYMBOL 6"H. X 2 1/2" W. MAX. 1/2" RADIUS TYPICAL - INTERNATIONAL SYMBOL OF ACCESSIBILITY 6"H. X 3 1/2"W. - ROOM NAME1" HIGH RAISED LETTTERS 60" MAX. 3/8" MIN TO - ROOM NAME 1/2" MAX (CA CONTRACTED B.O. BRAILLE 48" MIN. GRADE 2 BRAILLE) MOUNTING PER CBC 703.4.2 INSTALL SIGNAGE ON THE WALL ADJACENT TO THE LATCH SIDE OF THE DOOR. CENTER OF SIGN SHALL BE 14" MAX. FROM DOOR SWING. WHERE THERE IS NO WALL SPACE LATCH SIDE OF THE DOOR, INCLUDING DOUBLE LEAF DOORS, SIGNS SHALL BE PLACED ON THE NEAREST ADJACENT WALL AND APPROVED IN ADVANCE BY THE ARCHITECT. MOUNTING HEIGHT SHALL BE 60" FROM THE FLOOR TO THE RAISED CHARACTERS AND PICTORIAL SYMBOL SIGNS TEXT TO BE TACTILE, RAISED 5/8" MIN., MAXIMUM OF 2" HIGH TO MEET CBC 11B-703.2 REQUIREMENTS. WITHIN SECURE PERIMETER OF DETENTION AND

G0.3 SCALE: 1/4" = 1'-0" - INTERNATIONAL FEMALE / MALE SYMBOL 6"H. X 2 1/2" W. MAX. TRDS: APPLY SYMBOLS TO RESTROOM 1/2" RADIUS TYPICAL DOORS AS FOLLOWS: "UNISEX" SYMBOL: 1/4" THICK - INTERNATIONAL SYMBOL OF **EQUILATERAL TRIANGLE WITHIN 12"** ACCESSIBILITY 6"H. X 3 1/2"W. MAX. DIA. X 1/4" THICK CIRCLE - COLOR TRIANGLE TO CONTRAST W/ CIRCLE. ROOM NAME: "WOMEN" SYMBOL: MEN OR WOMEN 12" DIA. X 1/4" THICK CIRCLE COLOR SHALL CONTRAST THAT OF DOOR

RAISED LETTTERS
60" MAX. 12" DIA. X 1/4" THICK CIRCLE -1" HIGH - "MEN" SYMBOL: - ROOM NAME 1/4" THICK EQUILATERAL TRIANGLE (CA CONTRACTED WITH EDGES 12" LONG - COLOR SHALL GRADE 2 BRAILLE) CONTRAST THAT OF DOOR CENTER SYMBOL ON APPROPRIATE DOOR


HEIGHT
48" TYP. MEN/WOMEN SIGNAGE NOT APPLICABLE TO THIS PROJECT

CENTERLINE OF THE SIGN. SECURE SIGNS WITH TAMPER-RESISTANT ANCHORS/SCREWS.


ROOM IDENTIFICATION 'RID' PANEL SIGN WITH RAISED LETTERS, MOUNTED AT STRIKE SIDE OF DOOR. MOUNT APPROPRIATE SIGN AT TOILET ROOM, OFFICE OR OTHER ROOM

G0.3 | SCALE: 1/4" = 1'-0"

SLOPE AT 1 VERTICAL :2 HORIZONTAL, MAX

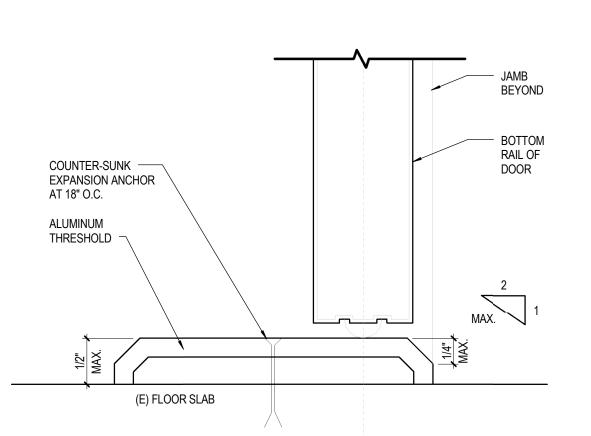

25 DOOR SIGNAGE
G0.3 SCALE: 1/2" = 1'-0" 24 THRESHOLD
G0.3 SCALE: 12" = 1'-0"

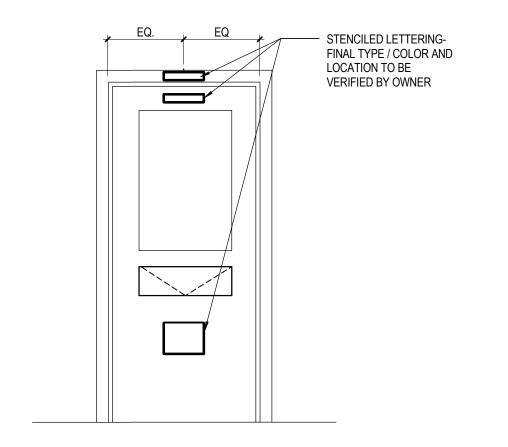


15 DOOR SIGNAGE

G0.3 SCALE: 1/2" = 1'-0"

CELL DOORS TO BE IDENTIFIED WITH A


PAINTED NUMBERED SIGN AS SHOWN.

VERIFY EXACT IDENTIFICATION FORMAT, LOCATION AND FEATURES WITH OWNER

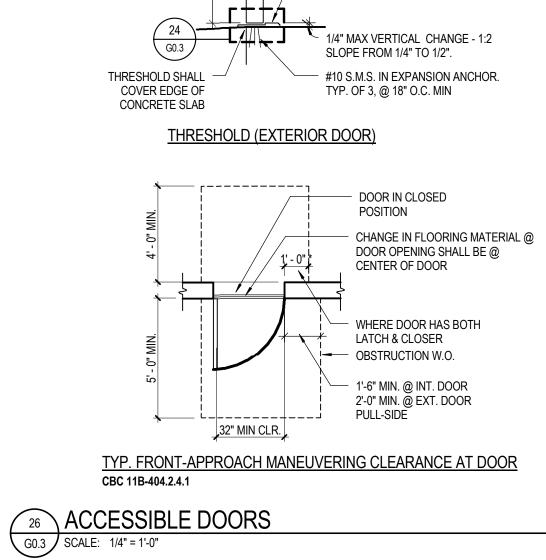


3' - 0" DOOR WIDTH


ENTRANCE/EXIT DOOR NOT USED

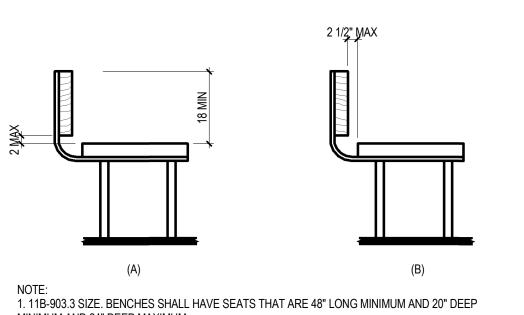

MINIMUM AND 24" DEEP MAXIMUM. 2. 11B-903.5 HEIGHT. TOP OF BENCH SEAT SURFACE SHALL BE 17" MINIMUM AND 19" MAXIMUM A.F.F OR GROUND. 3. 11B-903.4 BACK SUPPORT. THE BENCH SHALL BE AFFIXED TO A WALL ALONG ITS LONG 4. STRUCTURAL STRENGTH OF BENCHES PER CBC 11B-903.6 5. CLEAR FLOOR OR GROUND SPACE PER CBC 11B-903.2



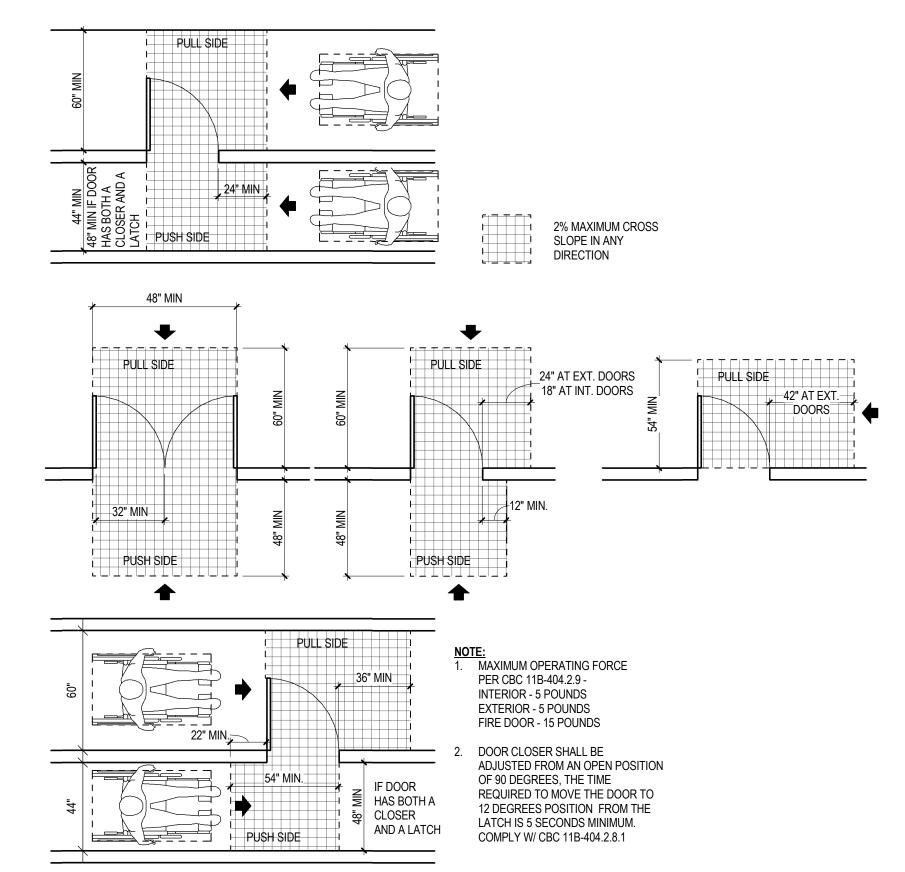

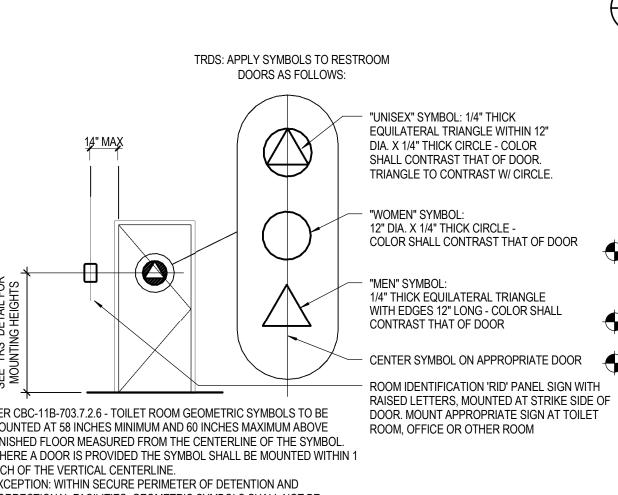

PER CBC-11B-703.7.2.6 - TOILET ROOM GEOMETRIC SYMBOLS TO BE MOUNTED AT 58 INCHES MINIMUM AND 60 INCHES MAXIMUM ABOVE FINISHED FLOOR MEASURED FROM THE CENTERLINE OF THE SYMBOL. WHERE A DOOR IS PROVIDED THE SYMBOL SHALL BE MOUNTED WITHIN 1 INCH OF THE VERTICAL CENTERLINE. EXCEPTION: WITHIN SECURE PERIMETER OF DETENTION AND CORRECTIONAL FACILITIES, GEOMETRIC SYMBOLS SHALL NOT BE REQUIRED TO BE 1/4" INCH THICK. SECURE SIGNAGE WITH DETENTION GRADE TAMPER RESISTANT ANCHORS/SCREWS. TOILET ROOM DOOR SIGNAGE "TRDS"

SIGNAGE MUST MEET A.D.A. & CBC TITLE 24 REQUIREMENTS AND COMPLY WITH CBC 11B-703.7.2.6.3 FOR UNISEX TOILET AND BATHING FACILITIES, EXCEPTION. CORRECTIONAL FACILITIES, GEOMETRIC SYMBOLS SHALL NOT BE REQUIRED TO BE 1/4" INCH THICK. PER CBC 11B-703.7.2.6.4 EDGES AND VERTICES ON GEOMETRIC SYMBOLS-EDGES SHALL BE EASED OR ROUNDED AT 1/16" MINIMUM OR CHAMFERED AT 1/8" MAXIMUM. VERTICES SHALL BE RADIUSED BETWEEN 1/8" INCH MINIMUM AND 1/4" MAXIMUM. TOILET ROOM SIGNAGE "TRS"

G0.3 SCALE: 3" = 1'-0"

MONITOR REVIEWED FOR ACCESS COMPLIANCE PER SETTLEMENT AGREEMENT DATE: 4/16/2018 HIBSER YAMAUCHI Architects, Inc.

PT / CT CONC

TRANSITION STRIP

SUBSTRATE

- TRANSITION STRIP

CONCRETE SUBSTRATE

RTF * PT

TYPICAL FLOOR TRANSITIONS

G0.3 SCALE: 1 1/2" = 1'-0"

LEGEND NOTES

LEGEND NOTES ARE COMMON TO ALL SOME NOTES MAY NOT APPLY TO THIS SHEET

ISSUE TYPE

A ACCESSIBILITY LITIGATION ISSUE CLIENT REQUESTED ISSUE L-R LIGATURE ISSUE RELATED TO AN ACCESSIBILITY ISSUE L-U LIGATURE ISSUE UNRELATED TO AN ACCESSIBILITY ISSUE OTHER ISSUE S SECURITY ISSUE

CELL BUNDLES

CB0=104, 105B CB1=A2, A3, A4, A5, A6, A7 CB2=A2, A3, A4, A5, F4, F5, F6, F7 CB3=A2, A3, A4, A5, A6, A7, F4, F5, F6, F7 CB4=F2, F3, F4, F5, F6, F7 CB5=A2, A3, A4, A5, F6, F7 CB6=B18, B19, B20, B221, B22, B23 CB7=A2, A3, A4, A5, A6, A7, B22, B23 CB8=F6, F7 CB9=108, 115 CBA=132, 133

DORM BUNDLES

DB1=A1, A2, C1, C2 DB2=A1, A2


CONSTRUCT DOCUMENTS

MED









Not compliant design

Compliant design required

H.05 WC/Lav Comby

Redesign

Significant impacts to adjacent space

Housing NA Cell NA NA x 108 108 108 108 108 CB9 108 CB9 108 108 108 108 108 A Water closet

DLR Group Barrier Matrix

LEGEND NOTES

LEGEND NOTES ARE COMMON TO ALL SOME NOTES MAY NOT APPLY TO THIS SHEET

ISSUE TYPE

A ACCESSIBILITY LITIGATION ISSUE CLIENT REQUESTED ISSUE L-R LIGATURE ISSUE RELATED TO AN ACCESSIBILITY ISSUE L-U LIGATURE ISSUE UNRELATED TO AN ACCESSIBILITY ISSUE OTHER ISSUE S SECURITY ISSUE


CELL BUNDLES

CB0=104, 105B CB1=A2, A3, A4, A5, A6, A7 CB2=A2, A3, A4, A5, F4, F5, F6, F7 CB3=A2, A3, A4, A5, A6, A7, F4, F5, F6, F7 CB4=F2, F3, F4, F5, F6, F7 CB5=A2, A3, A4, A5, F6, F7 CB6=B18, B19, B20, B221, B22, B23 CB7=A2, A3, A4, A5, A6, A7, B22, B23 CB9=108, 115 CBA=132, 133 CBB=134, 139

DORM BUNDLES


DB1=A1, A2, C1, C2 DB2=A1, A2 DB3=F1, F2

CONSTRUCT DOCUMENTS



ILLUSTRATE THE OVERARCHING WORK SCOPE WITHIN THE SPACES

Gro




MONITOR REVIEWED FOR ACCESS COMPLIANCE PER SETTLEMENT AGREEMENT DATE: 4/16/2018 HIBSER YAMAUCHI Architects, Inc


MASTER KEYNOTE DISCLAIMER


ARRIERS AND BARRIER CORRECTIVE ACTIONS THEREIN FOR A

Typical Existing Isolation Cell

Group

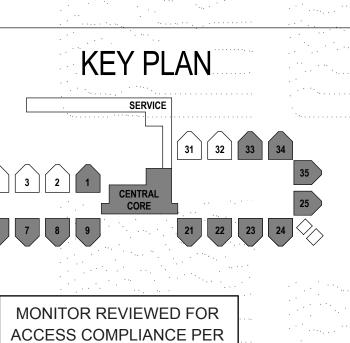



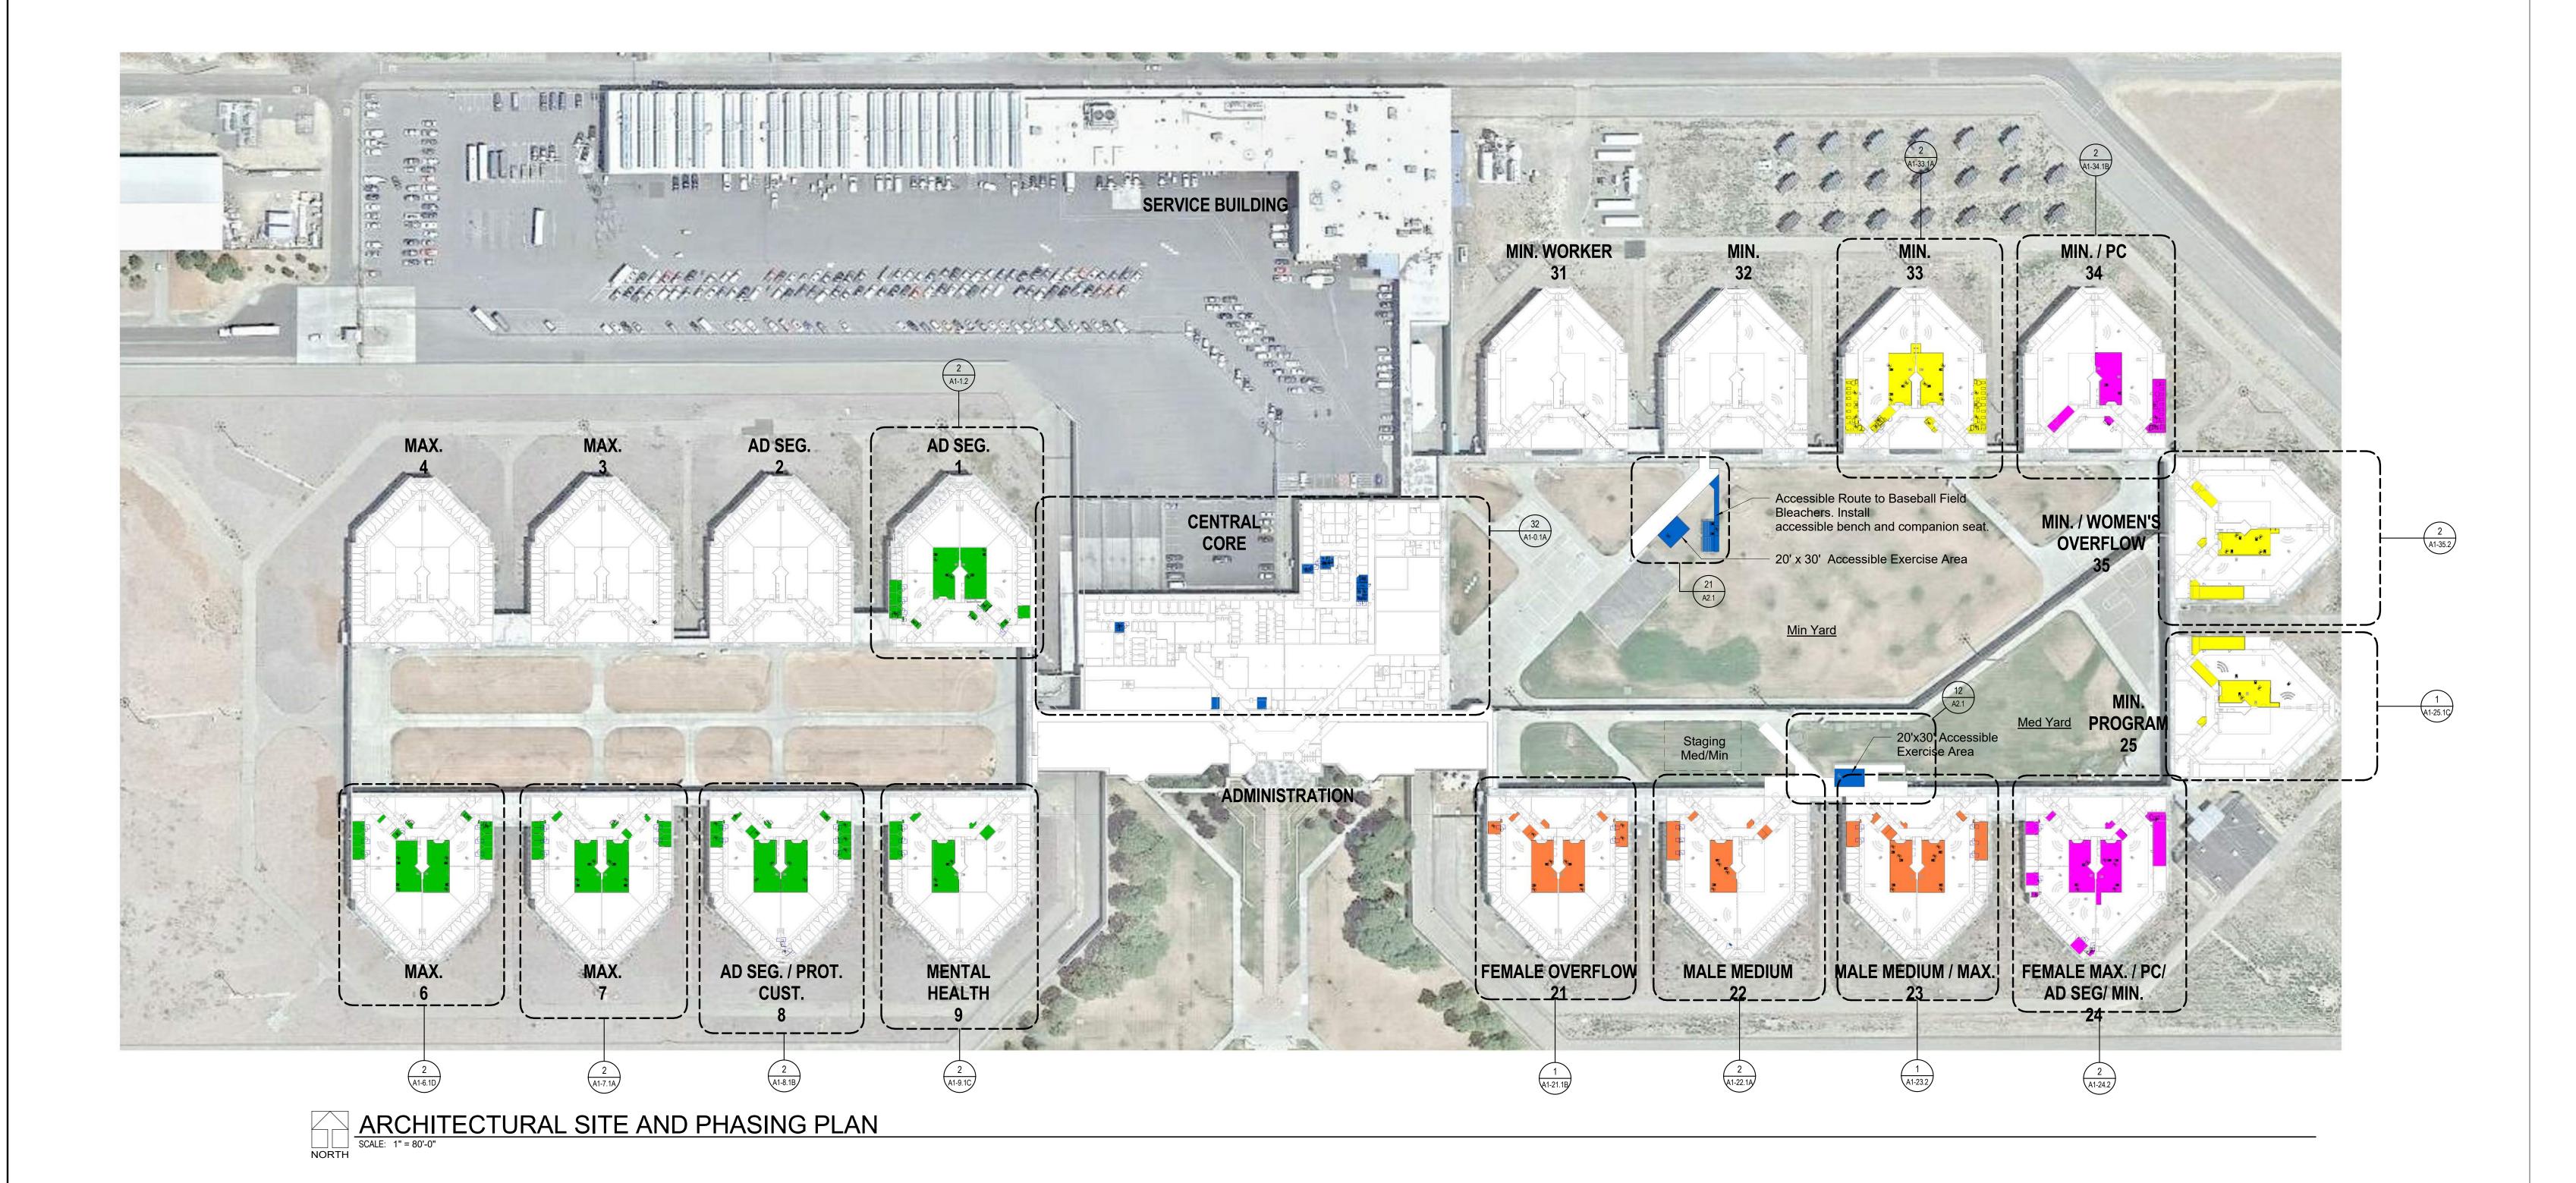

KEY PLAN

4 3 2 1

6 7 8 9


MONITOR REVIEWED FOR ACCESS COMPLIANCE PER

SETTLEMENT AGREEMENT DATE: 4/16/2018

HIBSER YAMAUCHI Architects, Inc.


31 32 33 34

21 22 23 24

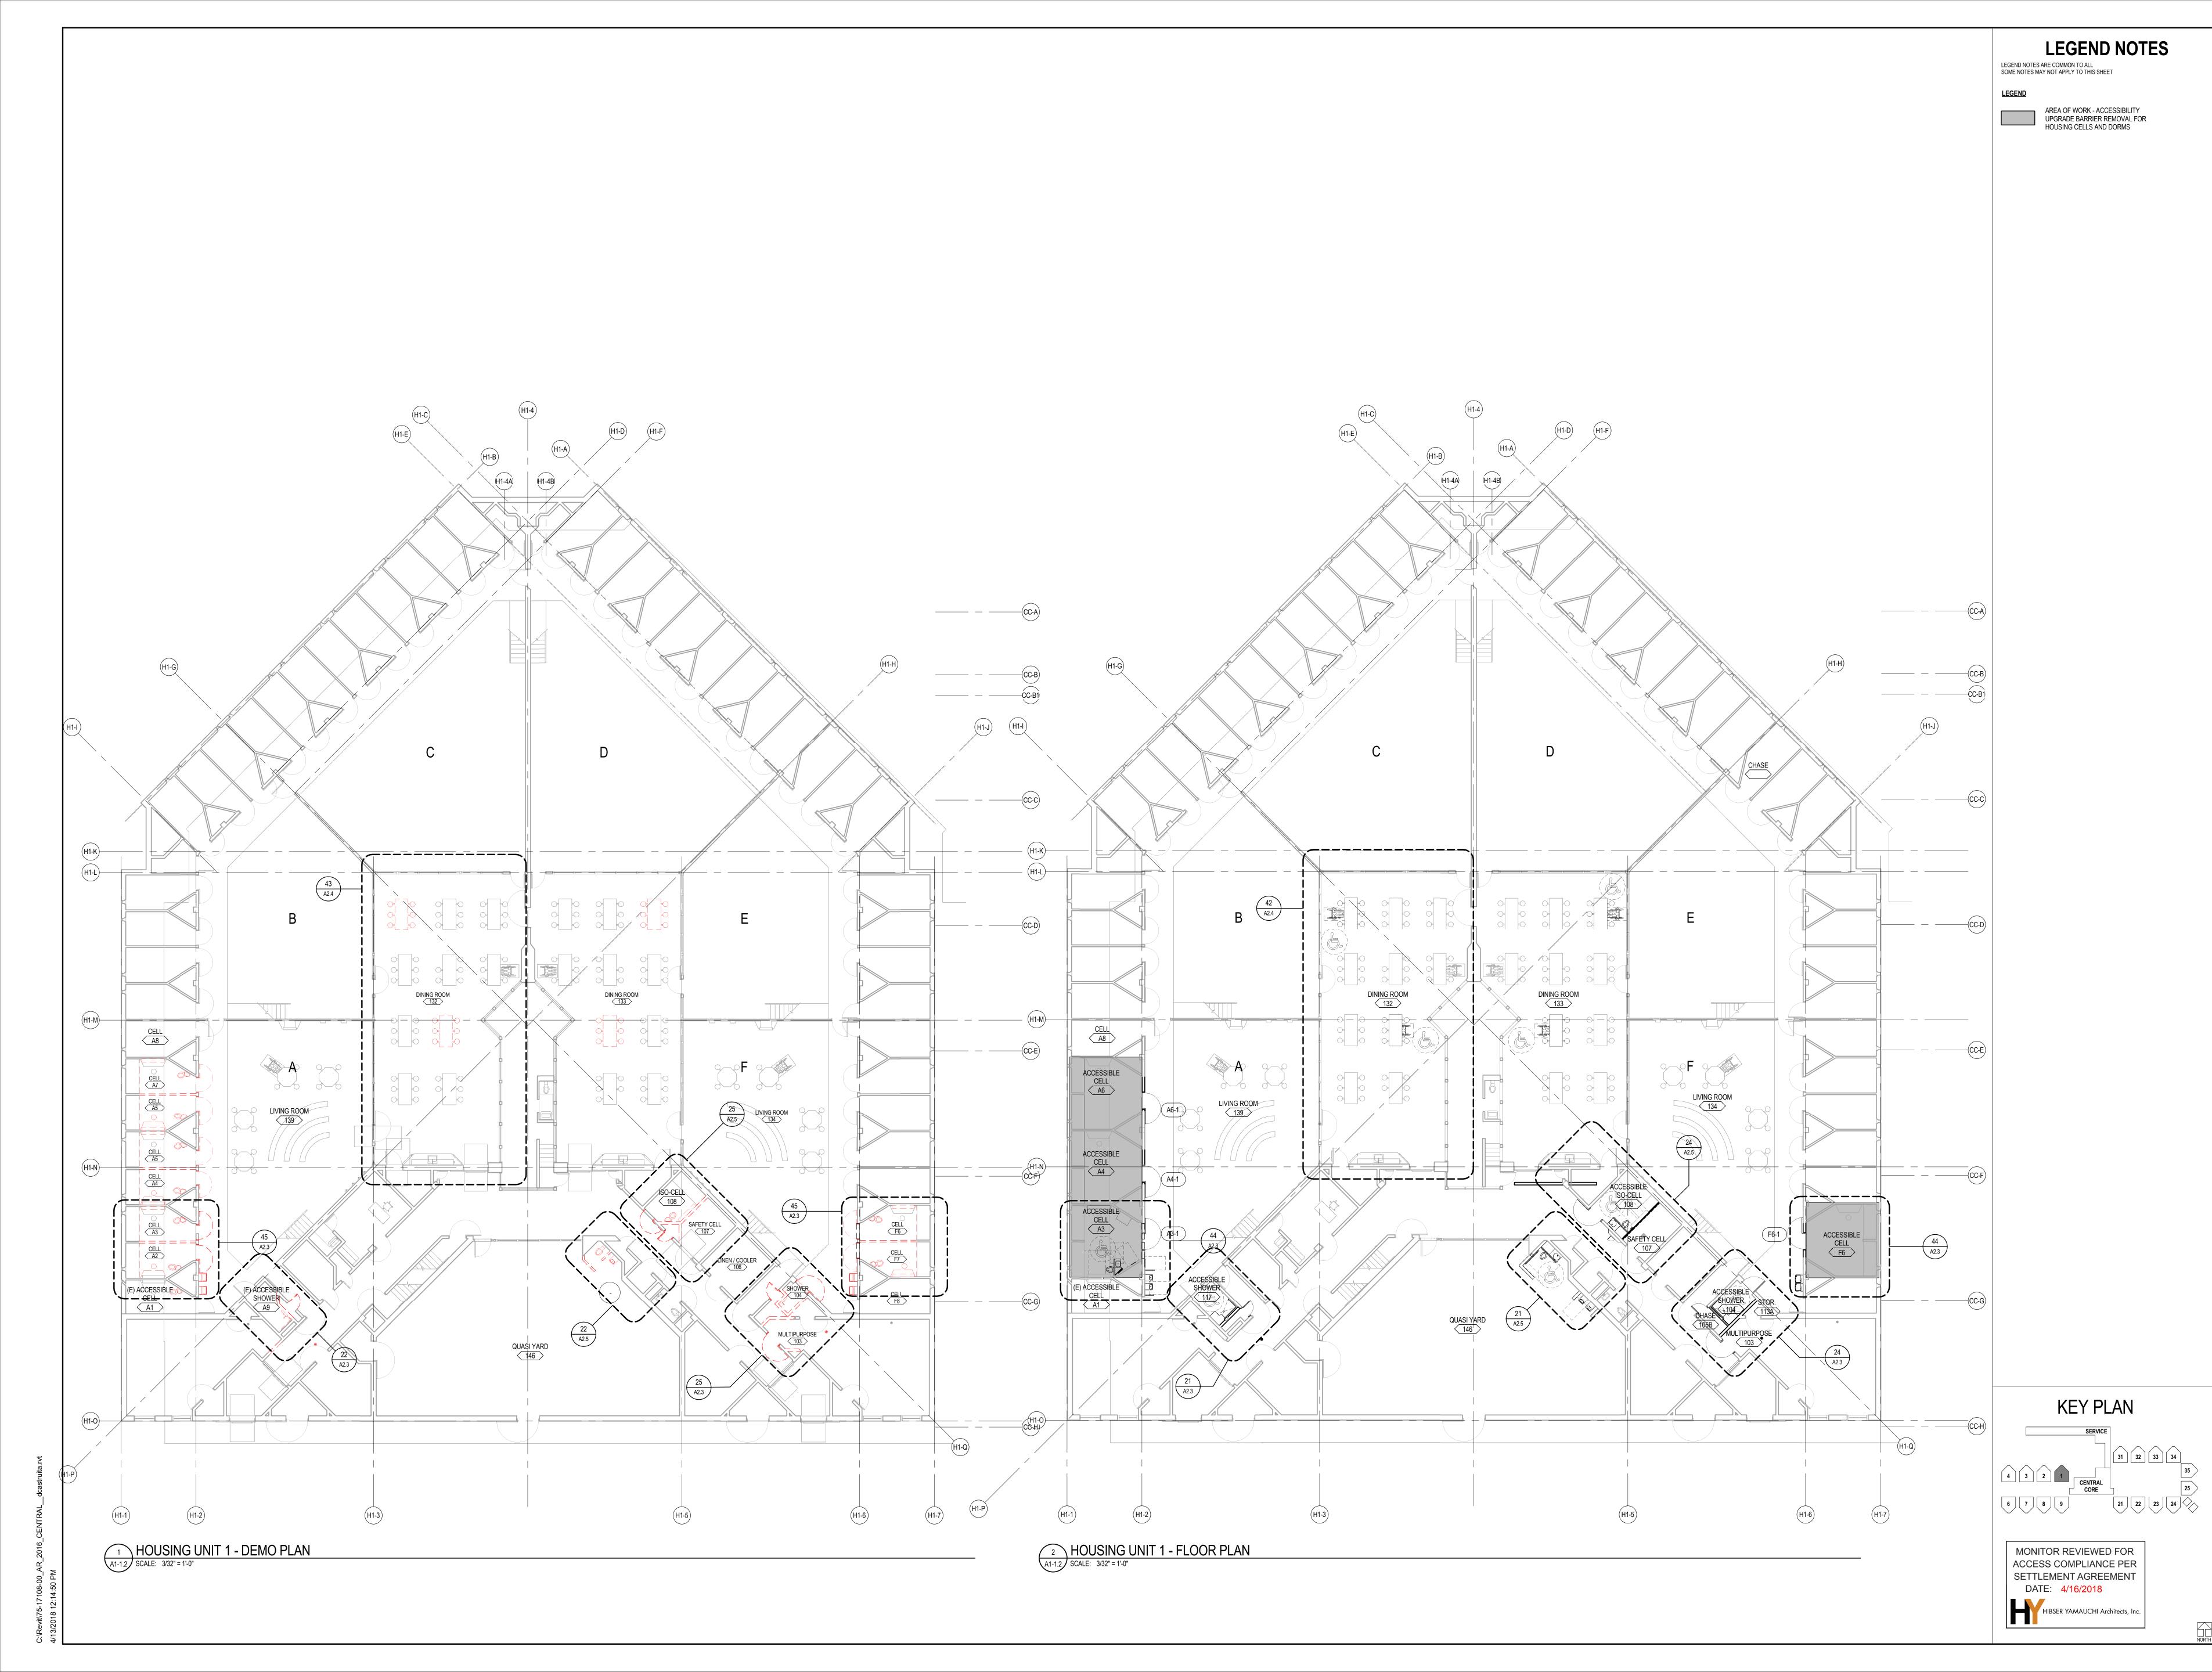





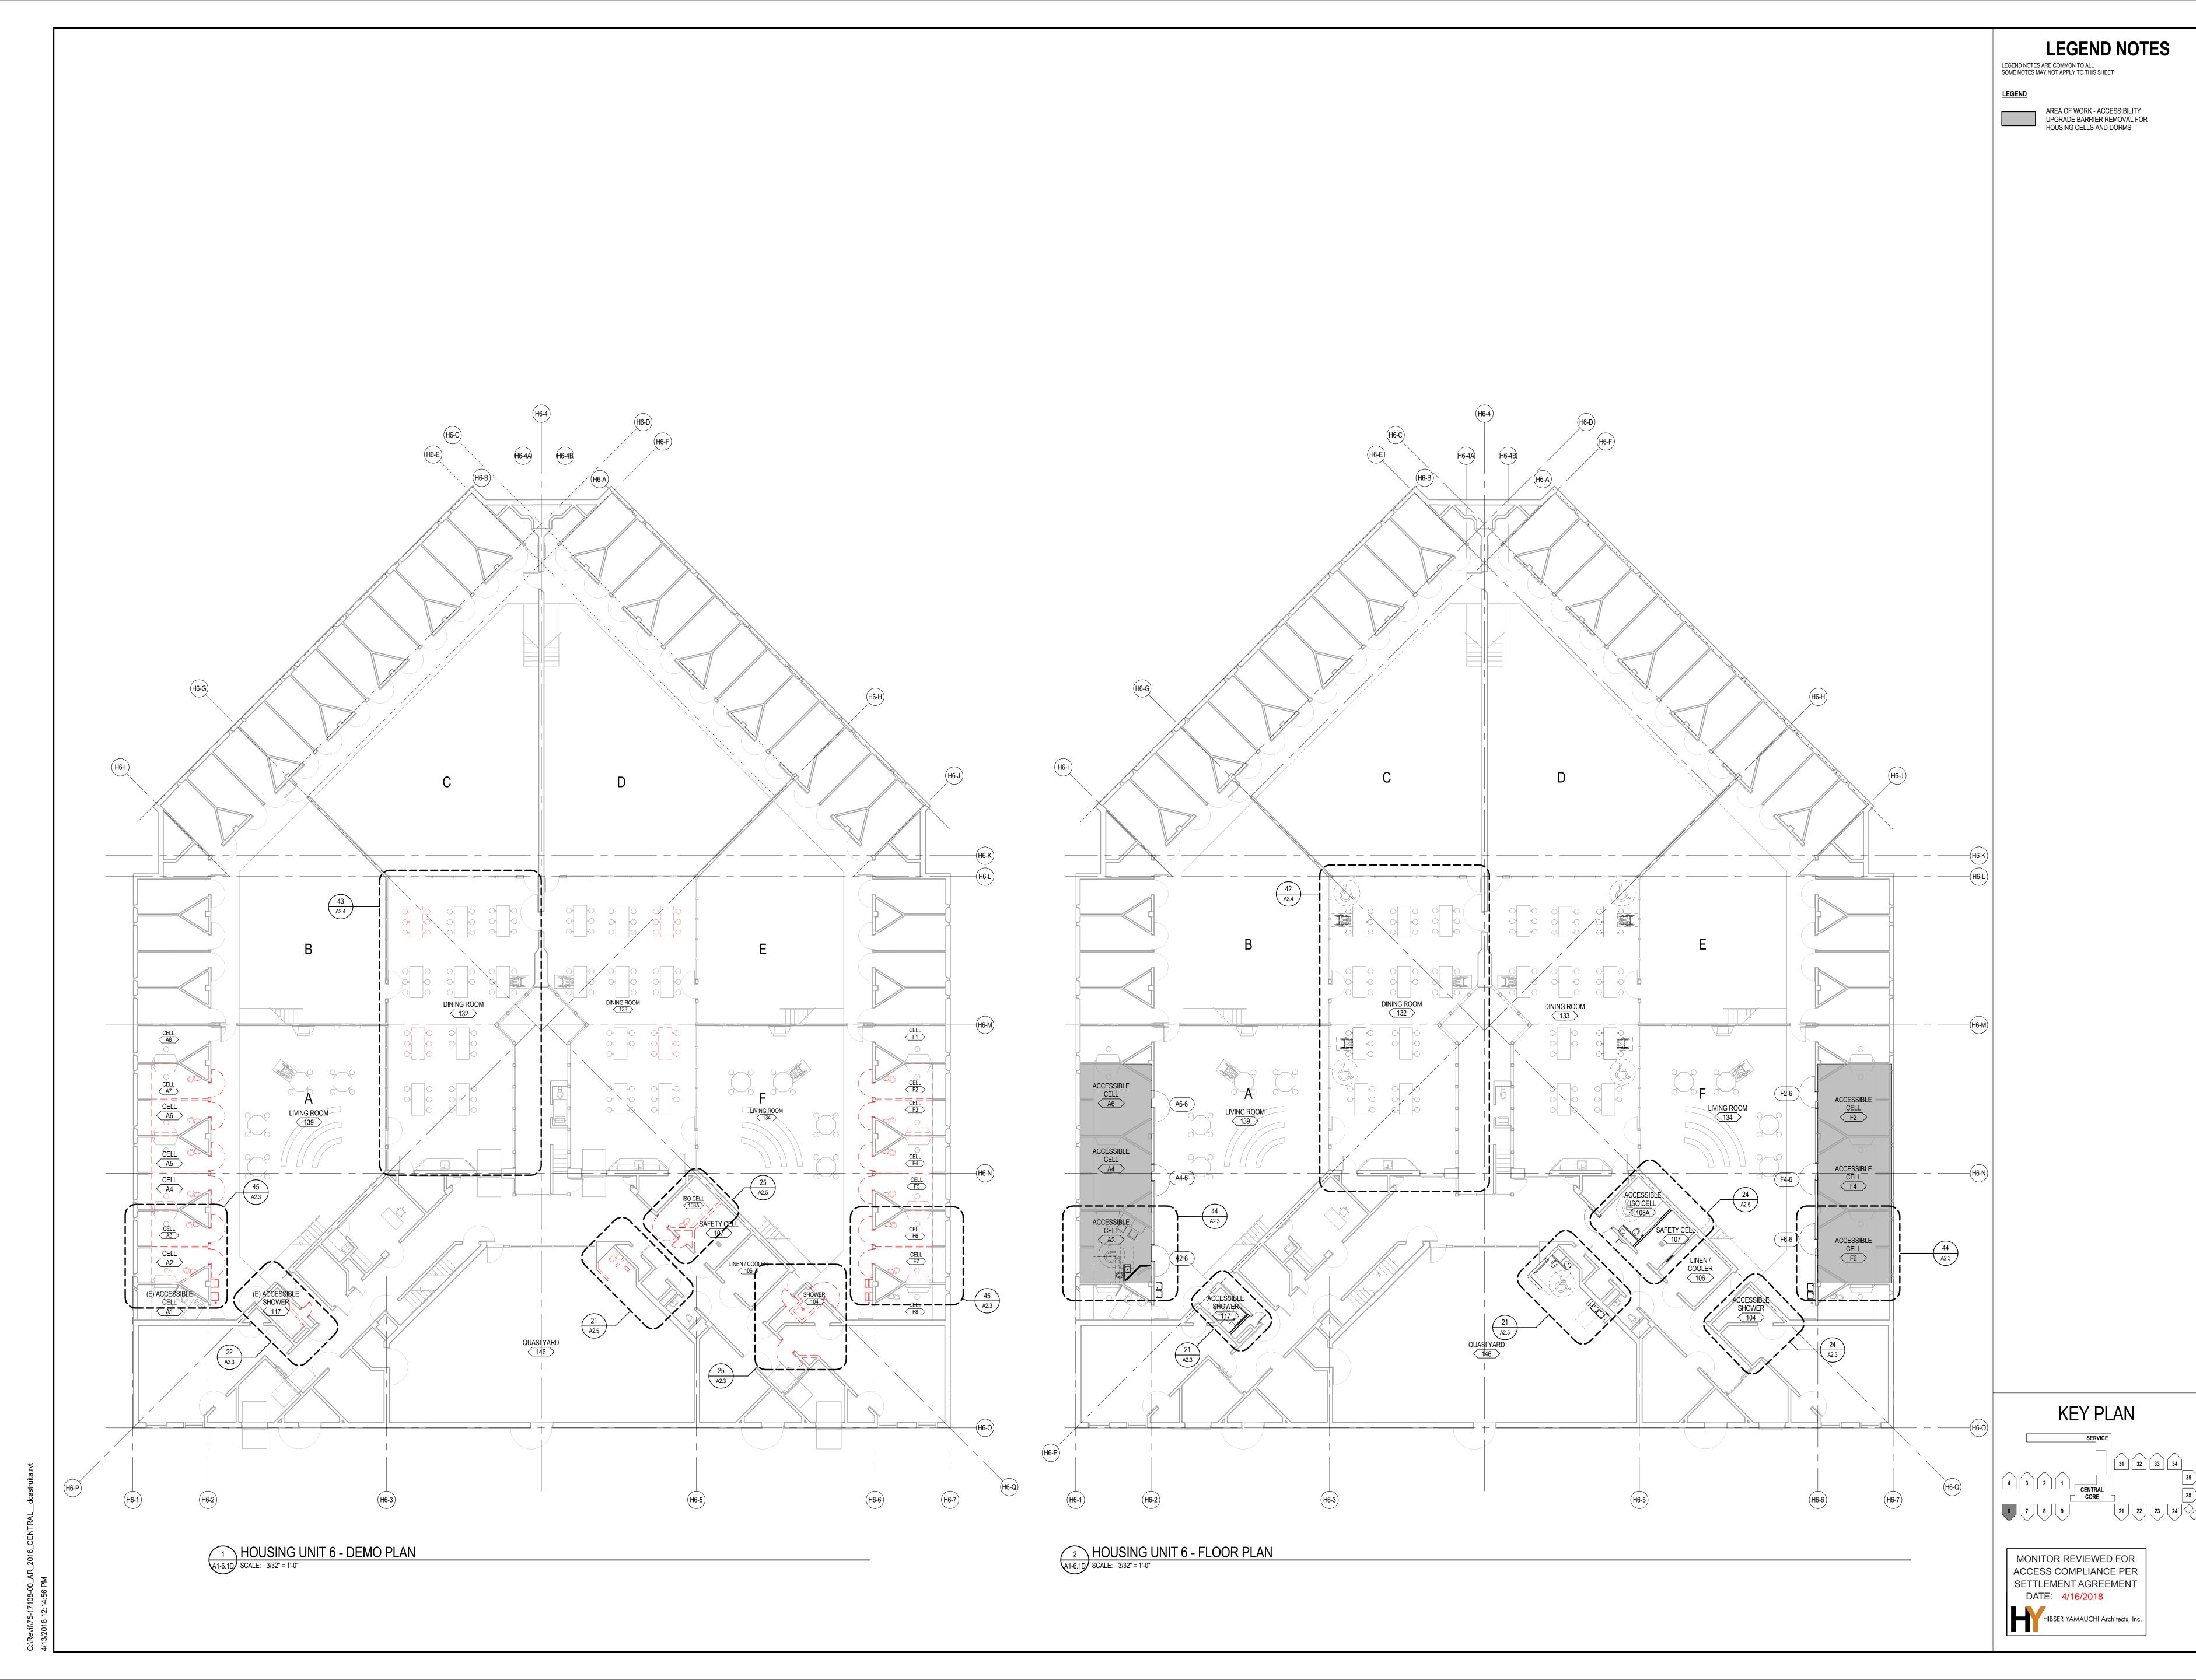

& FLOOR PLAN - HOUSING UNIT 6
DF ALAMEDA - SANTA RITA JAIL


A1-6.1D
75-17108-00
05-01-2018
Revisions






OUBLIN, CA 9











31 32 33 34










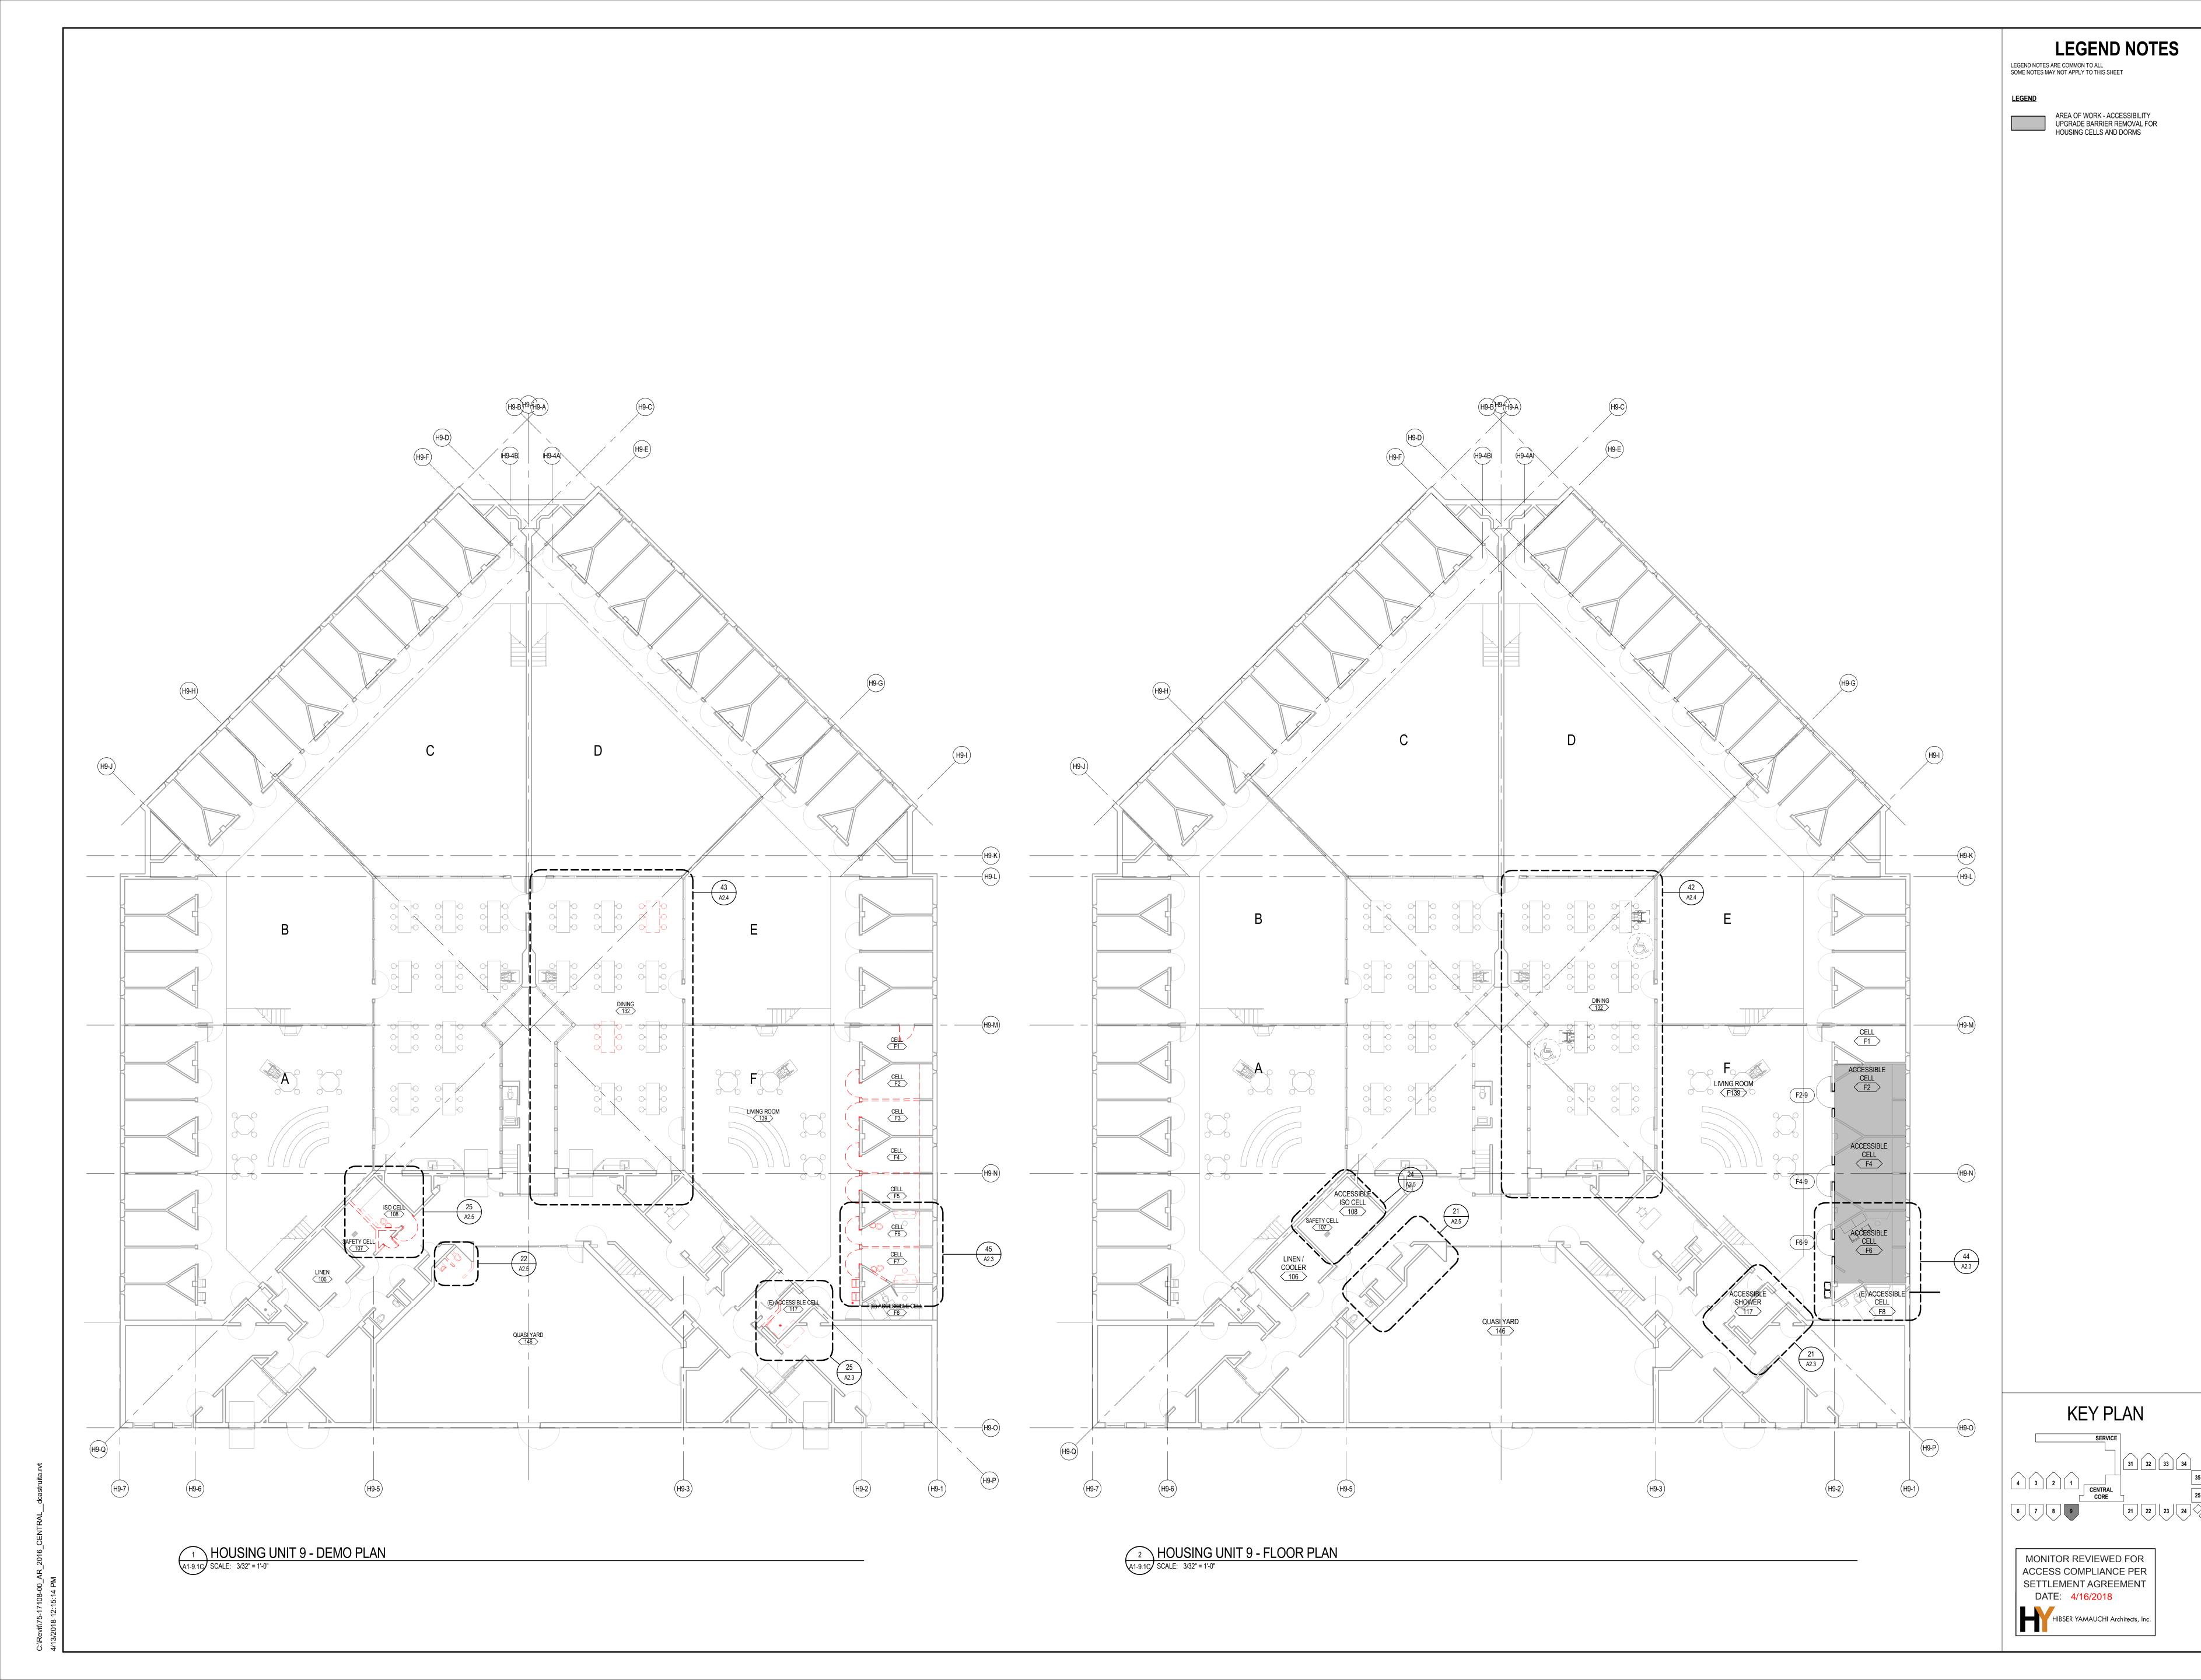









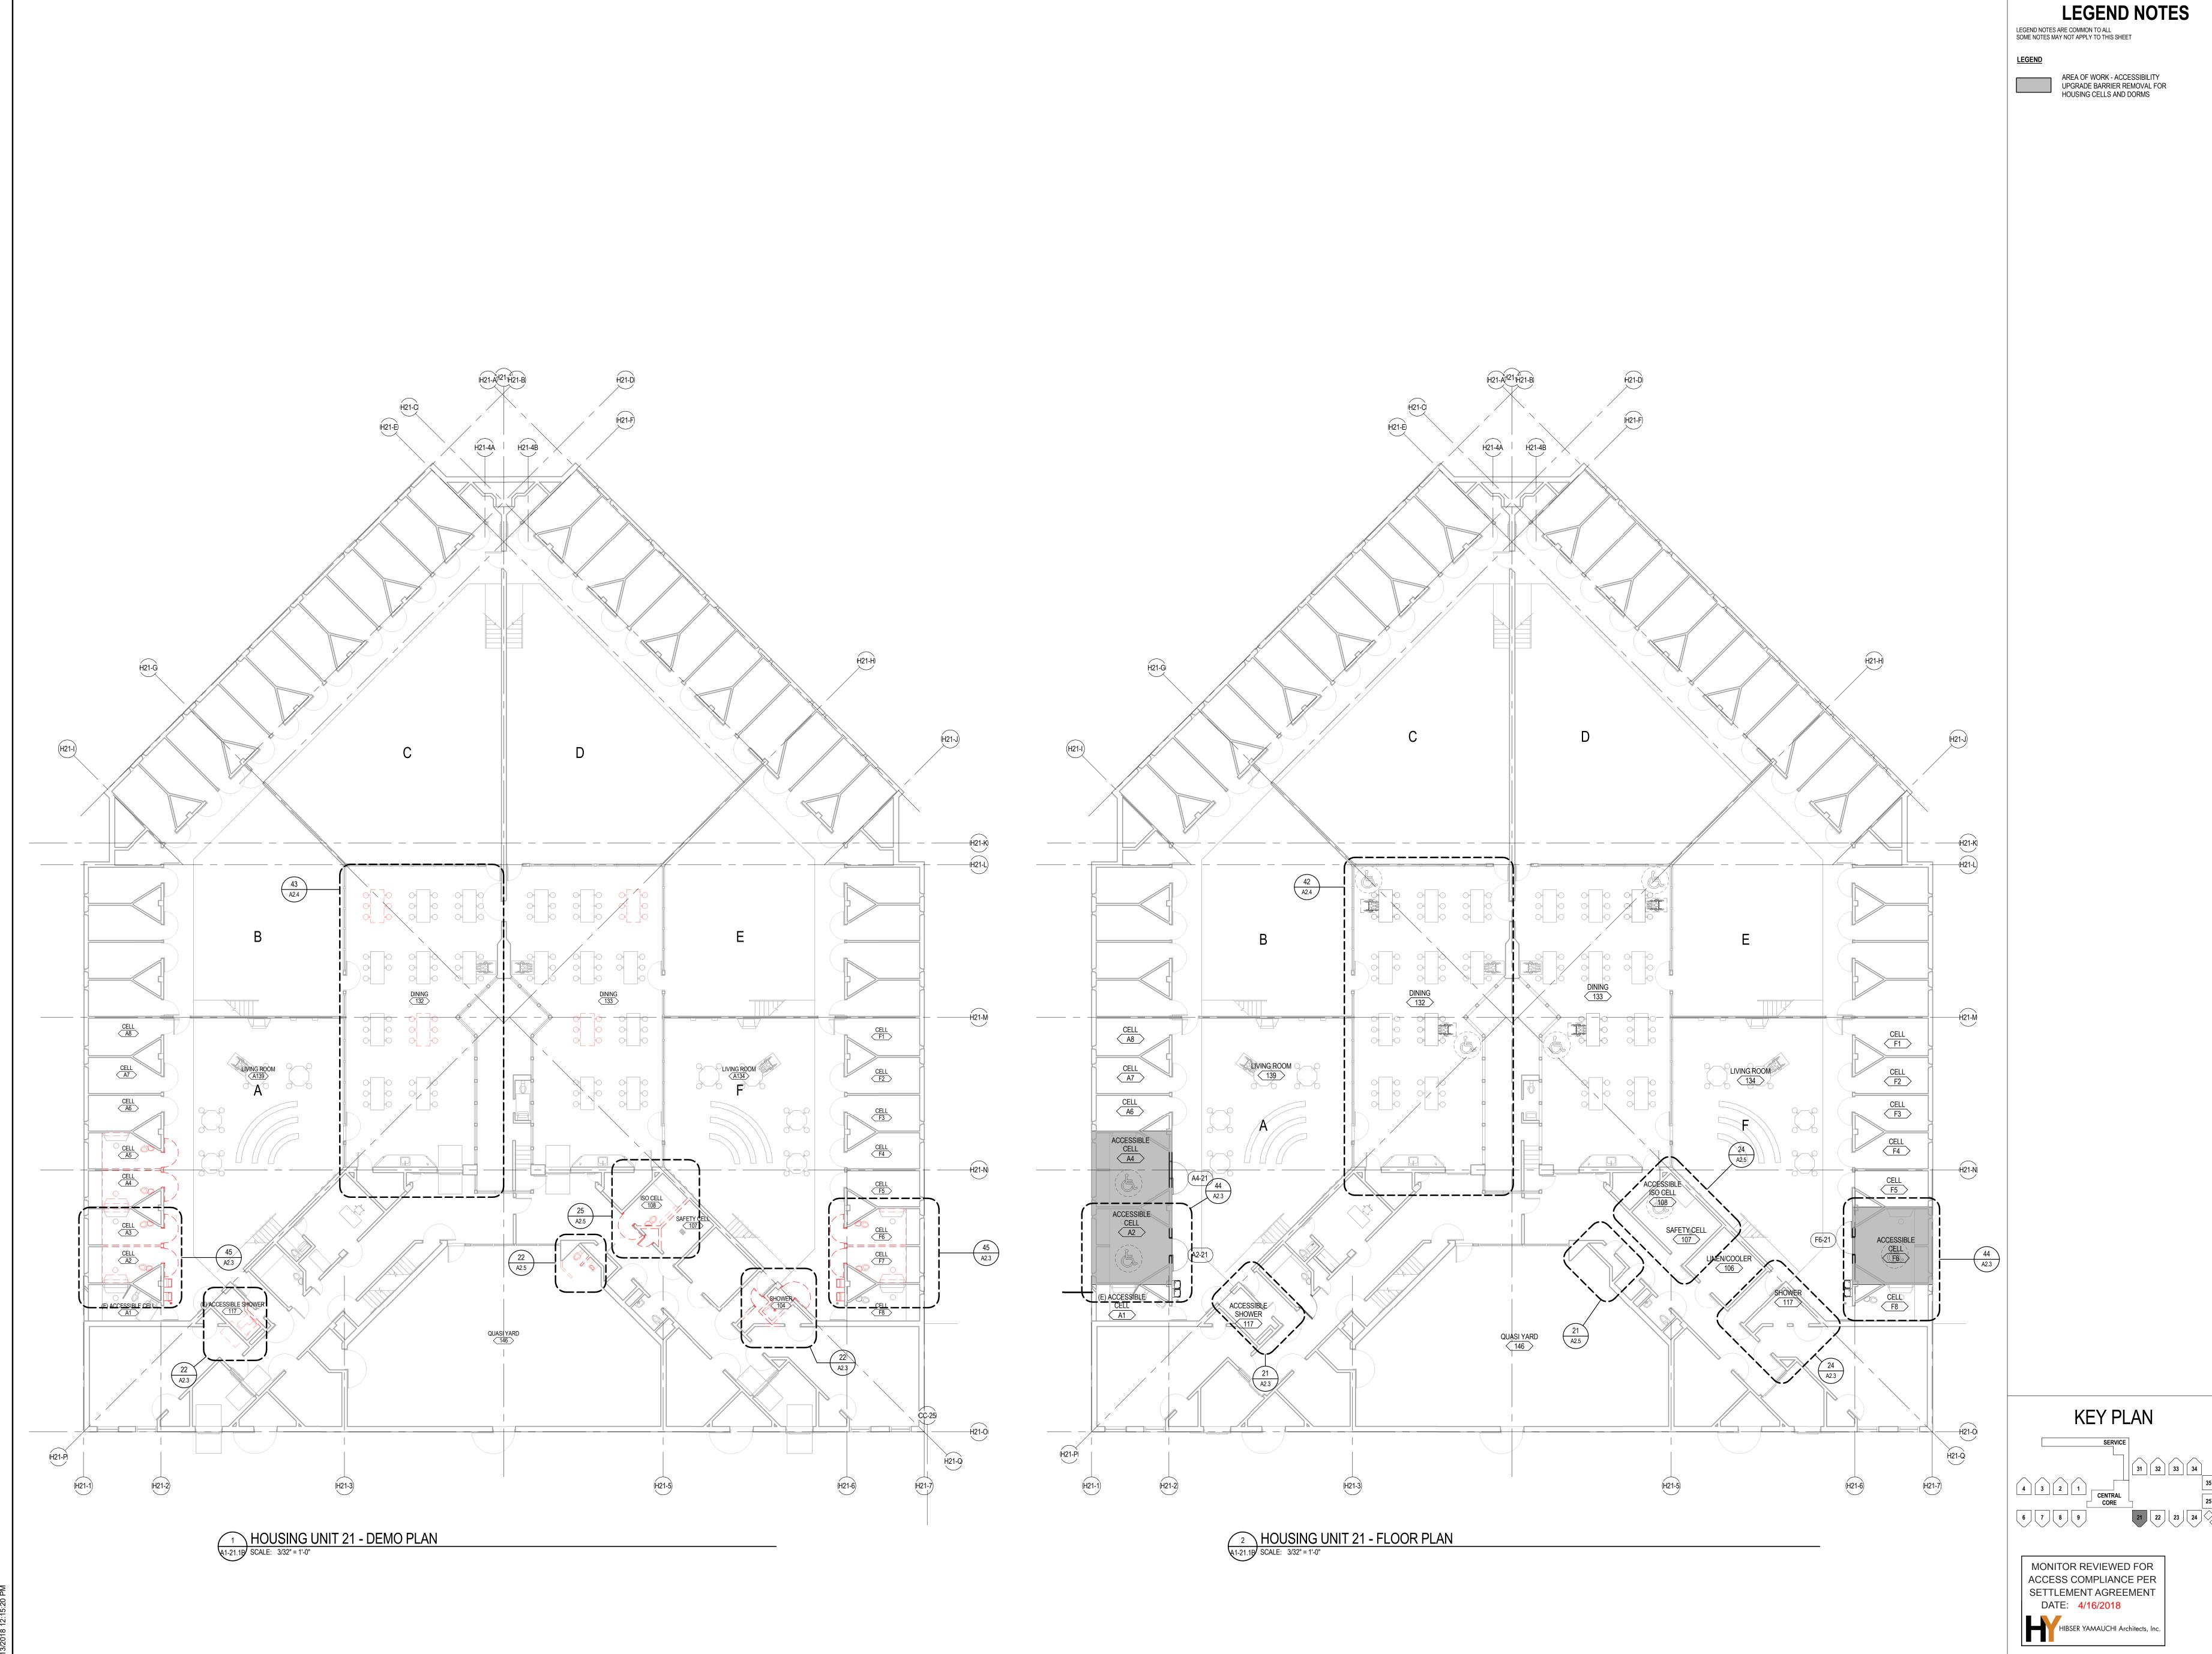

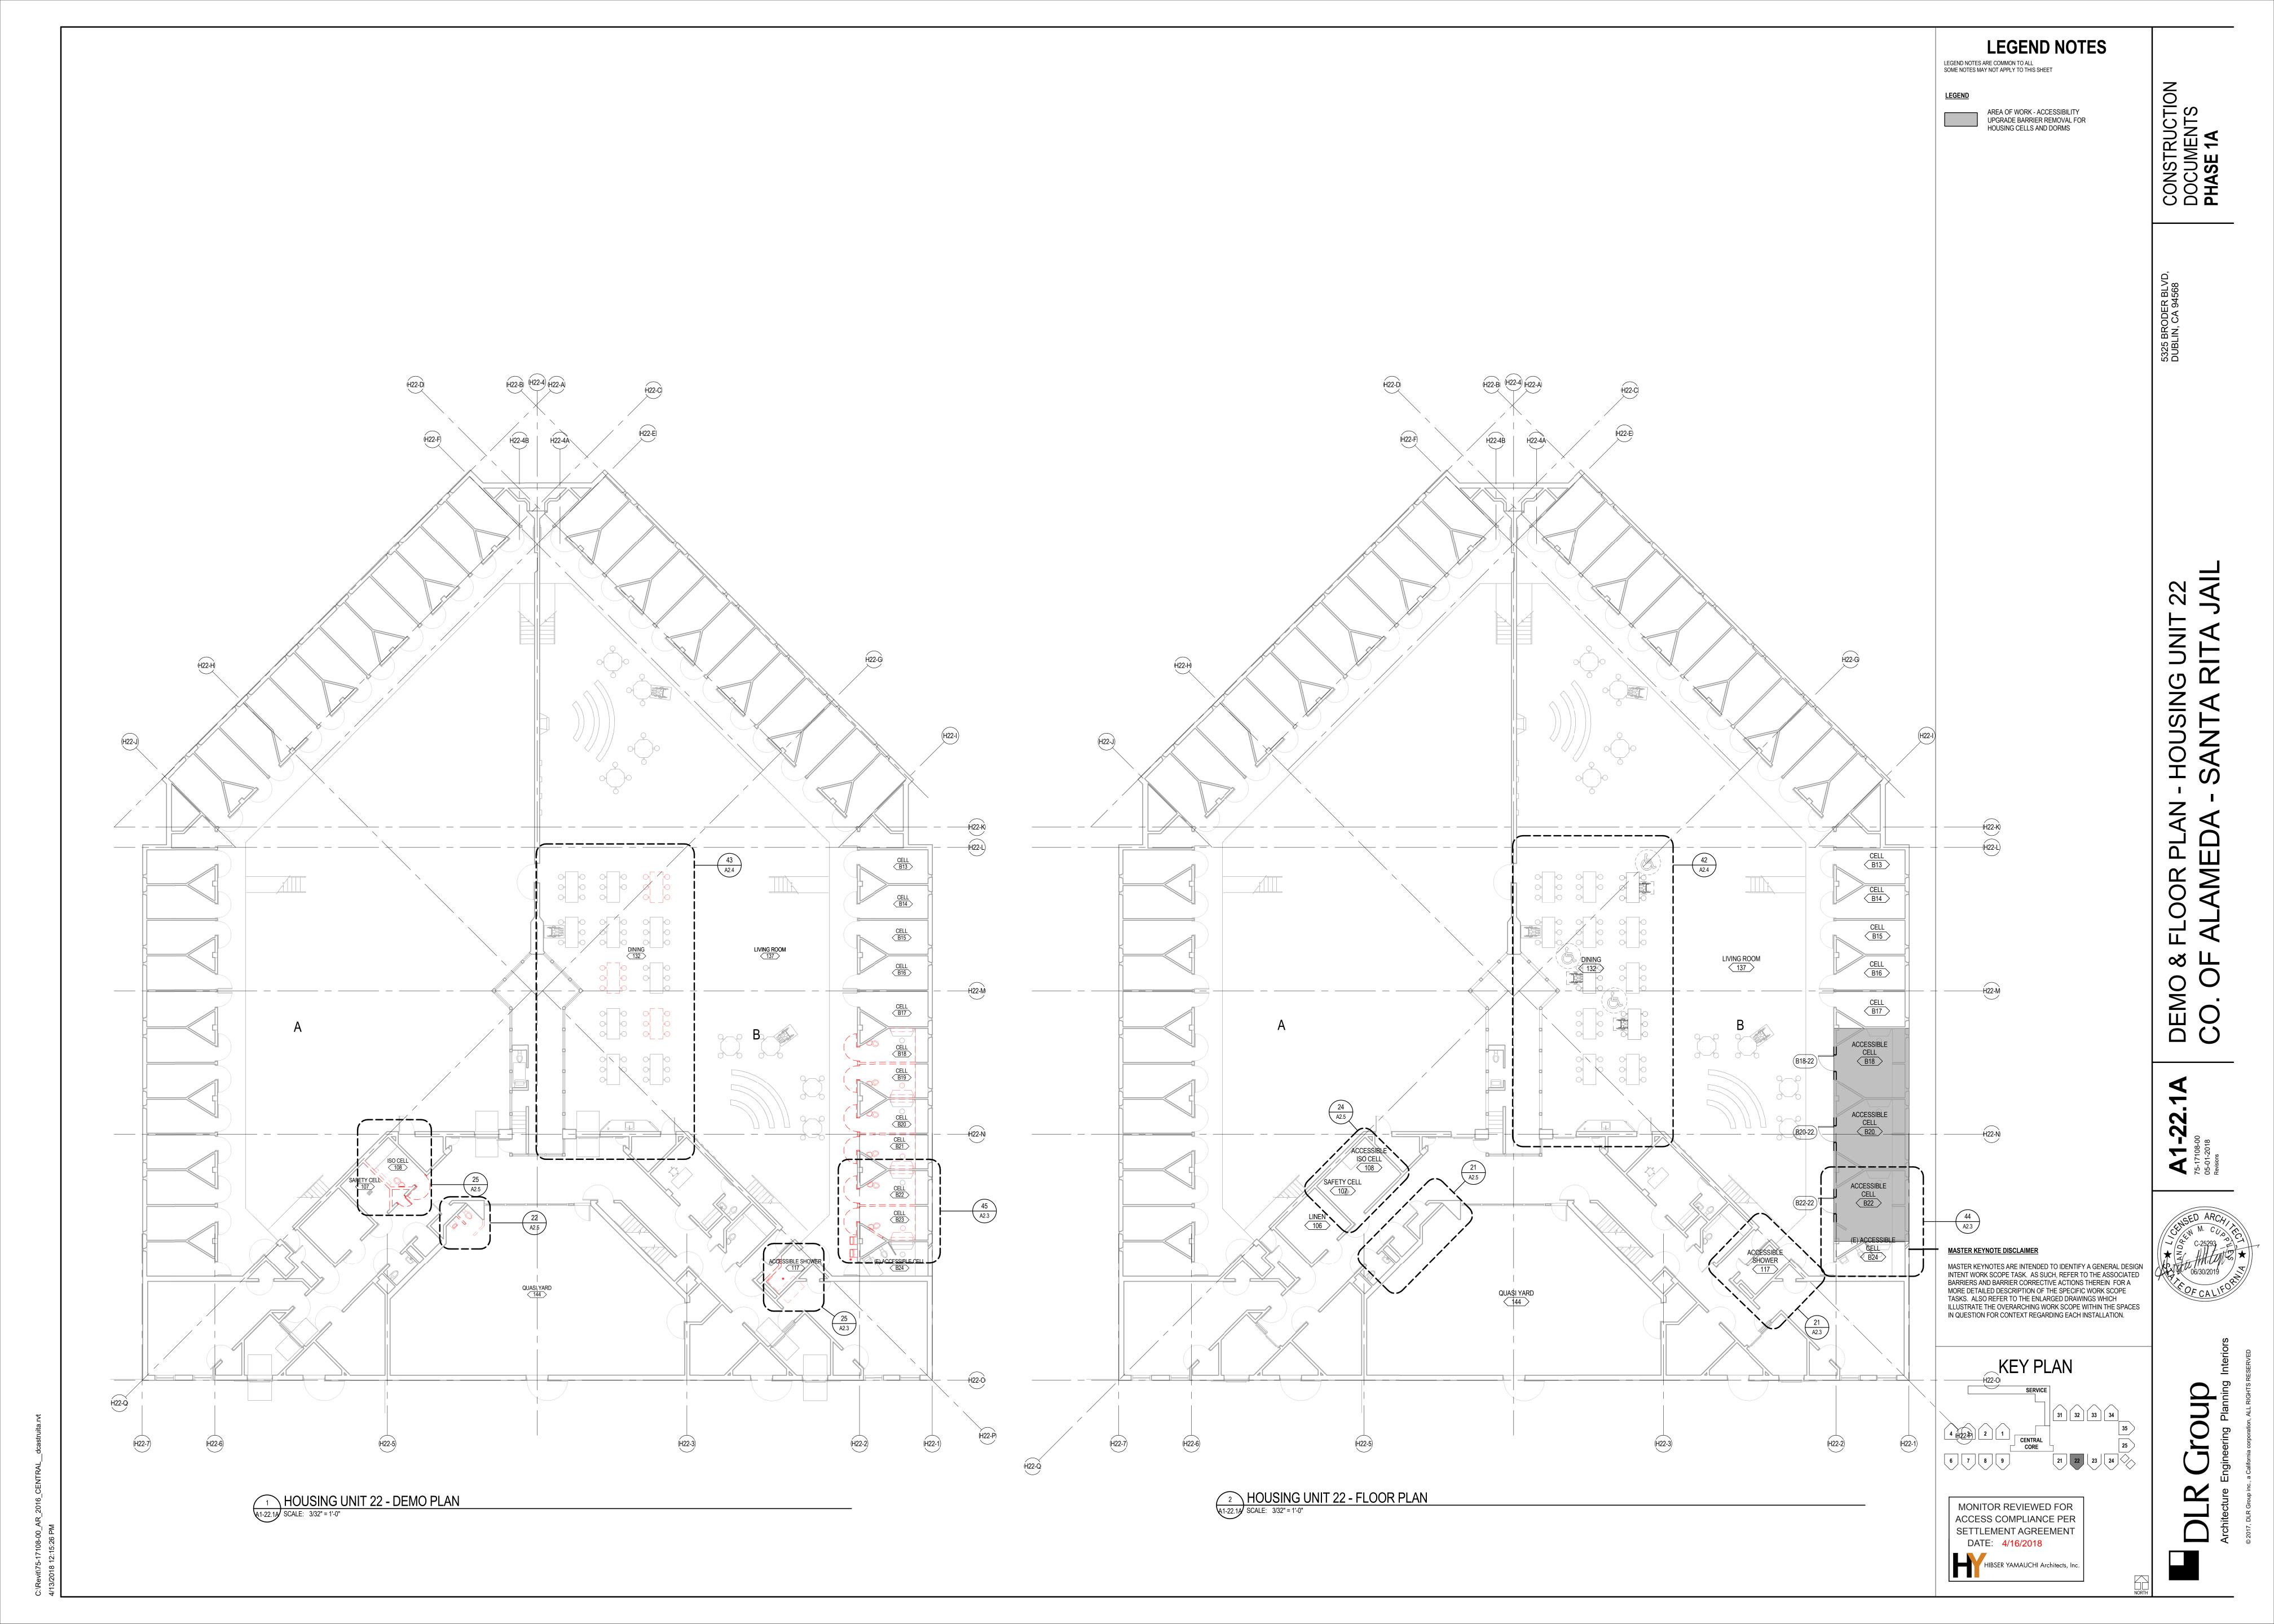

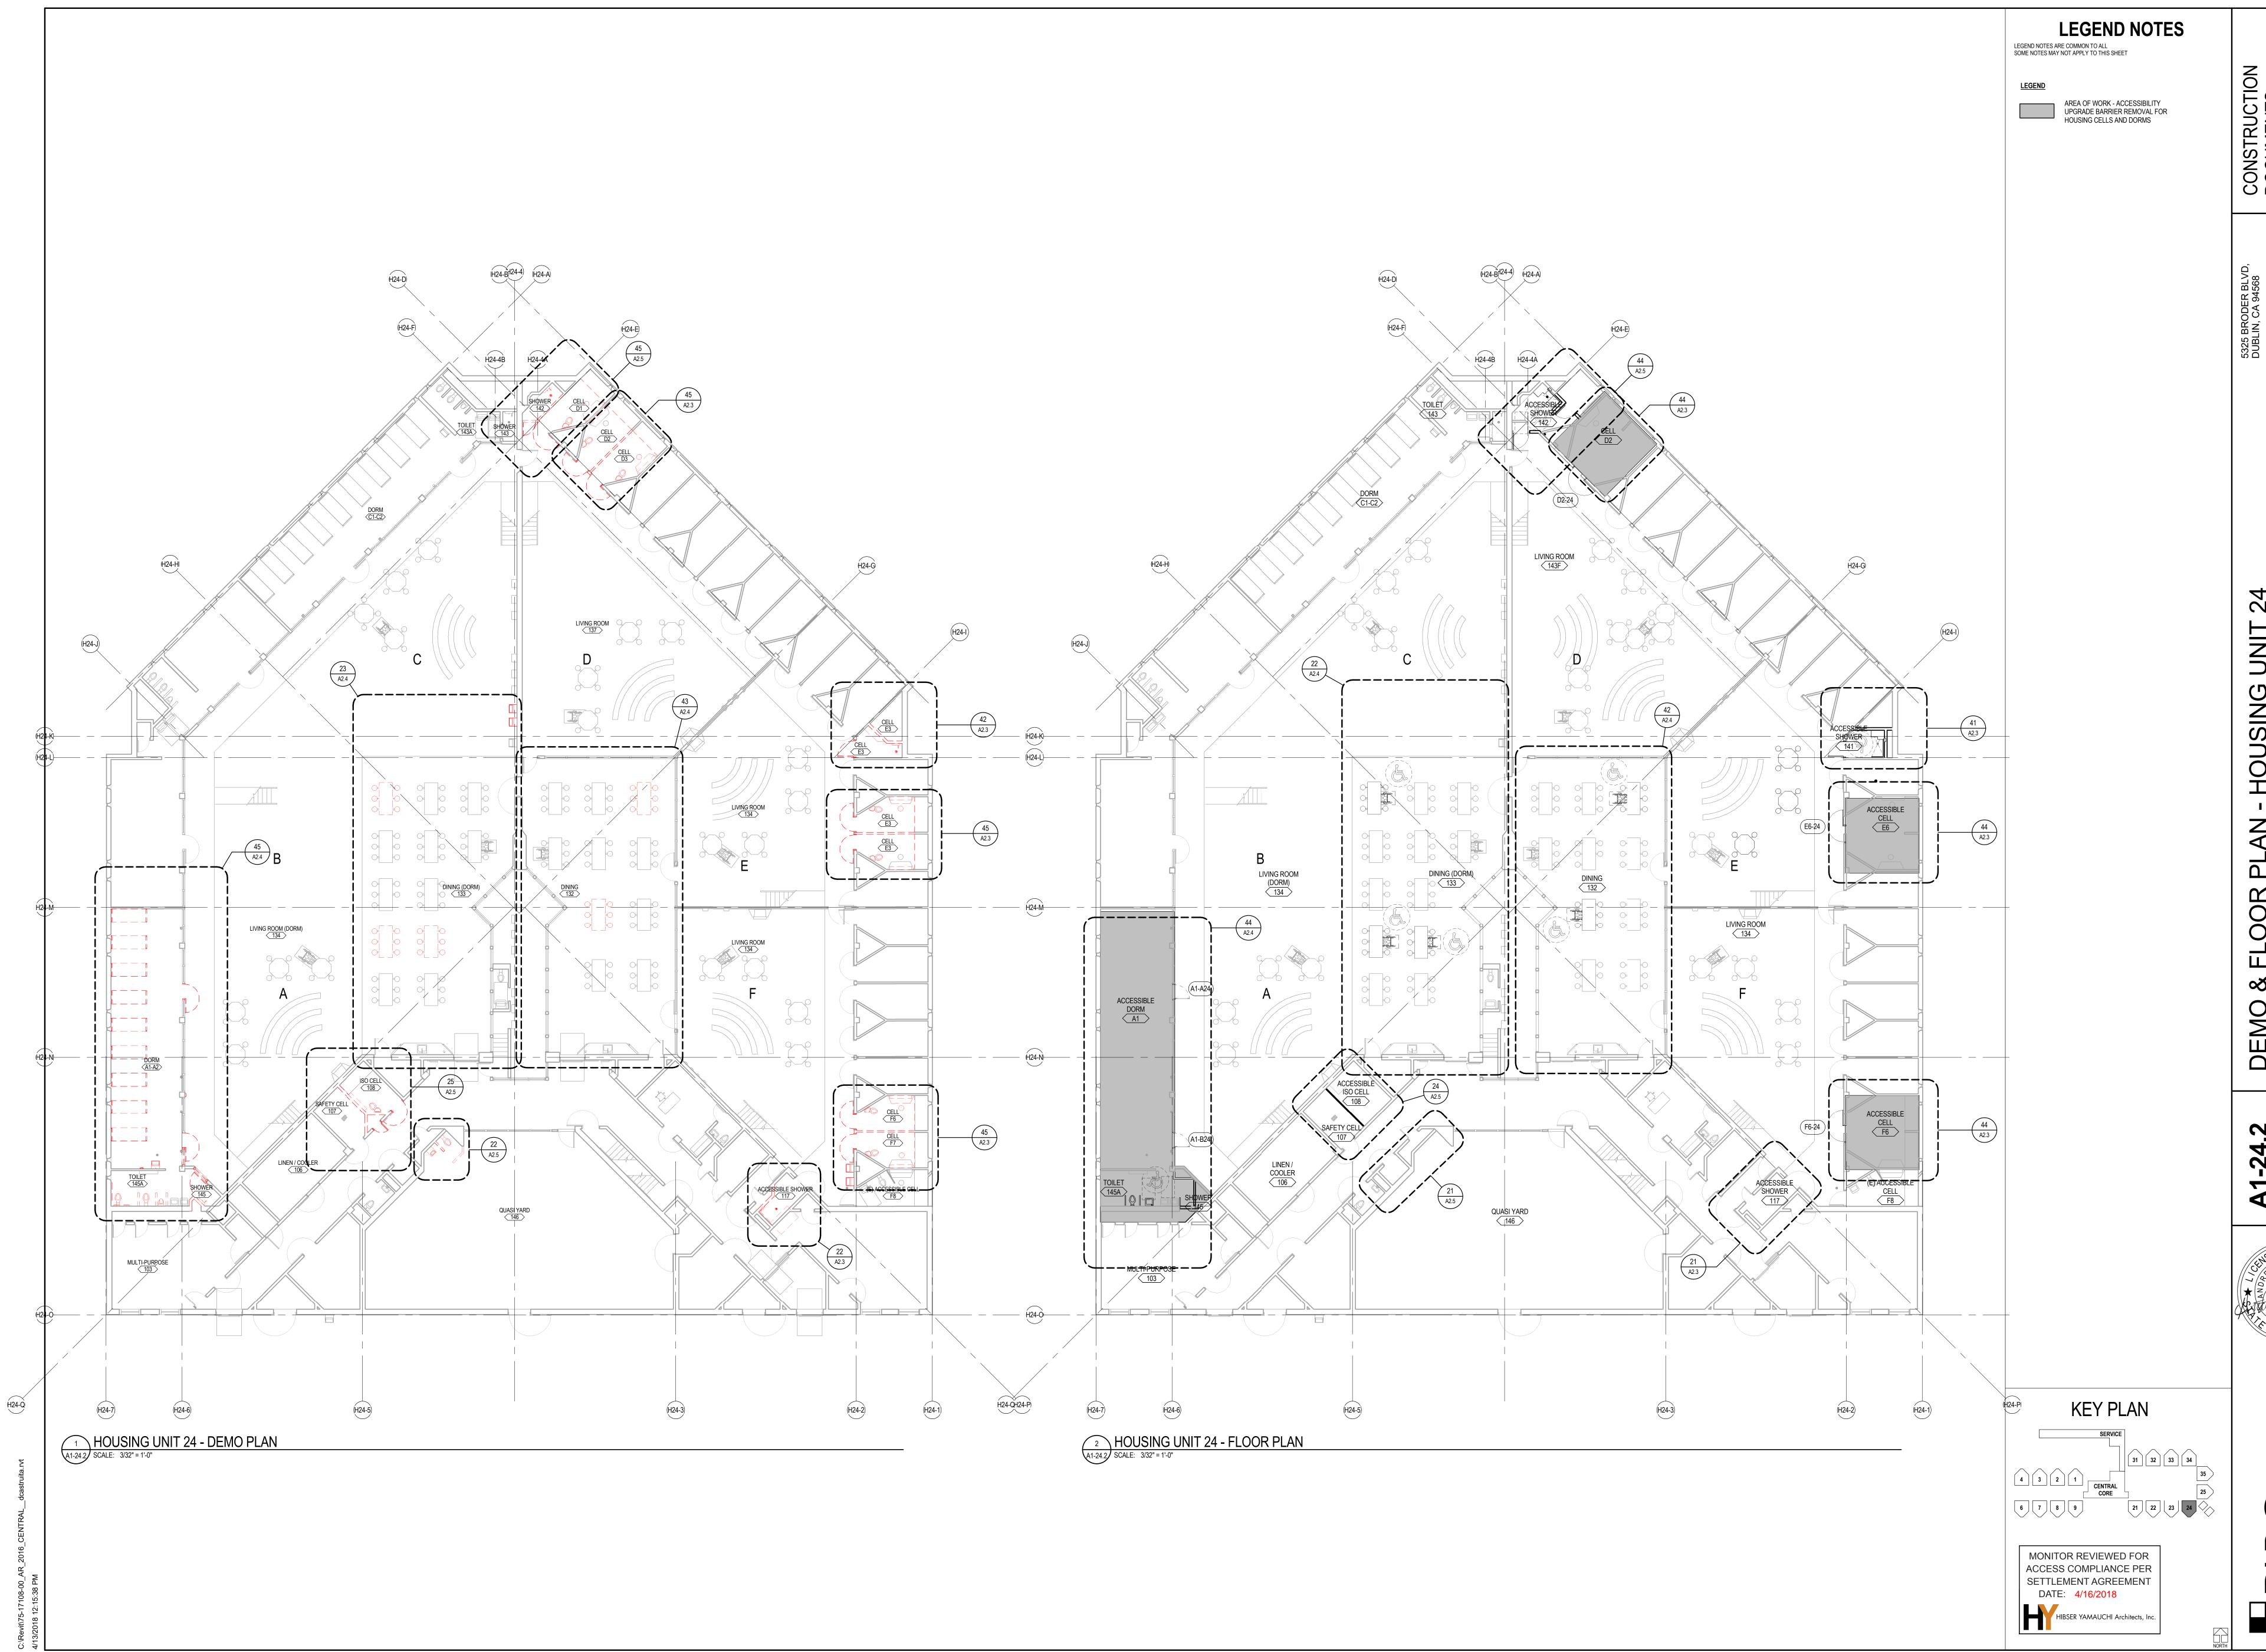


MO & FLOOR PLAN - HOUSING UNIT 24 . OF ALAMEDA - SANTA RITA JAIL


A1-24.2 75-17108-00 05-01-2018 Revisions


C-725533 * C-72080 * C-72050 * C-72050


DLR Granting Planning Interiors

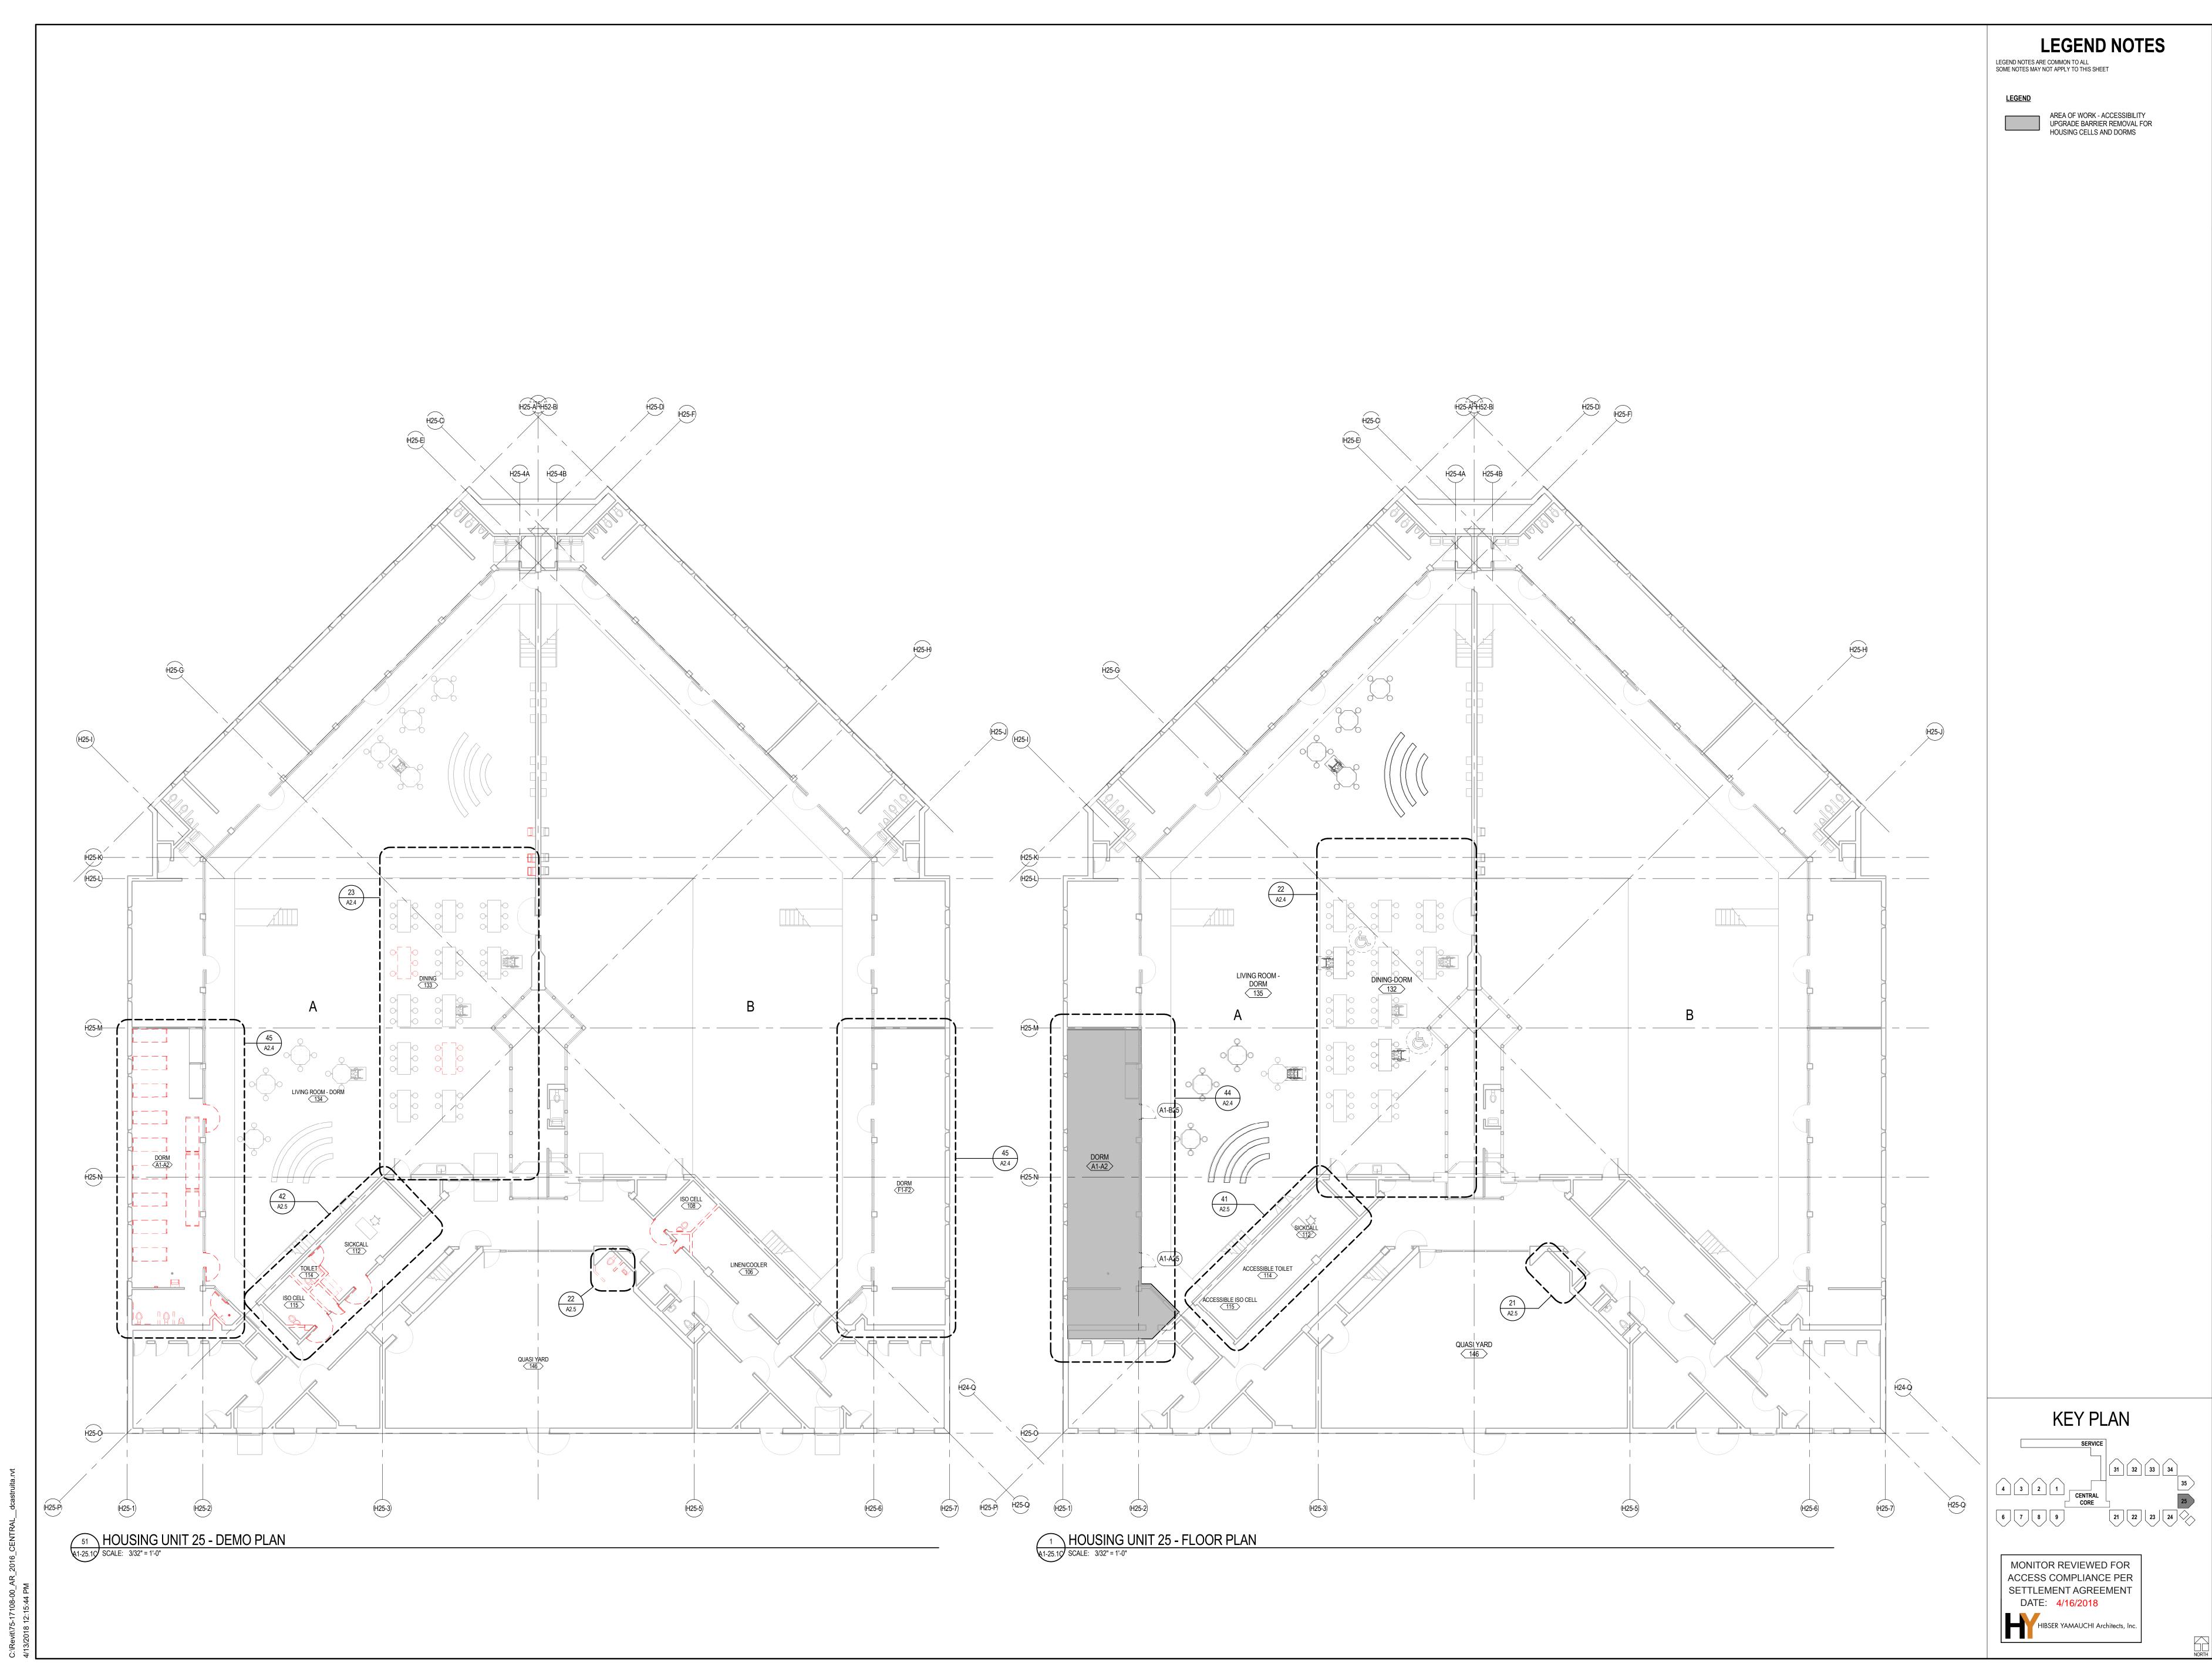




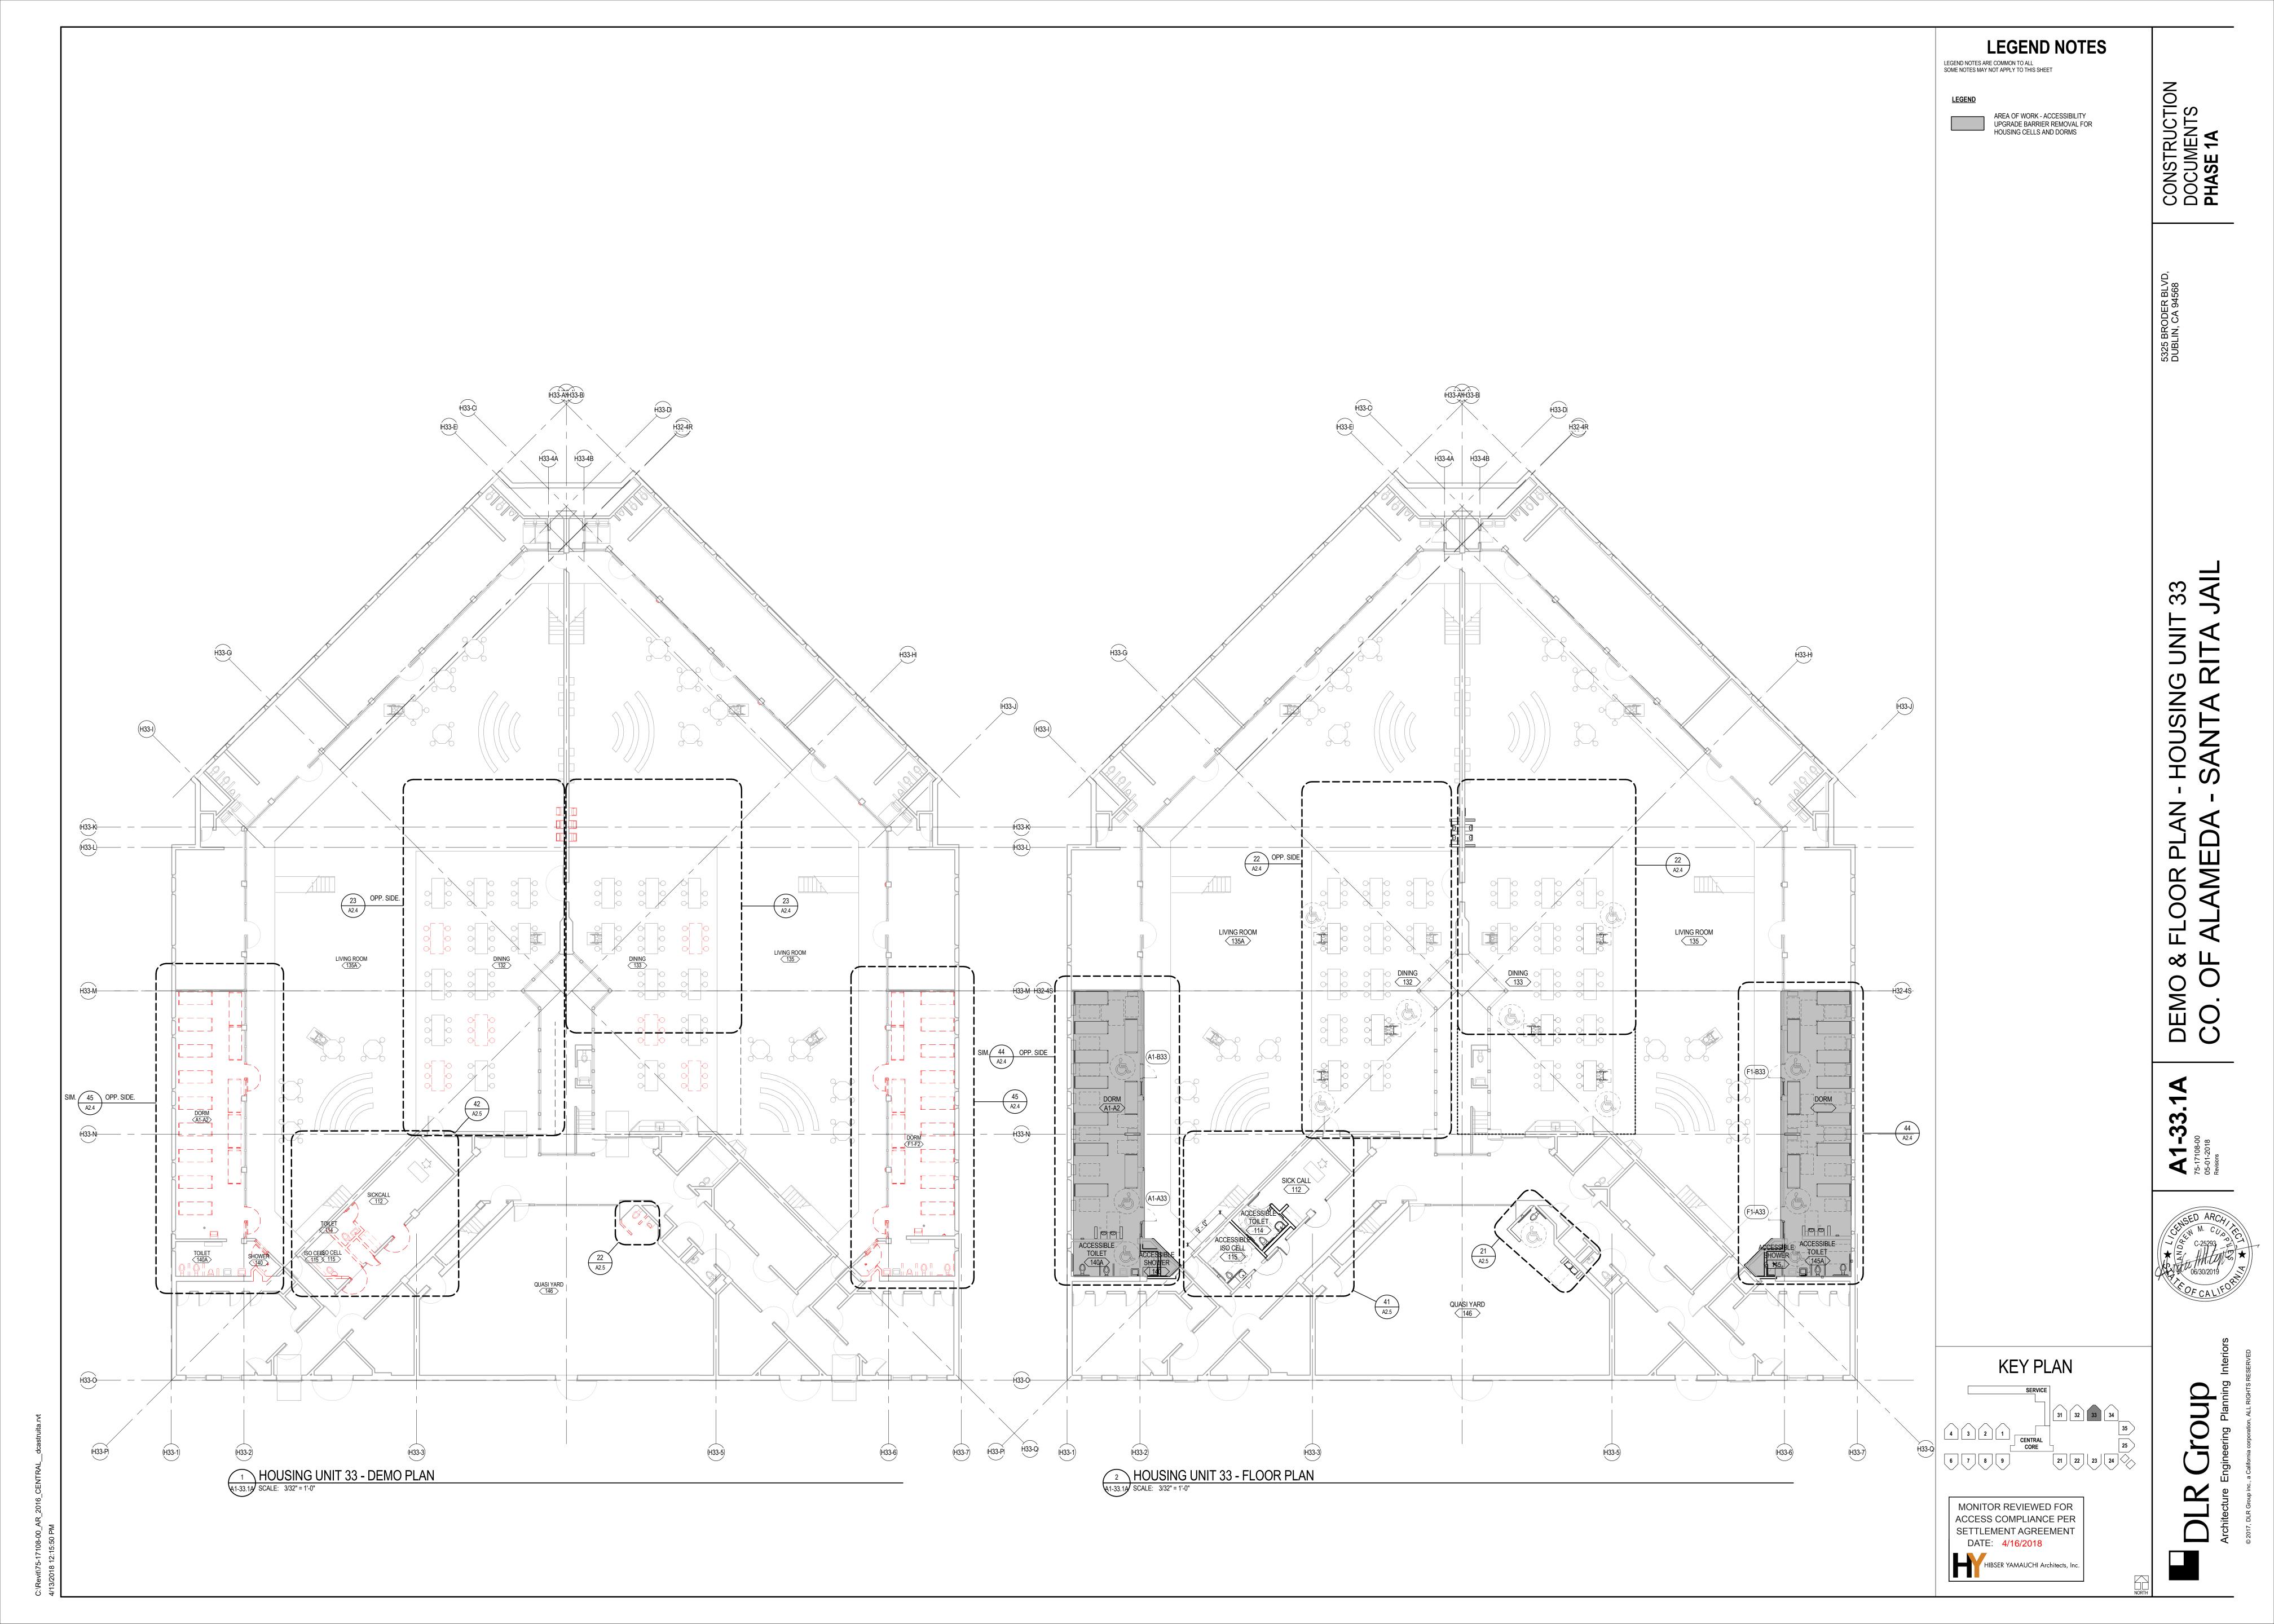


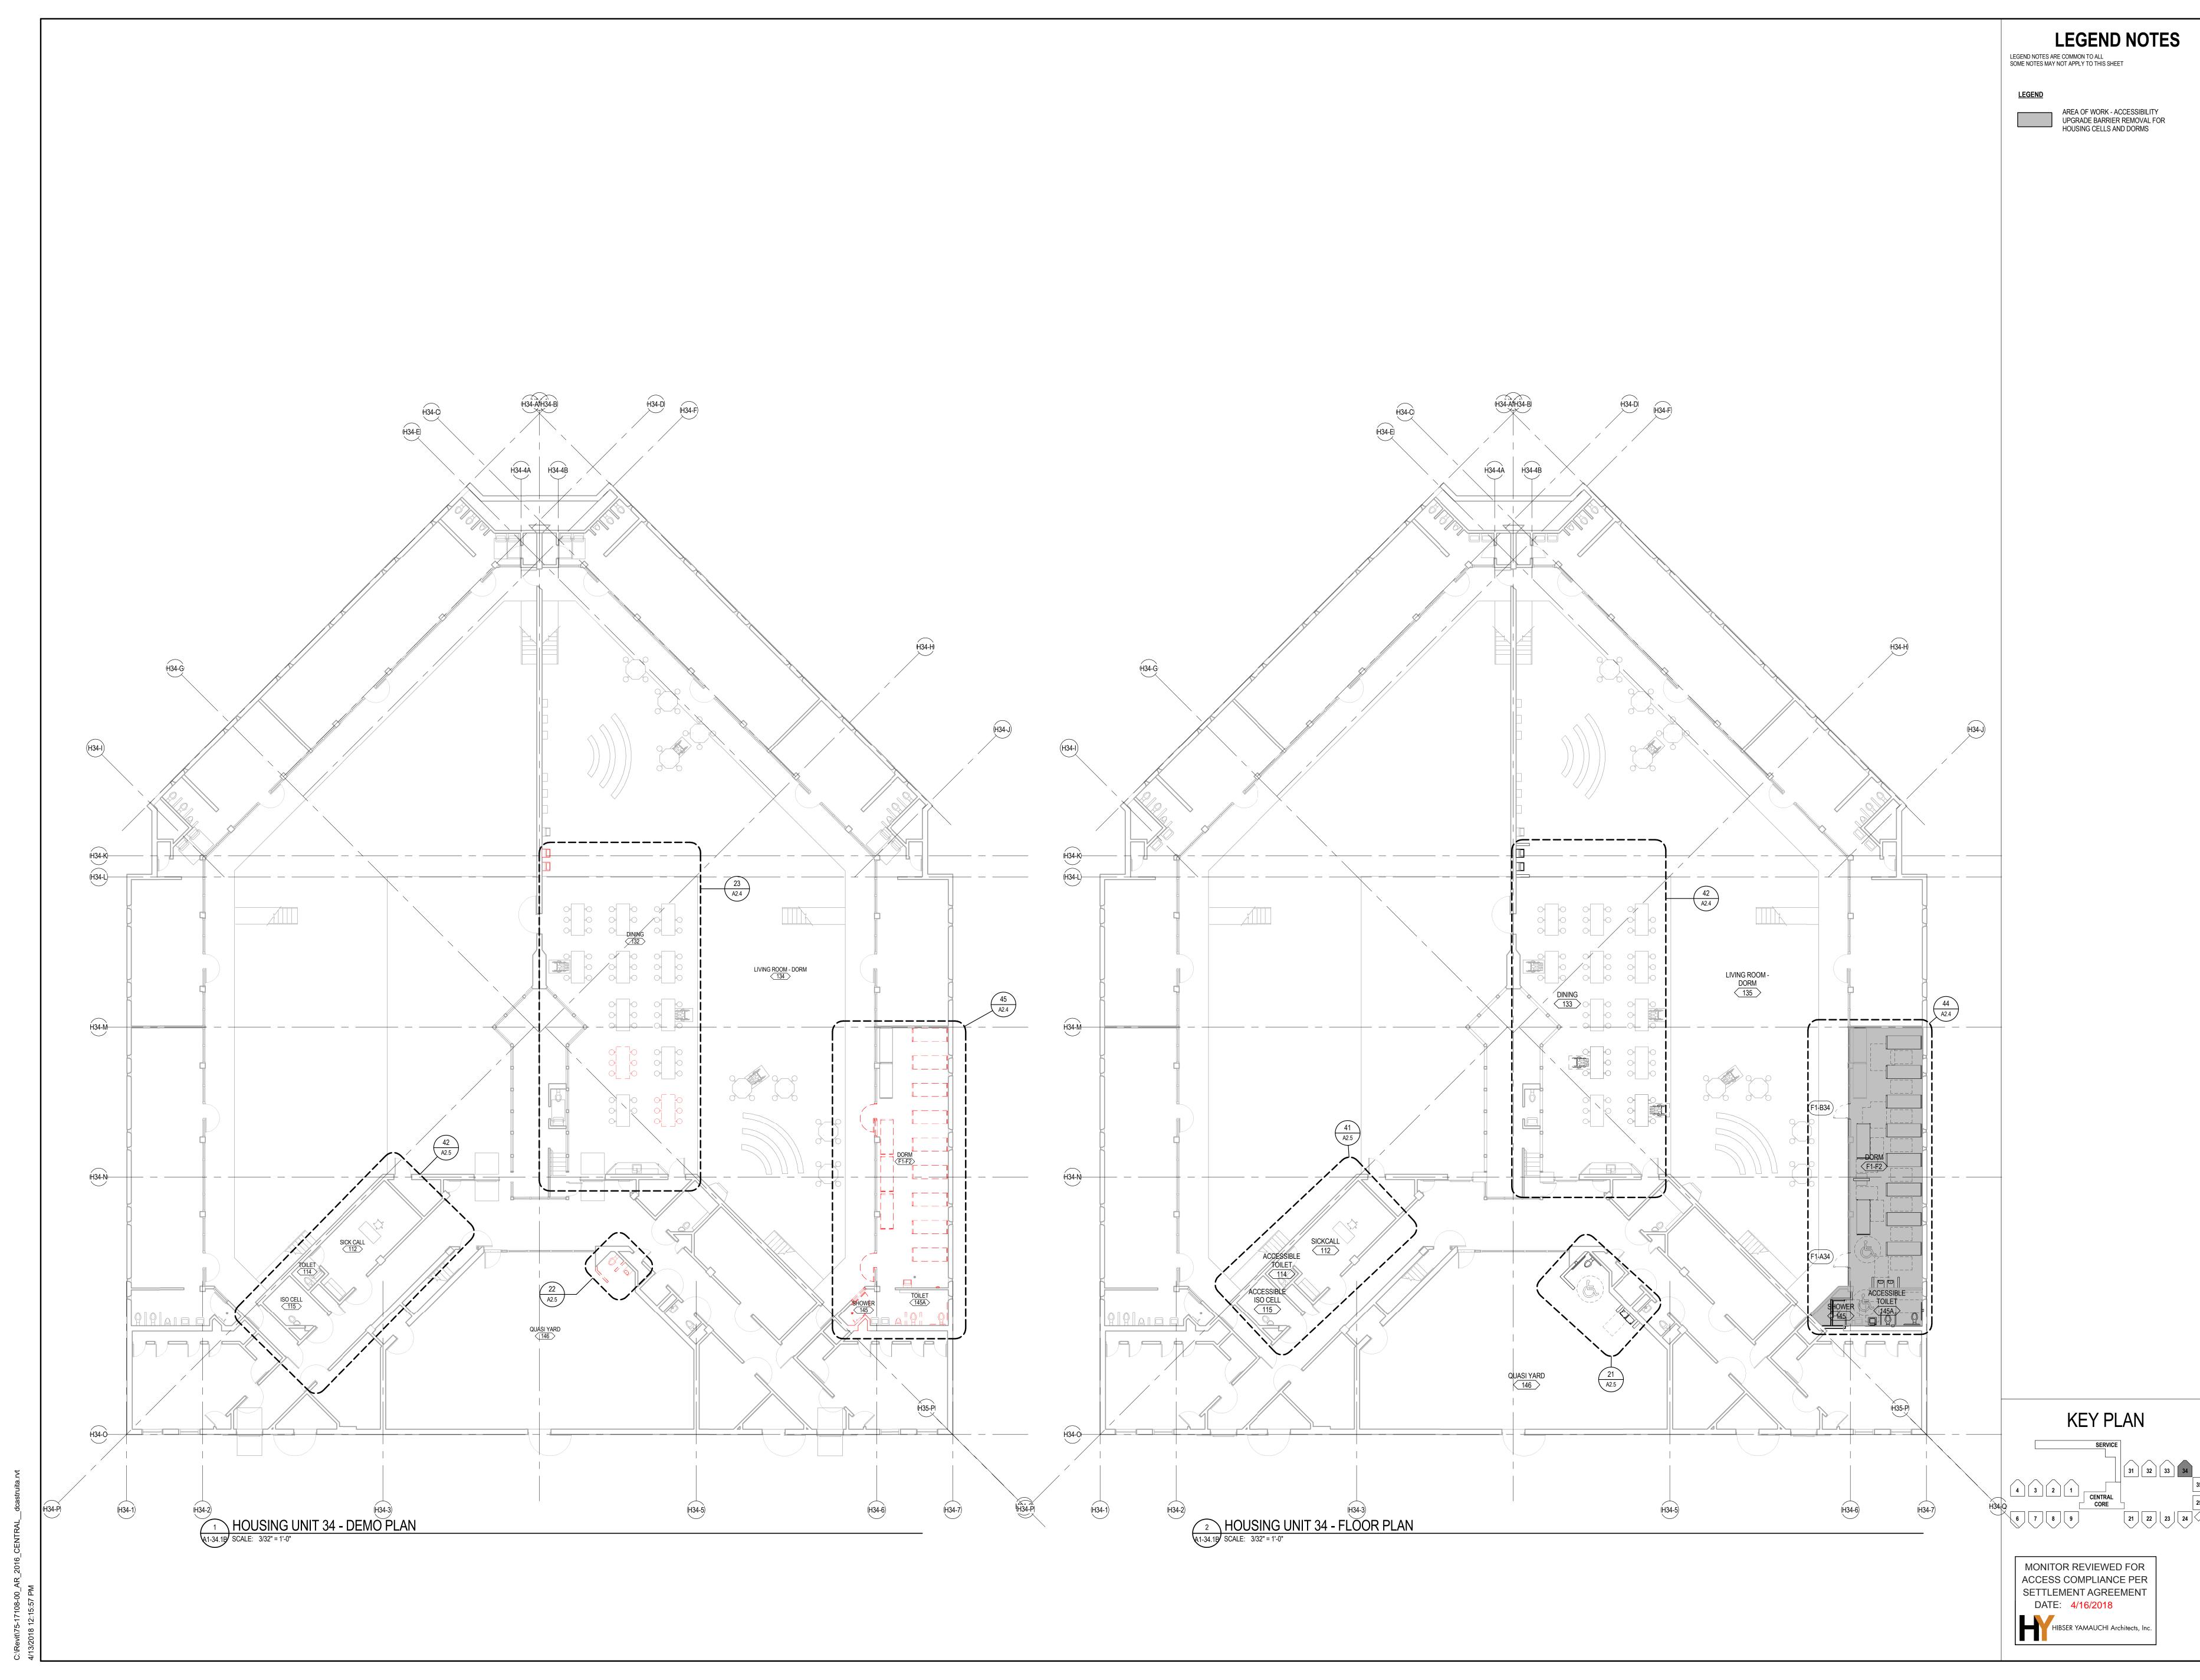






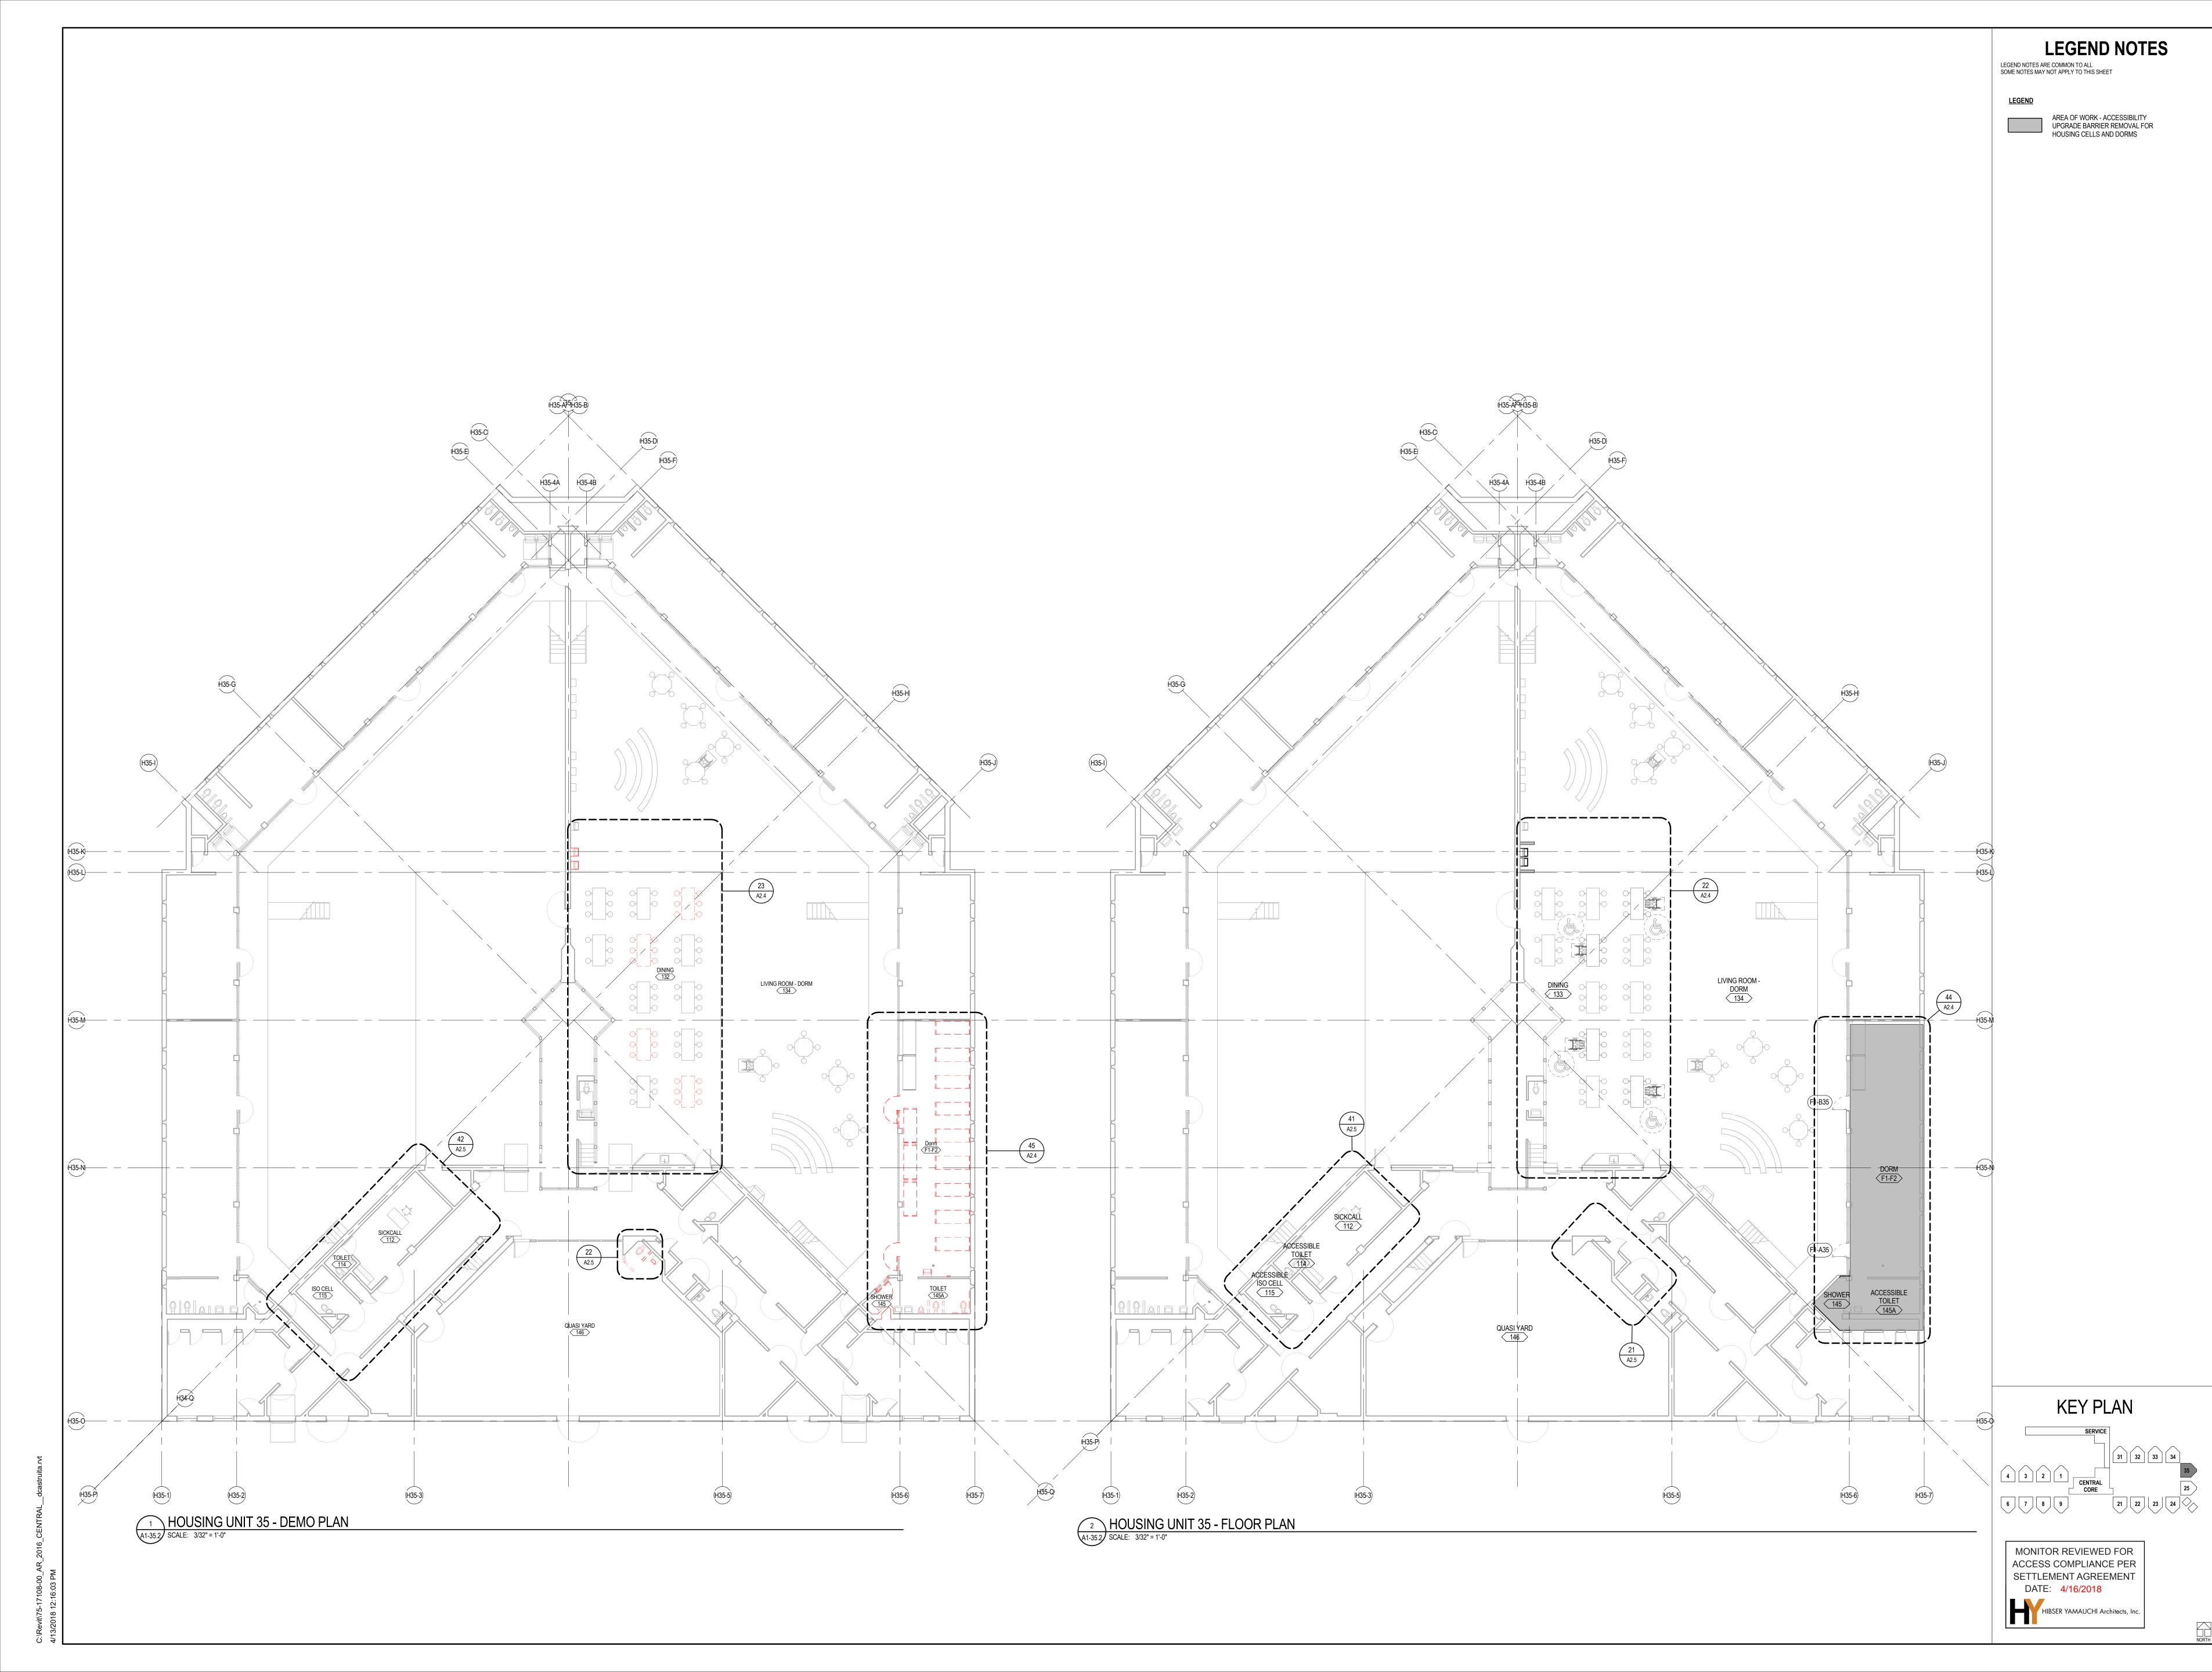





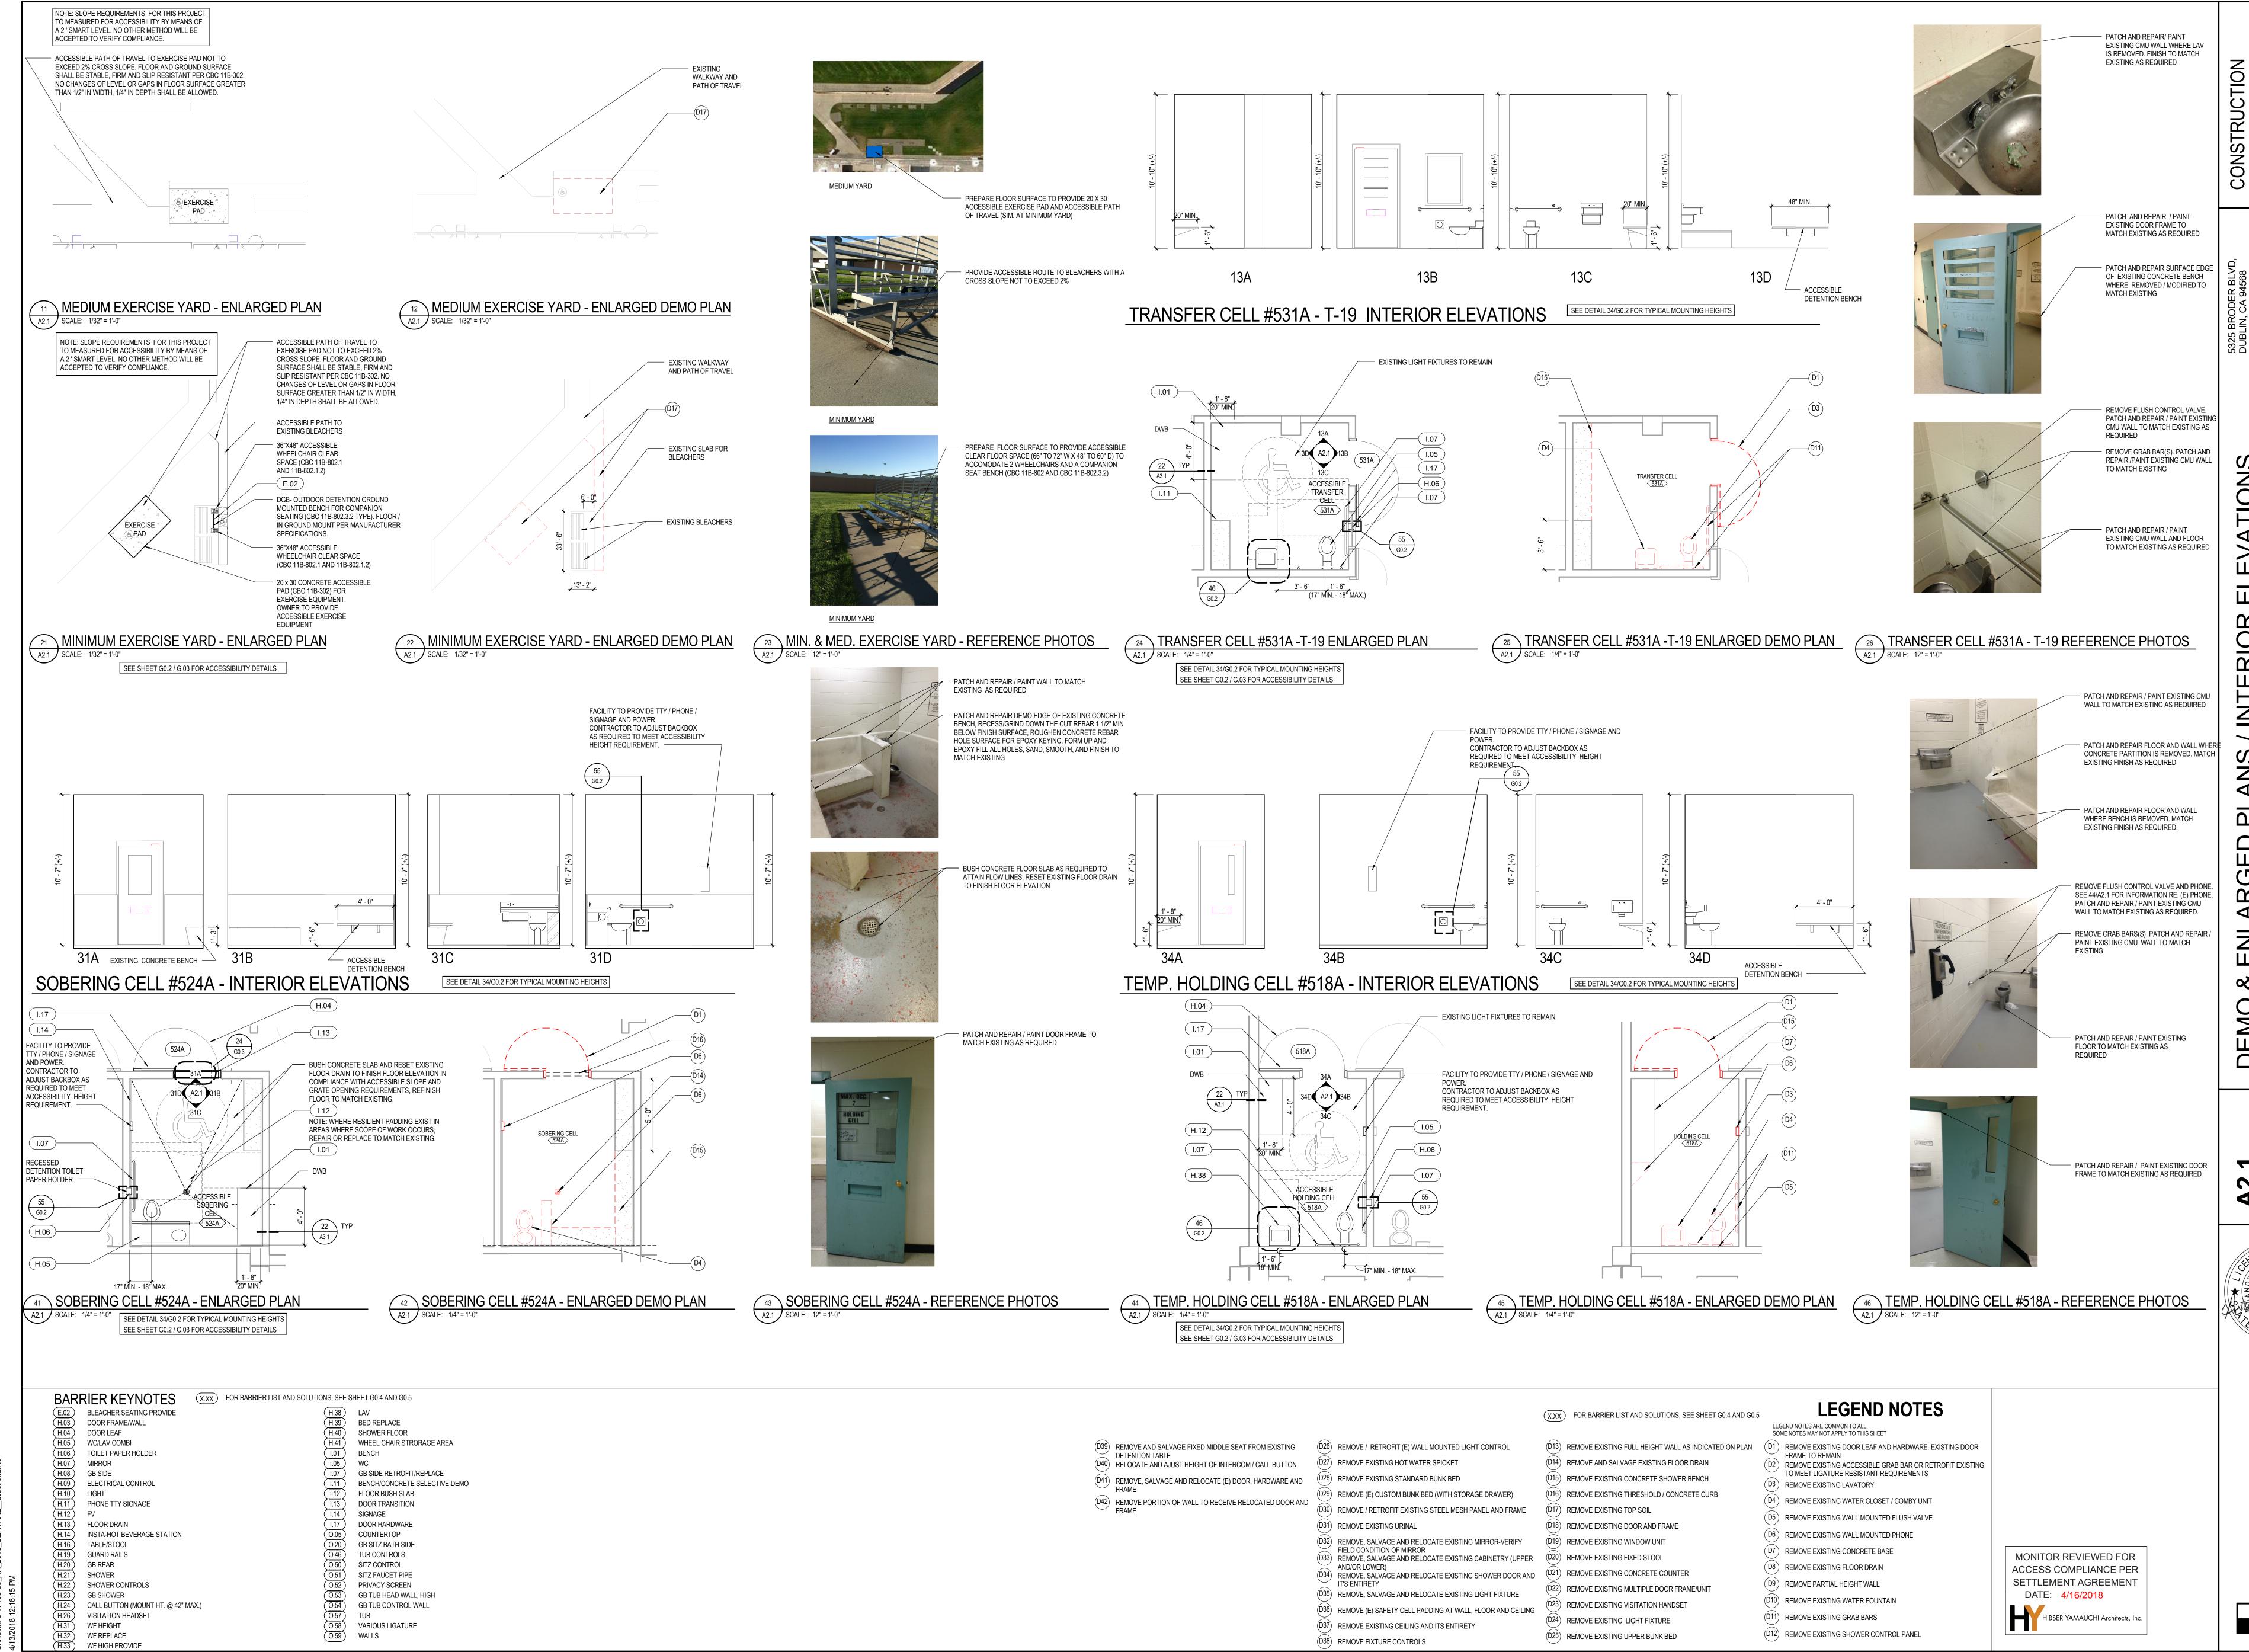

VARIOUS LIGATURE

WALLS


HIBSER YAMAUCHI Architects, Inc

(D12) REMOVE EXISTING SHOWER CONTROL PANEL

(D24) REMOVE EXISTING LIGHT FIXTURE

(D25) REMOVE EXISTING UPPER BUNK BED

(D37) REMOVE EXISTING CEILING AND ITS ENTIRETY

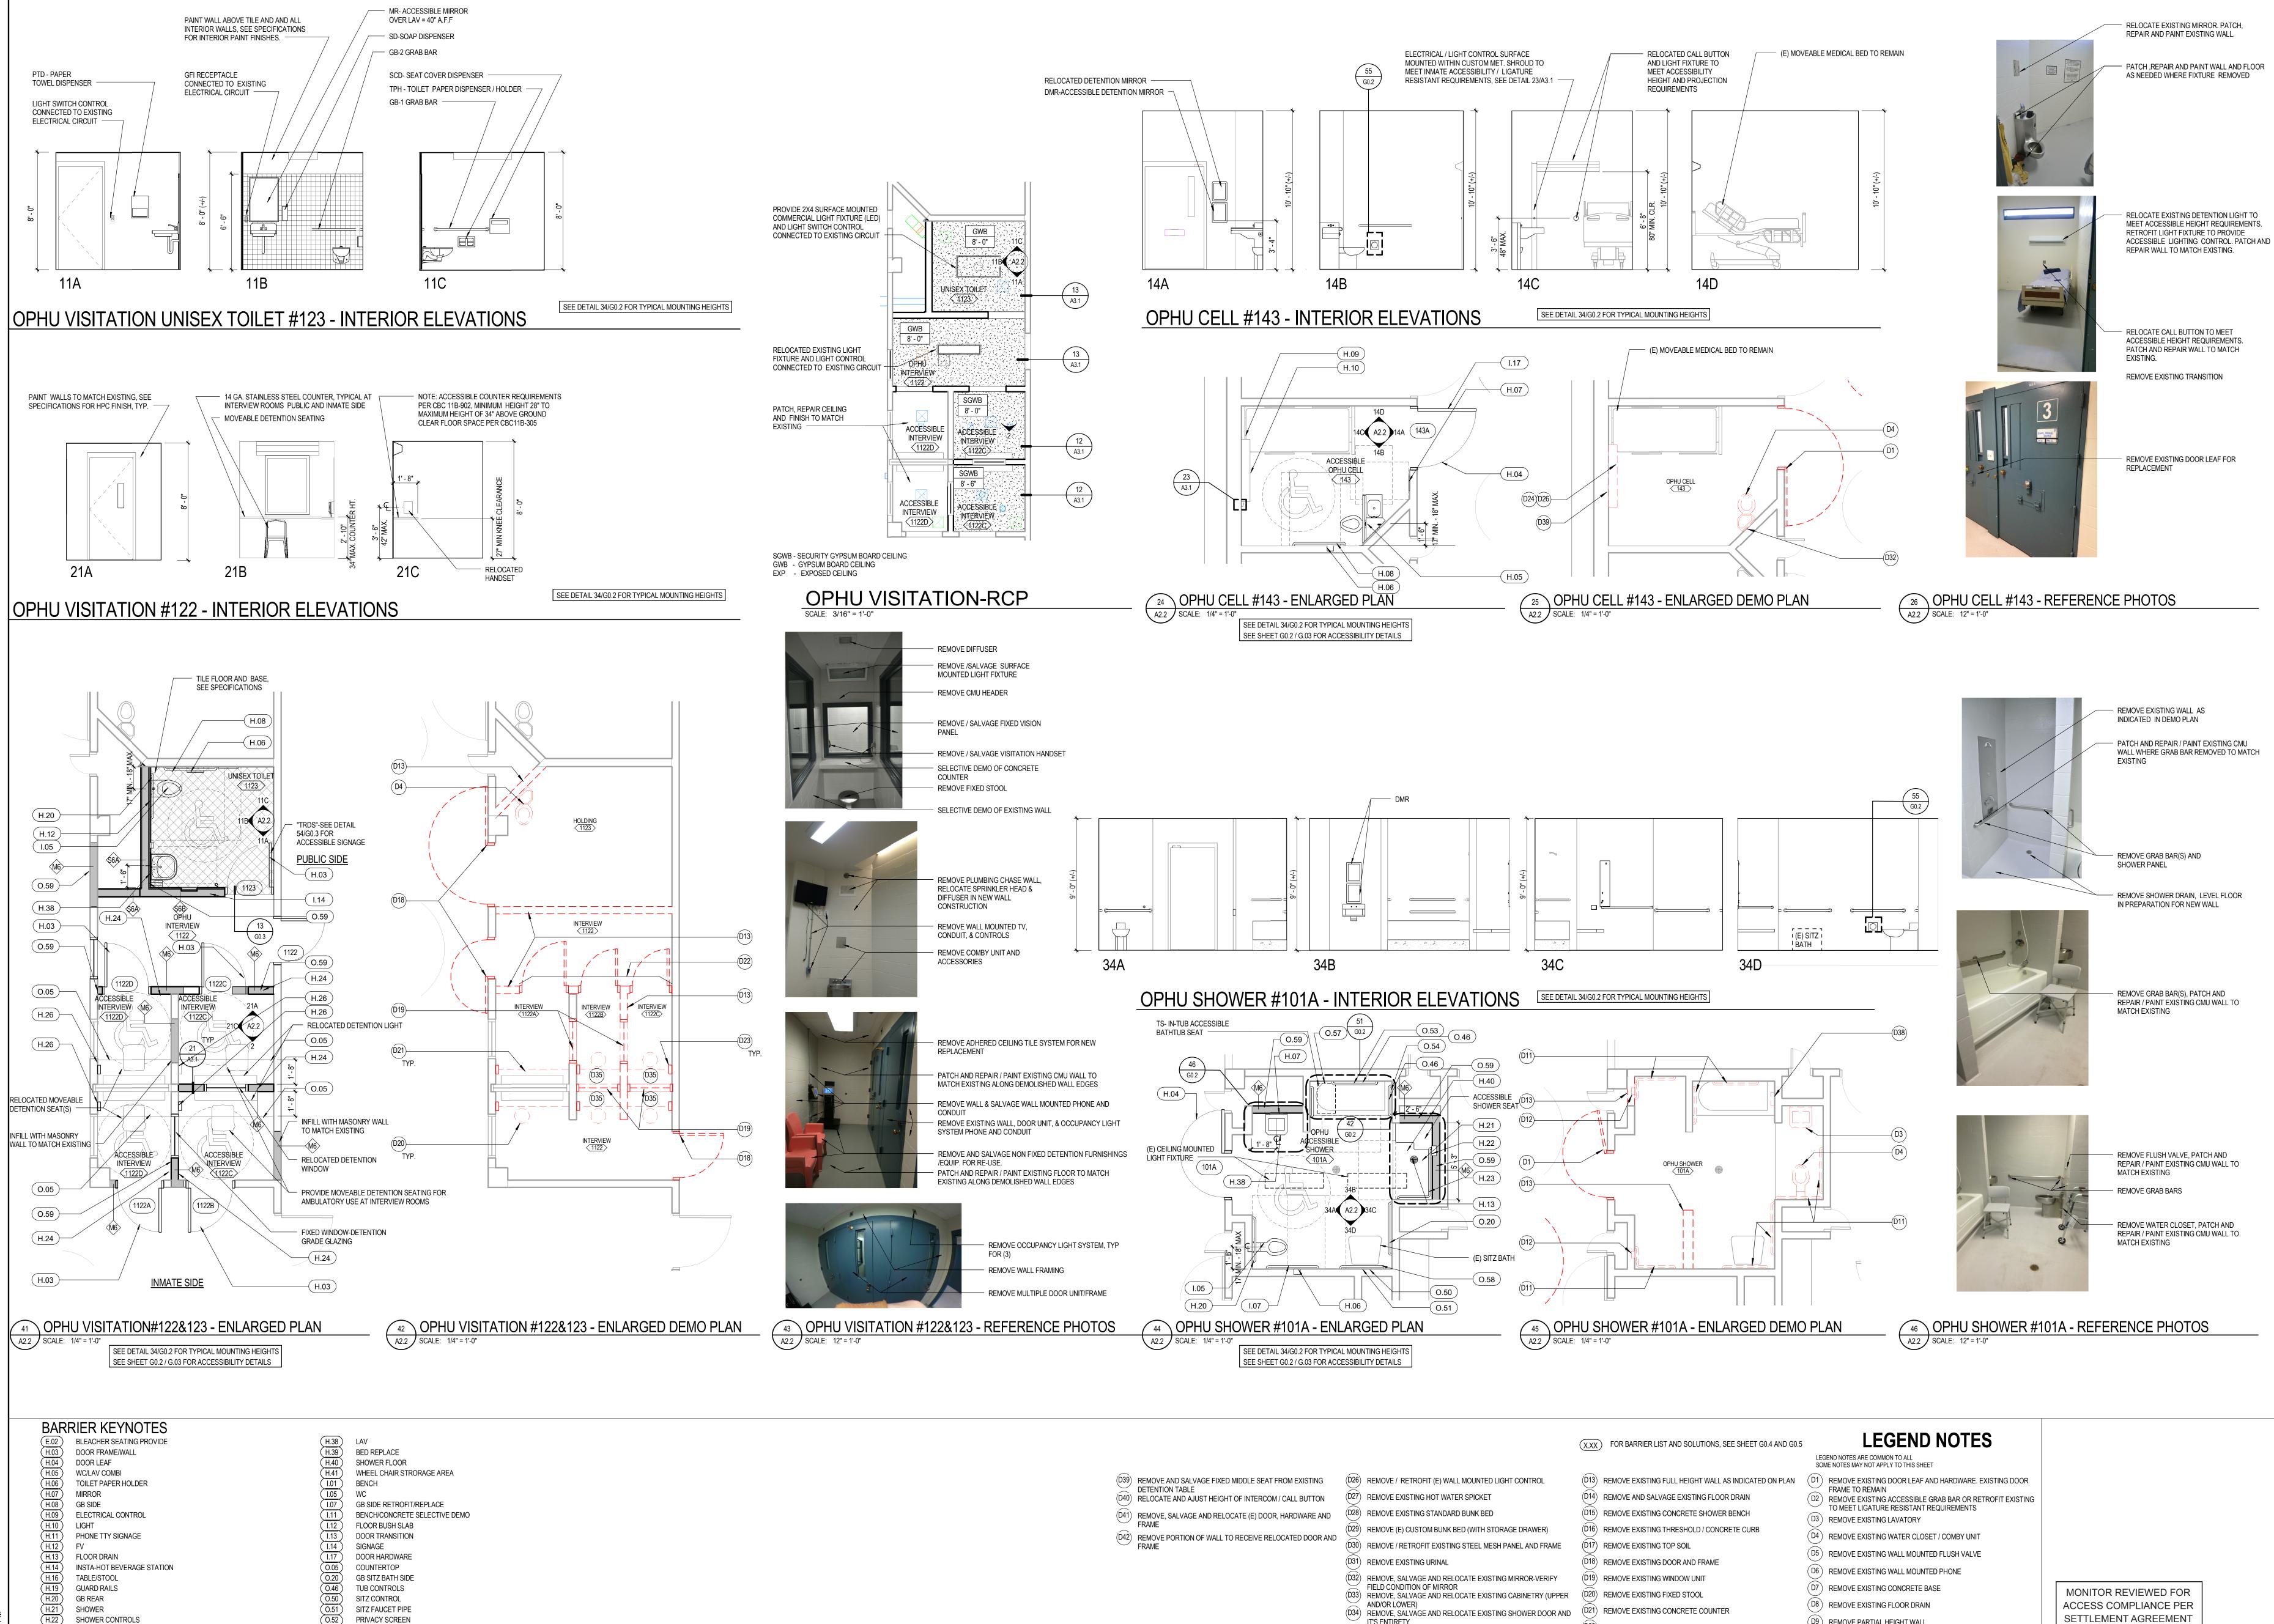

SHOWER

H.24 H.26 H.31 H.32 H.33

GB SHOWER

WF HEIGHT

WF REPLACE

WF HIGH PROVIDE

SHOWER CONTROLS

VISITATION HEADSET

CALL BUTTON (MOUNT HT. @ 42" MAX.)

SITZ FAUCET PIPE

PRIVACY SCREEN

TUB

WALLS

GB TUB HEAD WALL, HIGH

GB TUB CONTROL WALL

VARIOUS LIGATURE

0.53 0.54 0.57 0.58

0.59

SETTLEMENT AGREEMENT

HIBSER YAMAUCHI Architects, Inc

DATE: 4/16/2018

REMOVE EXISTING CONCRETE COUNTER

D22) REMOVE EXISTING MULTIPLE DOOR FRAME/UNIT

D23) REMOVE EXISTING VISITATION HANDSET

(D24) REMOVE EXISTING LIGHT FIXTURE

(D25) REMOVE EXISTING UPPER BUNK BED

(D9) REMOVE PARTIAL HEIGHT WALL

(D11) REMOVE EXISTING GRAB BARS

(D10) REMOVE EXISTING WATER FOUNTAIN

(D12) REMOVE EXISTING SHOWER CONTROL PANEL


(D34) REMOVE, SALVAGE AND RELOCATE EXISTING SHOWER DOOR AND

(D36) REMOVE (E) SAFETY CELL PADDING AT WALL, FLOOR AND CEILING

(D35) REMOVE, SALVAGE AND RELOCATE EXISTING LIGHT FIXTURE

D37) REMOVE EXISTING CEILING AND ITS ENTIRETY

IT'S ENTIRETY

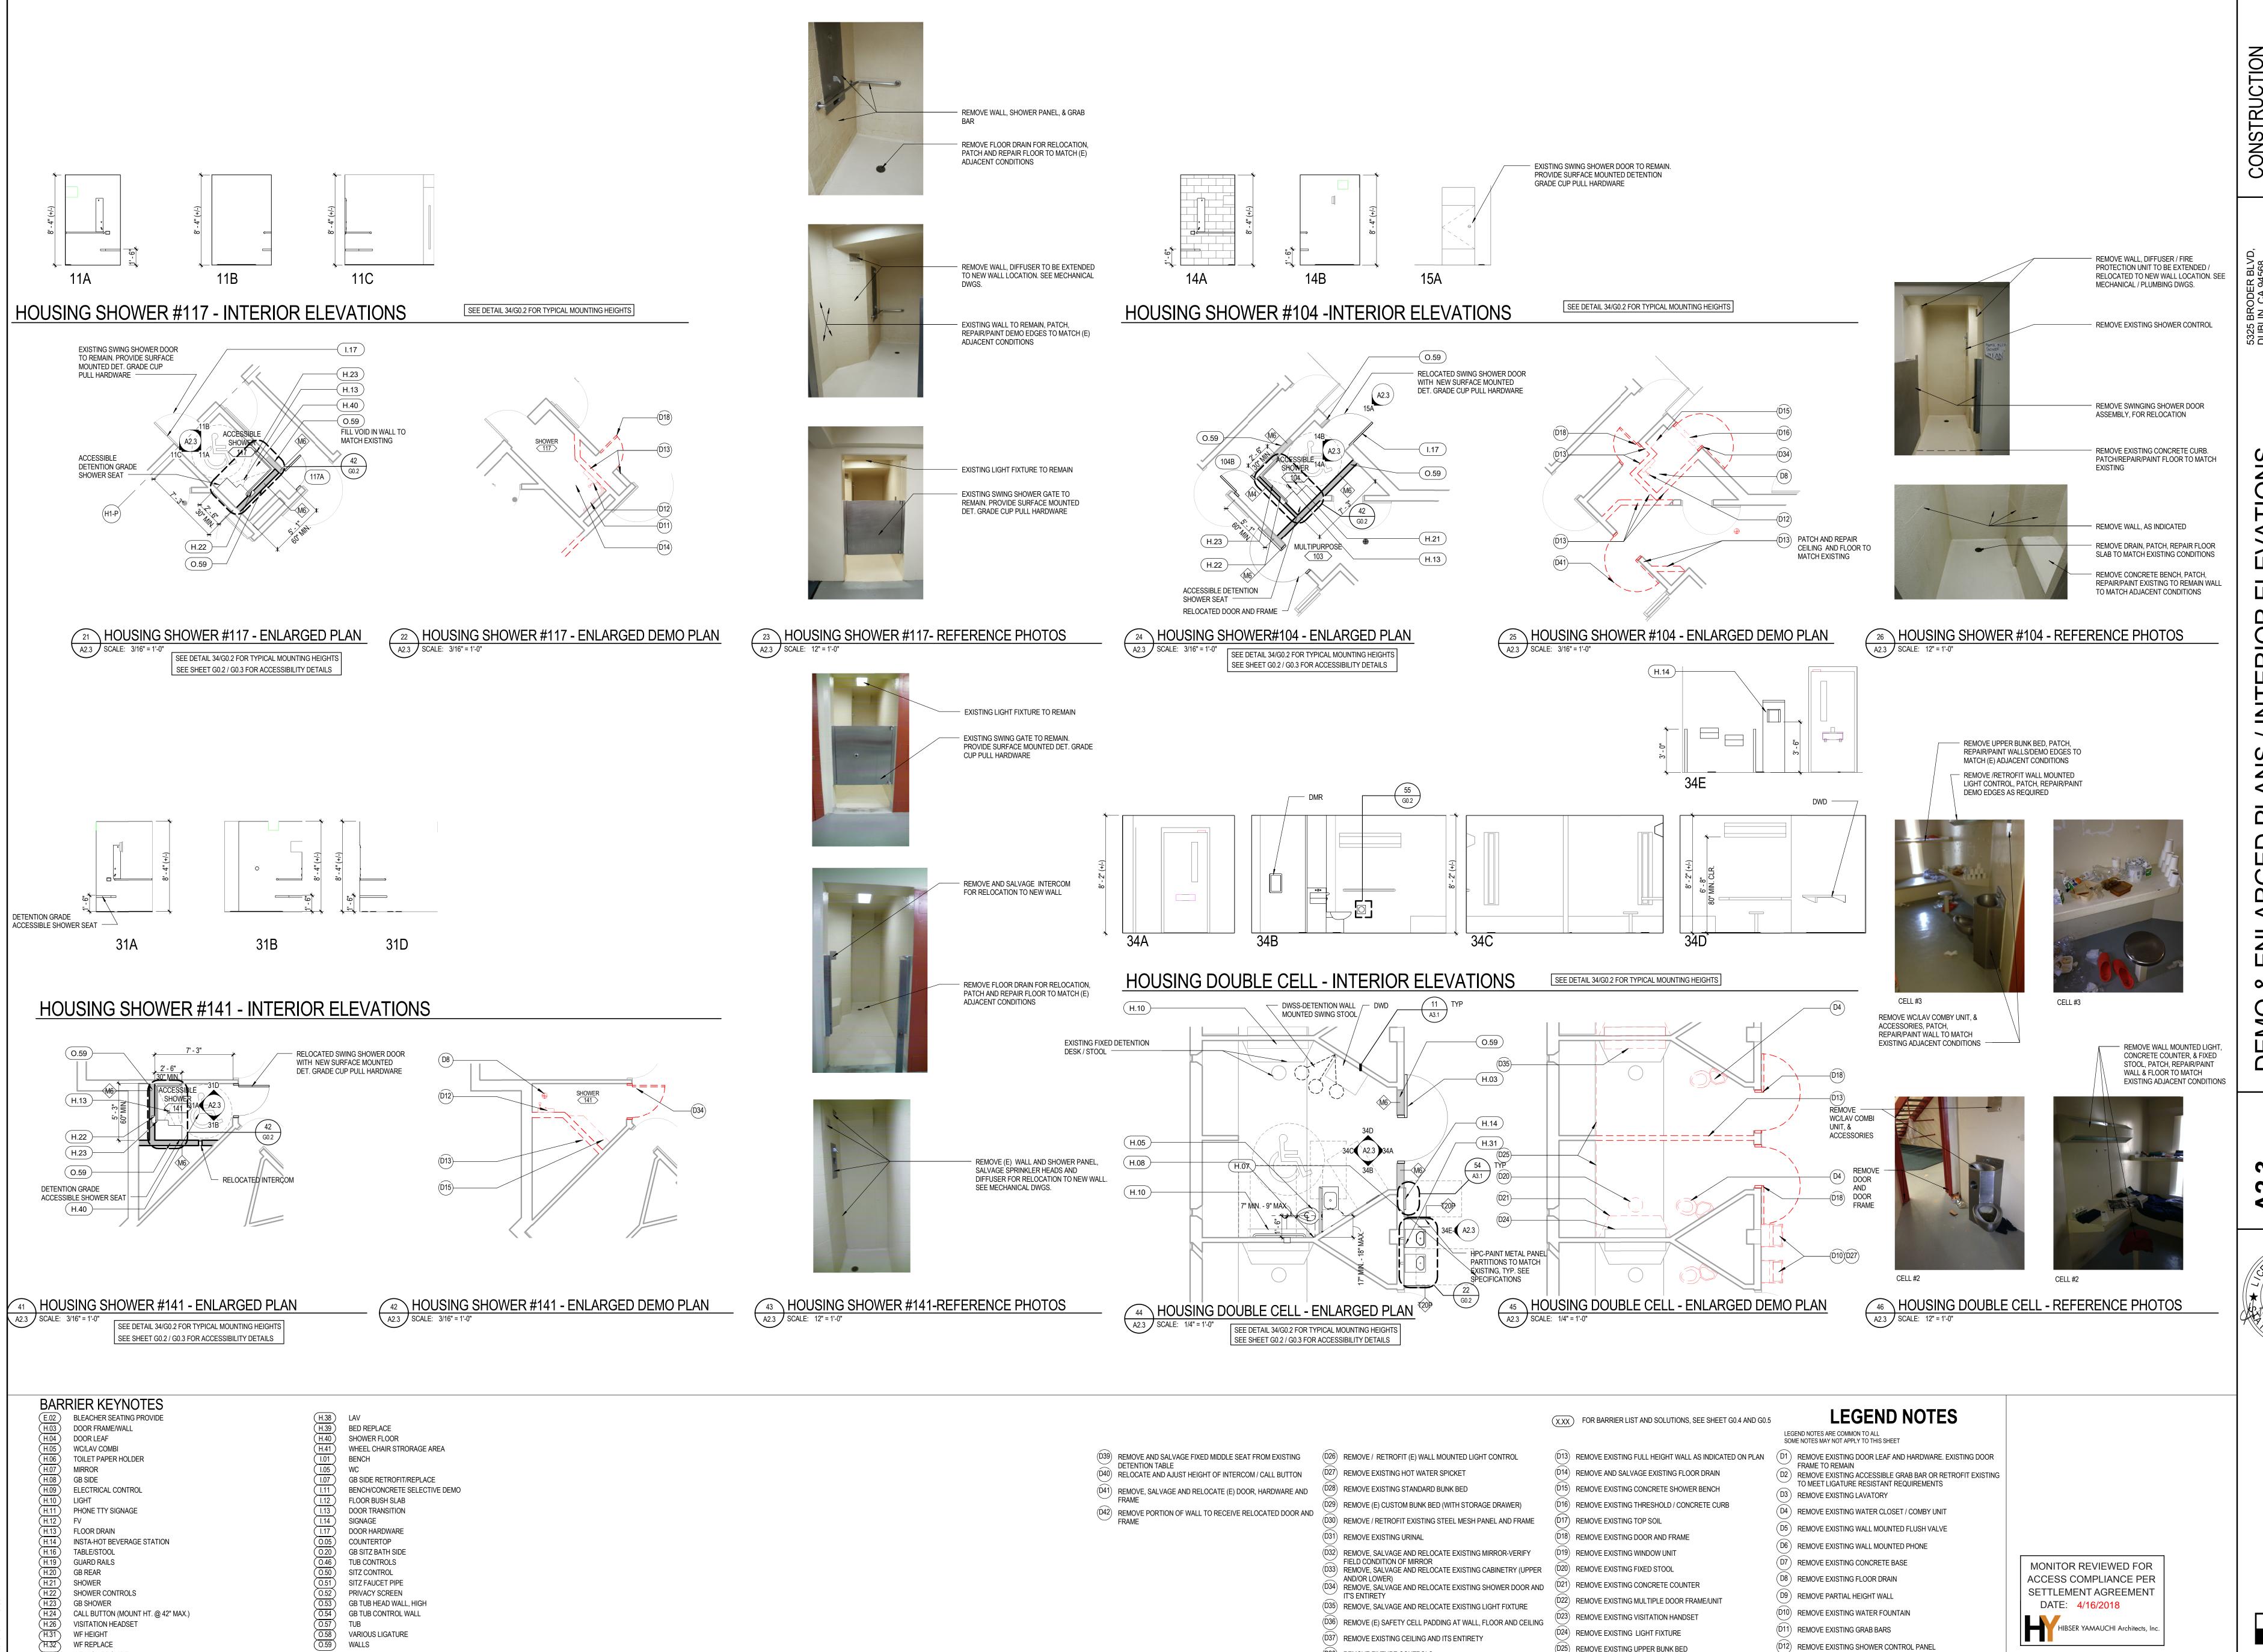

WF HEIGHT

WF REPLACE

WF HIGH PROVIDE

H.32

H.33

VARIOUS LIGATURE

WALLS

D11) REMOVE EXISTING GRAB BARS

(D12) REMOVE EXISTING SHOWER CONTROL PANEL

(D24) REMOVE EXISTING LIGHT FIXTURE

(D25) REMOVE EXISTING UPPER BUNK BED

(D37) REMOVE EXISTING CEILING AND ITS ENTIRETY

CALL BUTTON (MOUNT HT. @ 42" MAX.)

VISITATION HEADSET

WF HEIGHT

WF REPLACE

WF HIGH PROVIDE

H.26 H.31 H.32 H.33

GB TUB CONTROL WALL

VARIOUS LIGATURE

TUB

WALLS

(D35) REMOVE, SALVAGE AND RELOCATE EXISTING LIGHT FIXTURE

(D37) REMOVE EXISTING CEILING AND ITS ENTIRETY

(D38) REMOVE FIXTURE CONTROLS

(D36) REMOVE (E) SAFETY CELL PADDING AT WALL, FLOOR AND CEILING

P23) REMOVE EXISTING VISITATION HANDSET

(D24) REMOVE EXISTING LIGHT FIXTURE

(D25) REMOVE EXISTING UPPER BUNK BED


(D10) REMOVE EXISTING WATER FOUNTAIN

(D12) REMOVE EXISTING SHOWER CONTROL PANEL

(D11) REMOVE EXISTING GRAB BARS



HIBSER YAMAUCHI Architects, Inc

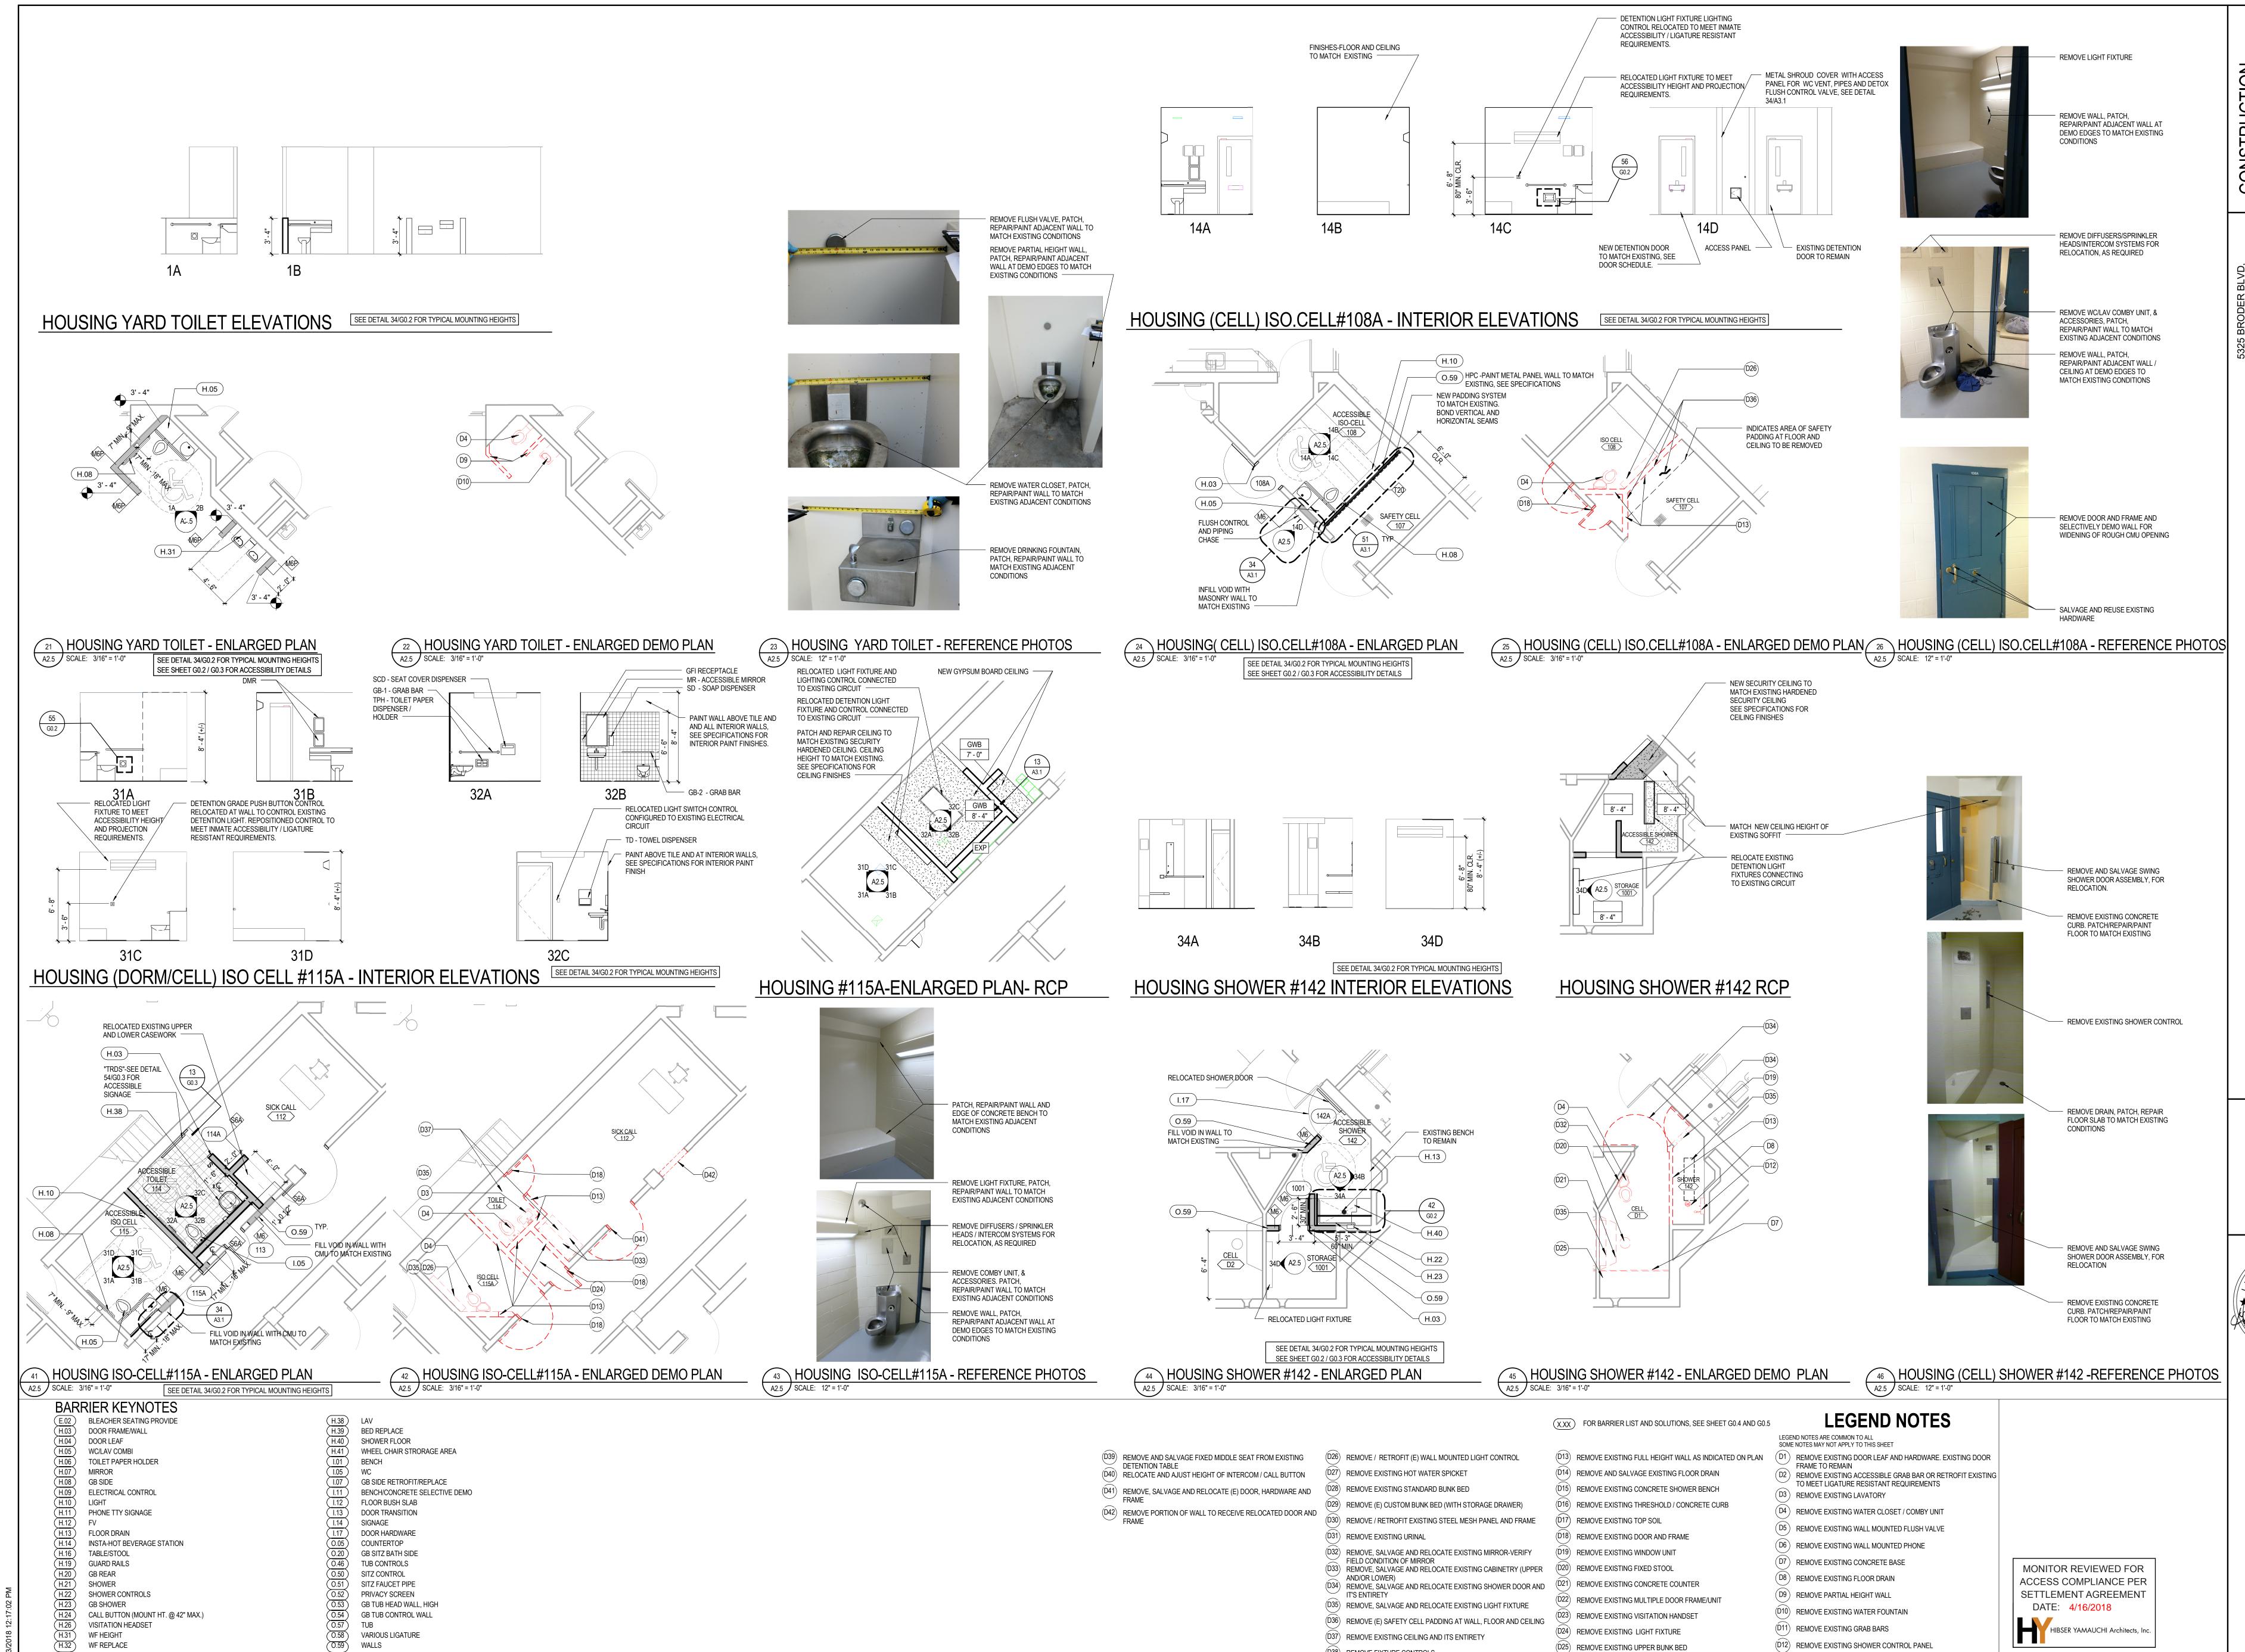



(H.32) WF REPLACE

(H.33) WF HIGH PROVIDE

(D12) REMOVE EXISTING SHOWER CONTROL PANEL

(D25) REMOVE EXISTING UPPER BUNK BED

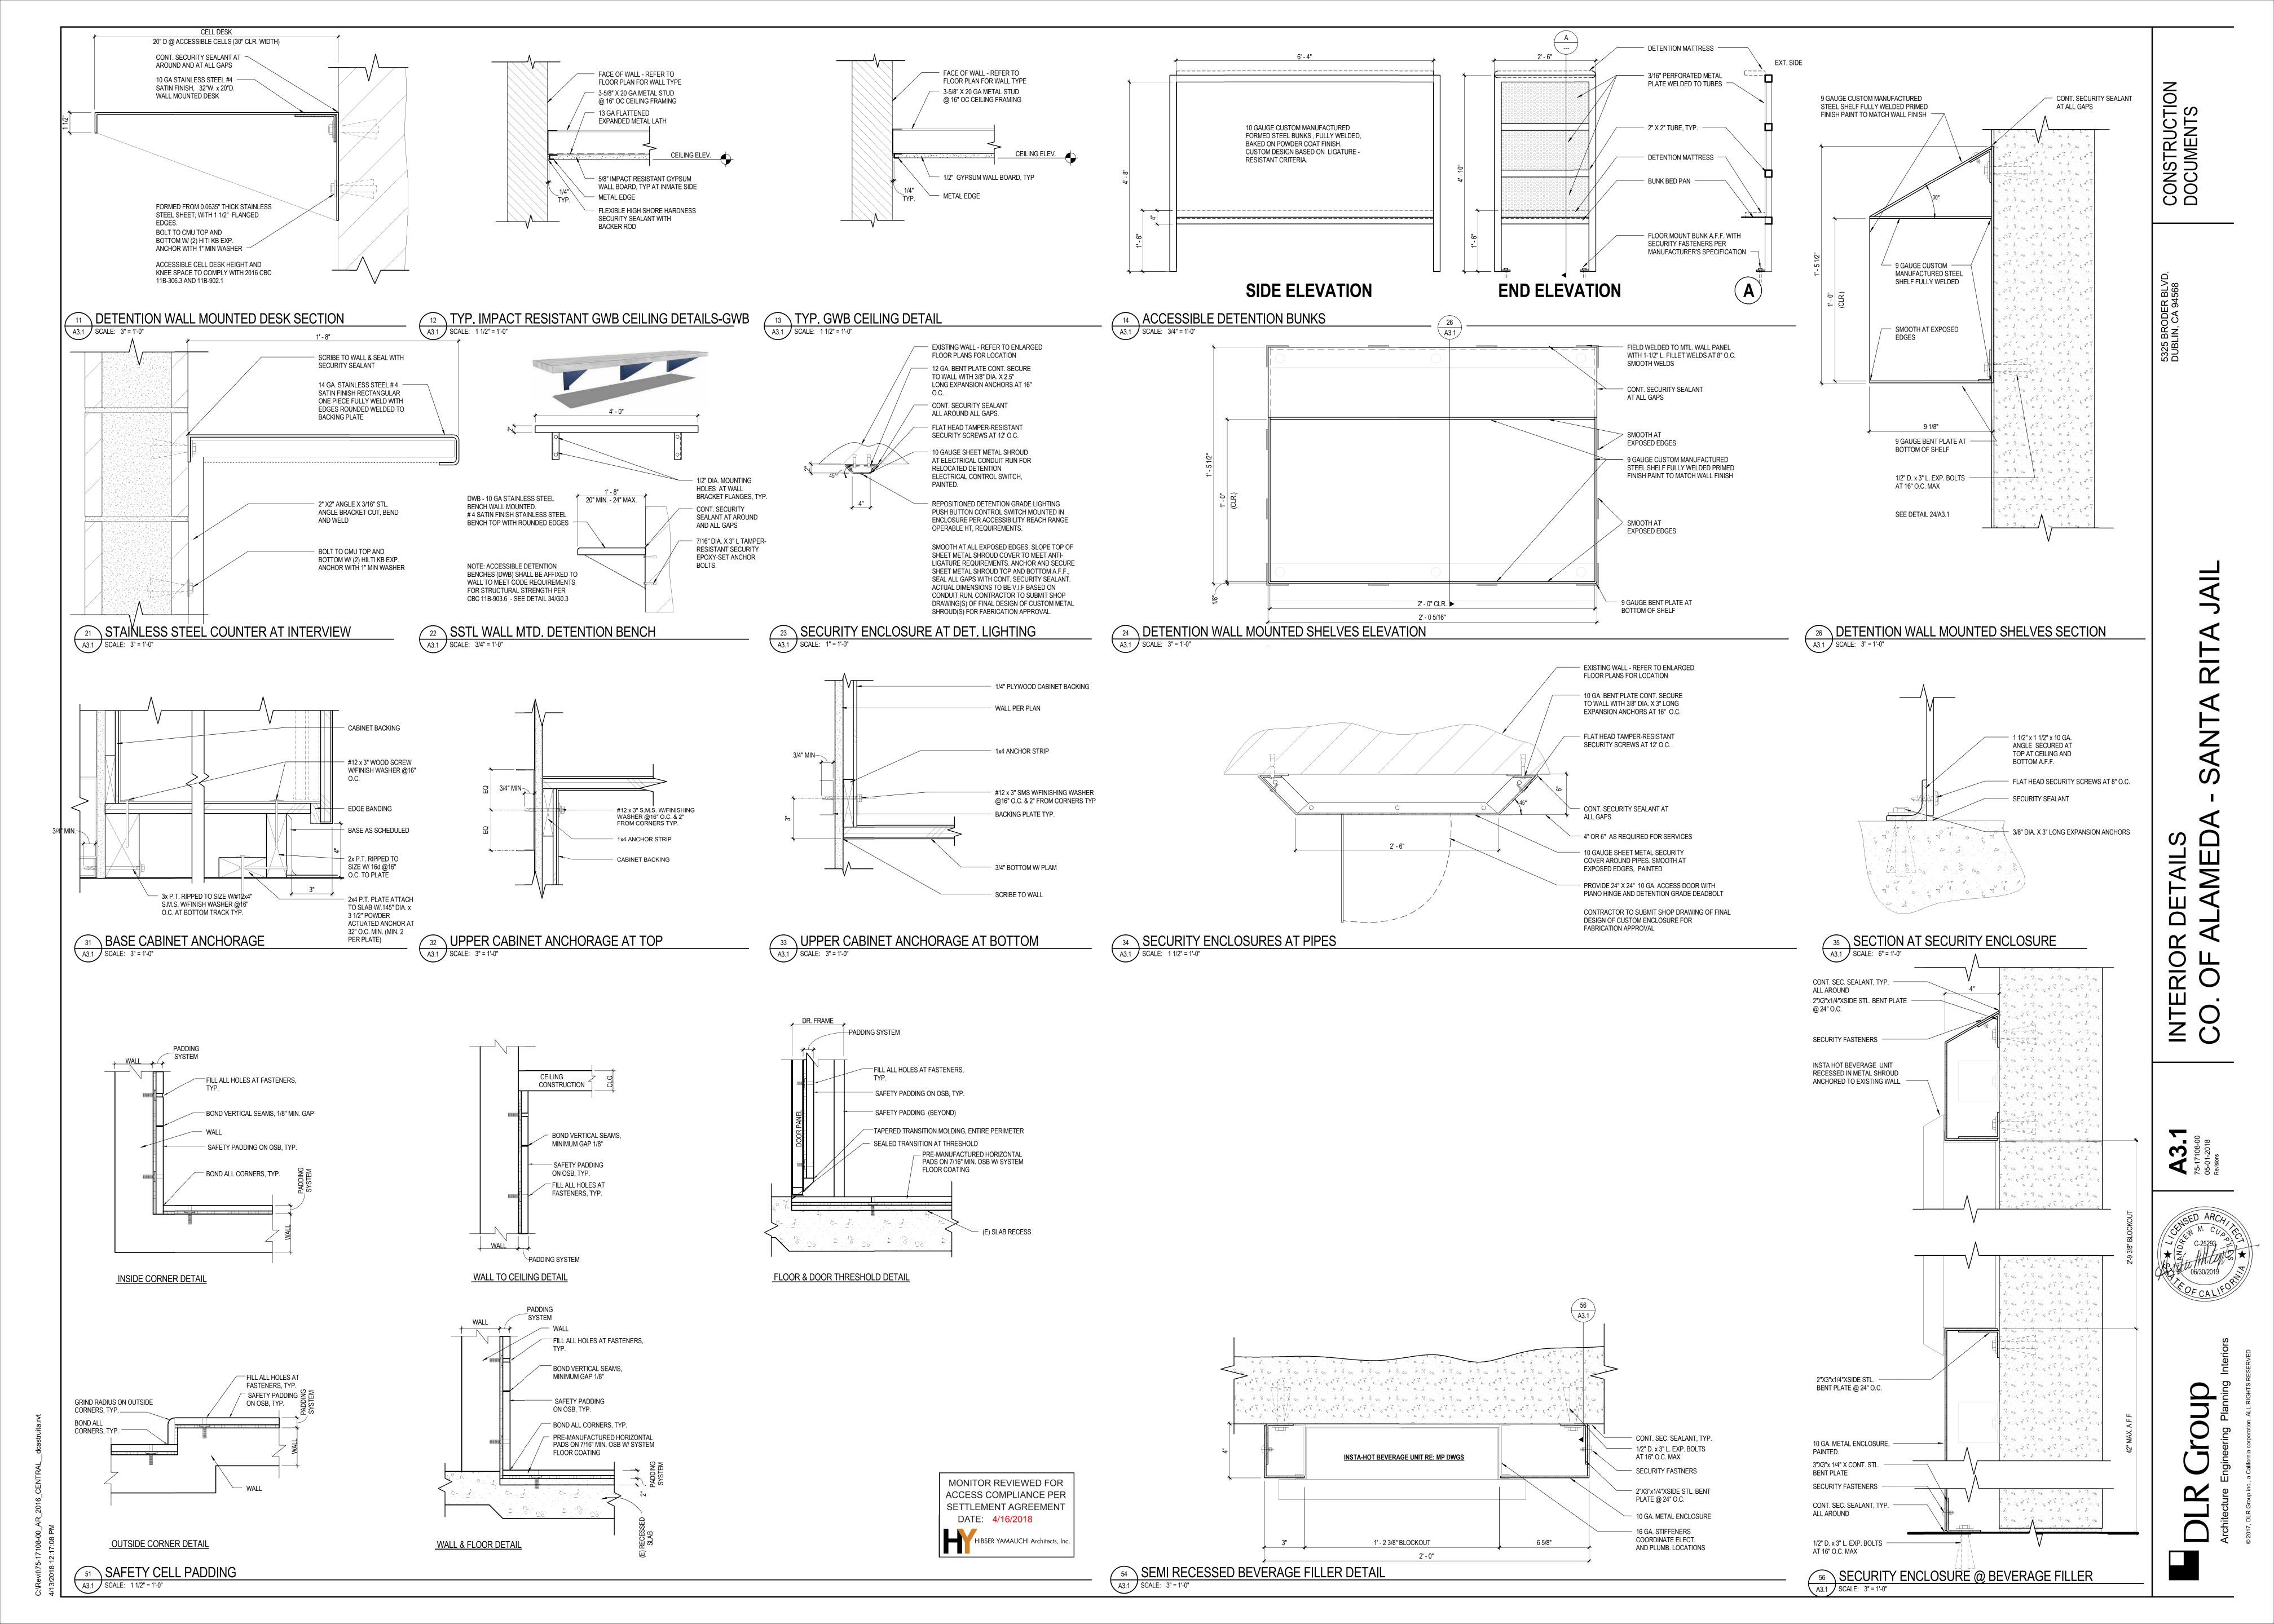

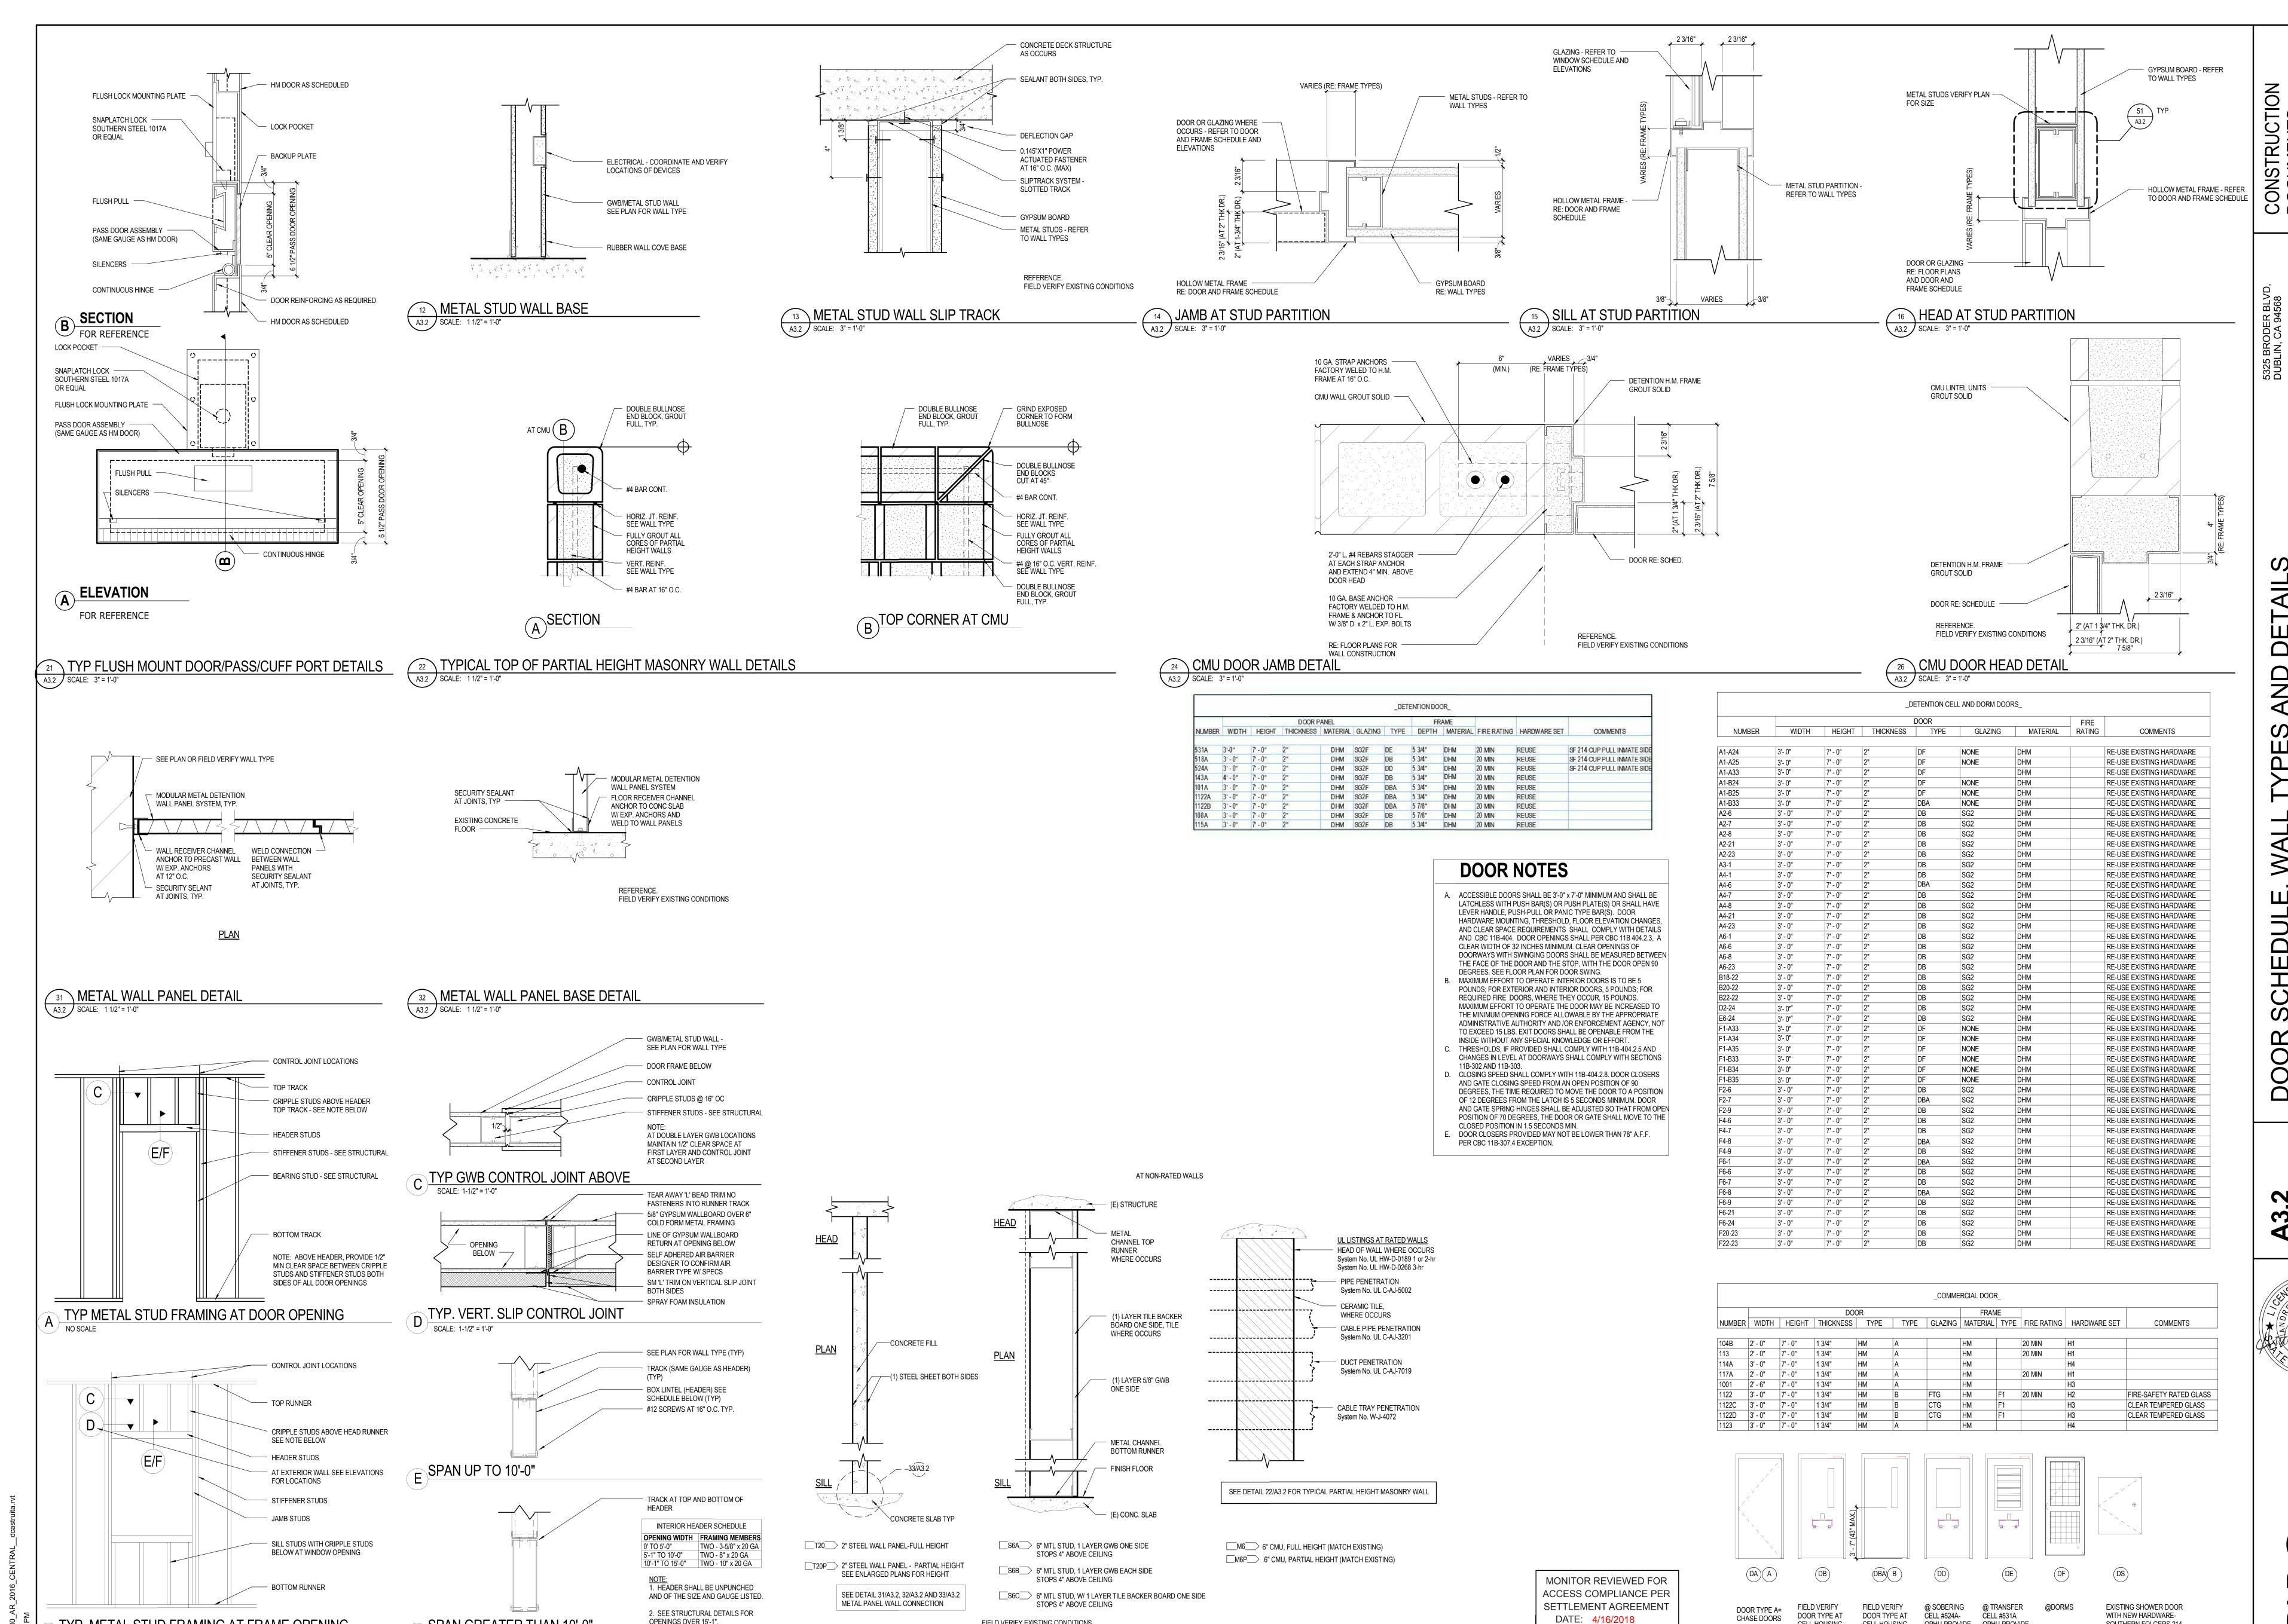

FIELD VERIFY EXISTING CONDITIONS

TYPICAL WALL TYPES

A3.2 | SCALE: 1 1/2" = 1'-0"

SPAN GREATER THAN 10'-0"

OPENINGS OVER 15'-1".

TYP. METAL STUD FRAMING AT FRAME OPENING

TYP. GWB CONTROL JOINT DETAILS AT DOOR FRAMES

SOUTHERN FOLGERS 214

CUP PULL HARDWARE

CHASE DOORS

DOOR TYPE "D"=

DETENTION DOOR

AND TOILET

ROOMS

HIBSER YAMAUCHI Architects, Inc

CELL HOUSING

CELL HOUSING

OPHU-PROVIDE OPHU-PROVIDE

SOUTHERN

FOLGERS 214

HARDWARE AT

INMATE SIDE

CUP PULL

SOUTHERN

FOLGERS 214

CUP PULL AT

INMATE SIDE

MECHANICAL ABBREVIATIONS

ACCESS DOOR

AREA DRAIN

ABOVE FINISH FLOOR

AIR PRESSURE DROP

BACK DRAFT DAMPER

BELOW FINISH FLOOR

BOTTOM OF DUCT

BOTTOM OF PIPE

CAST IRON

COUNTER SINE COLD WATER

DIFFUSER

DOOR GRILLE

DOWN

FXISTING

FXHALIST AIR

FXHAUST FAN

EXPANSION TANK

FLOOR CLEAN OUT

FLOOR DRAIN

FXHAUST

FLOOR

HAND SINK

HOT WATER

HOT WATER CIRCULATION

LEAVING AIR TEMPERATURE

LEAVING WATER TEMPERATURI

MAXIMUM SECURITY GRILLE SUPPLY

MAXIMUM SECURITY GRILLE EXHAUST

HOT WATER RETURN

MOTORIZED DAMPER

MANUFACTURER

NOT IN CONTRACT

OVERFLOW DRAIN

OUTSIDE AIR

NON POTABLE COLD WATER

OPEN TO CEILING SPACE

PRESSURE DIFFERENCE

POINT OF CONNECTION

POINT OF DISCONNECT

RAIN LEADER (OR STORM WATER)

REDUCED PRESSURE BACKFLOW PREVENTOR

STRUCTURAL POLYCARBONATE PANEL ASSEMBLY

DOOR UNDERCUT (3/4" UNLESS OTHERWISE NOTED)

WATER CLOSET / LAVATORY COMBINATION UNIT

RETURN AIR

SANITARY SEWER SUPPLY AIR

SURFACE CLEAN OUT

SMOKE DETECTOR

SHUT-OFF VALVE

SERVICE SINK

TRANSFER BOOT

TRENCH DRAIN

TYPICAL

UP THRU ROOF

VENT THRU ROOF

SANITARY WASTE

WATER CLOSET

WALL CLEAN OUT

ZONE CONTROL VALVE

TOTAL STATIC PRESSURE

UNLESS NOTED OTHERWISE

VARIABLE AIR VOLUME

VARIABLE FREQUENCY DRIVE

JANITORS SINK

LAVATORY

MIXED AIR

NEW

MFGR

OTCS

SPPA

WCO

DRINKING FOUNTAIN

DUCT SMOKE DETECTOR

ENTERING AIR TEMPERATURE

EXTERNAL STATIC PRESSURE

ENTERING WATER TEMPERATUR

DUCT THRU ROOF

AIR HANDLING UNIT

ACCESS PANEL

BELOW

| PLUMBING FIXTURE SCHEDULE | | | | | | | | | | |
|---------------------------|---|--------|------|--------|--------|---|--|--|--|--|
| MARK | K FIXTURE VENT H.W. C.W. WASTE CONNECTION REMARKS | | | | | | | | | |
| WC-1 | WATER CLOSET (FLOOR MTD, ADA) | 2" | - | 1-1/2" | 3" MIN | KOHLER K-4325 KINGSTON ELONGATED TOILET BOWL. WALL MOUNTED. 1.28 GPF. INSTALL PER ADA REQUIREMENTS AT 17"-19" TOP OF TOILET SEAT. | | | | |
| C-1 | COMBY UNIT (ADA) | 2" | 1/2" | 1" | 4" | ACORN PENAL-WARE 1432ALAR SERIES, ADA 2010 COMPLIANT - LAV/TOILET COMBY - ANGLED TOILET BOWL - ANGLED LAVY. OPTIONS : -2-BPH-03-0M-PBH-1.28 GPH-LW1-CO1-FVT-PC-TWE-SW | | | | |
| C-2 | COMBY UNIT (ADA) | 2" | 1/2" | 1" | 4" | ACORN PENAL-WARE 1449 SERIES, ADA 2010 COMPLIANT - LAV/TOILET COMBY - OFFSET TOILET BOWL. OPTIONS: LO/RO (SEE PLANS FOR LEFT OR RIGHT OFFSET)3-BPH-03-0M-PBH-1.28 GPF-LWE-CO1-FVT-TWE-DMB-SW | | | | |
| C-3 | WATER CLOSET (FLOOR MTD, INMATE, ADA) | 2" | 1/2" | 1" | 4" | ACORN PENAL-WARE 1695 SERIES, - SIPHON JET TOILET - FLOOR MOUNTED OPTIONS: W-1.28-GPF-HPS-FVT-ADA-SW | | | | |
| SH-1 | SHOWER (INMATE, ADA) | 2" | 1/2" | 1" | 2" | ACORN PENAL-WARE 1741ADAFA SERIES, FRONT ACCESS ADA COMPLIANT. OPTONS: 03-M-PBH- CSH-F-1.4GPM-FH | | | | |
| SH-2 | SHOWER (INMATE, ADA) | 2" | 1/2" | 1" | 2" | ACORN PENAL-WARE 1741ADA SERIES, PENAL-PAK WALL SHOWER- ADA COMPLIANT. OPTONS: 04-M-PBH- CSH-F-1.4GPM-FH | | | | |
| FD-1 | FLOOR DRAIN (FOR SH-1 & SH-2) | 1-1/2" | - | TP | 2" | ZURN PRISON CELL FLOOR DRAIN. MODEL Z355. DURA-COATED CAST IRON BODY WITH SIDE OUTLET, INTEGRAL TRAP, ANCHOR FLANGE AND ADJUSTABLE NICKLE BRONZE SLOTTED STRANER SECURED WITH SPANNER TYPE VANDAL PROOF SCREWS. | | | | |
| L-1 | LAVATORY (WALL HUNG, ADA) | 1-1/2" | 1/2" | 1/2" | 2" | KOHLER KINGSTON WALL MOUNTED BATHROOM SINK MODEL-K-2005. VITREOUS CHINA, K-8998 P-TRAP. | | | | |
| SL-1 | LAVATORY (WALL HUNG, INMATE, ADA) | 1-1/2" | 1/2" | 1/2" | 2" | ACORN PENAL-WARE LR1652-1-03-M. 18" LAV WITH OVAL BOWL, ADA 2010 COMPLIANT. | | | | |
| DF-1 | DRINKING FOUNTAIN (ADA) | 1-1/2" | - | 1/2" | 2" | ACORN LR1672-1-BPH-3-PBH. LIGATURE RESISTANCE., WALL MOUNTED, NO REFRIGERATION. (2) UNITS TO BE INSTALLED IN A HI-LOW CONFIGURATION, (1) UNIT AT ADA REQUIRED HEIGHT. | | | | |
| BF-1 | BOTTLE FILLER - HOT WATER | 1-1/2" | 1/2" | - | 2" | MURDOCK MBF3-A001 MODIFIED SEMI-RECESSED BOTTLE FILLER, MODIFIED TO ACCOMODATE CHRONOMITE WATER HEATER, EWH-1, DEADBOLT LOCK, 14 GAGE TYPE 304. | | | | |
| EWH-1 | ELECTRIC INSTANT-FLOW WATER HEATER | 1-1/2" | 1/2" | 1/2" | - | CHRONOMITE SLR-15/277, 15 A, 277 V, 4150 W. TO BE FURNISHED WITH BOTTLE FILLER BF-1. | | | | |

1 SEE FLOOR PLAN AND DIAGRAMS FOR SIZES

2. UNLESS NOTED OTHERWISE ON FLOOR PLANS OR DIAGRAMS. 3. REFER TO SECTION 224600 FOR PLUMBING FIXTURE SPECIFICATIONS.

| | | | DIFFUSER, | REGISTE | R & GR | ILLE S | CHEDUL | | | | | |
|----------|---------------|----------------------------|----------------------------------|---------------|-------------------|---------------------|----------------------------|--------|----------------|----------------------|----------|---------|
| MARK NO. | MODULE SIZE | TYPE | MARK & MODEL | OPERATING CFM | NECK SIZE (IN) | MAX S.P. (IN.WG) | NECK MAX VELOCITY (FPM) | MAX NC | | OW 4-WAY 0/50 FPM | MATERIAL | NOTES |
| | | | | RANGE | | | | | MIN | MAX | | |
| CD-10 | 12" x 12" | CEILING MOUNT | TITUS MODULAR CORE, MODEL MCD-AA | 75-200 | 6" x 6" | 0.053 | 800 | 25 | 3.00/3.75/6.00 | 5.25/6.75/9.75 | ALUM | 1, 2, 3 |
| | 8" x 8" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 0-100 | 6"x6" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| MSGS-01 | 12" x 12" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 101-300 | 10"x10" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| | 14" x 14" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 301-400 | 12"x12" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| | 8" x 8" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 0-100 | 6"x6" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| MSGE-01 | 12" x 12" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 101-300 | 10"x10" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| | 14" x 14" | MAXIMUM SECURITY GRILLE | TITUS SG-SD | 301-400 | 12"x12" | 0.08 | 400 | 25 | - | - | STEEL | 4 |
| | | | | RETURN / EX | (HAUST AIR GRILLE | ES | | | | | | |
| R-01 | 12.5" x 12.5" | CEILING MOUNT | TITUS 350 FL | 0-415 | 10" x 10" | 0.053 | 700 | 25 | N/A | N/A | ALUM | - |
| R-02 | 24" x 24" | LAY-IN | TITUS 350 FL | 255-1540 | 20" x 20" | 0.073 | 600 | 23 | N/A | N/A | ALUM | - |
| R-03 | 48" x 24" | LAY-IN | TITUS 350 FL | 550-3300 | 42" x 20" | 0.073 | 600 | 26 | N/A | N/A | ALUM | - |
| E-01 | 12" x 12" | CEILING MOUNT | TITUS AEROBLADE GRILLES-25RL | 55-220 | 8" x 8" | 0.070 | 600 | 23 | N/A | N/A | ALUM | - |
| E-02 | 8" x 8" | CEILING MOUNT | TITUS AEROBLADE GRILLES-25RL | 0-100 | 6" x 6" | 0.006 | 300 | 10 | N/A | N/A | ALUM | - |

CONTRACTOR SHALL COORDINATE MOUNTING BORDER AND FINISH WITH THE CEILING CONSTRUCTION TYPE AND SURFACE COLOR PRIOR TO FURNISHING MATERIAL. PROVIDE MANUAL VOLUME DAMPER IN EACH SUPPLY AND RETURN DUCT BRANCH REGARDLESS IF THE DAMPER IS INDICATED ON DRAWINGS OR NOT. PROVIDE WITH MANUFACTURER'S 3/16" Ø HOLE FACE PLACE

| PIPE SCHEDULE | | | | | | | | | |
|---------------------|--------------|----|----------------|-------------|---|---|-------------|----|--|
| SERVICE | LOCATION | /5 | 7 / PE W. CODY | 10-14 COPER | 100 100 100 100 100 100 100 100 100 100 | P | ETHIN STEEL | _/ | FITTINGS (REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION) |
| WATER | ABOVE GROUND | | 0 | | | | | | LEAD FREE SOLDERED JOINTS AND FITTINGS |
| VV/VIEIX | BELOW GROUND | 0 | | | | | | | LEAD FREE SOLDERED JOINTS AND FITTINGS |
| SOIL, WASTE, | ABOVE FLR | | 0 | | | | | | PROVIDE TYLER 2-BAND NO-HUB COUPLINGS |
| STORM DRAIN | BELOW FLR | | 0 | | | | | | PROVIDE TYLER 4-BAND NO-HUB COUPLINGS |
| VENT | ABOVE FLR | | 0 | | | | | | PROVIDE TYLER 2-BAND NO-HUB COUPLINGS |
| VEINI | BELOW FLR | | О | | | | | | PROVIDE TYLER 2-BAND NO-HUB COUPLINGS |
| CONDENSATE DRAIN | INSIDE | | 0 | | | | | | 95-5 SOLDERED FITTINGS |
| | OUTSIDE | | 0 | | | | | | 95-5 SOLDERED FITTINGS |
| | INSIDE | | | 0 | | | | | SCH. 40 THREADED FITTINGS |
| GAS | OUTSIDE | | | | 0 | | | | SCH. 40 THREADED FITTINGS |
| | BELOW GRADE | | | | | 0 | | | SOLVENT WELD FITTINGS |

PLUMBING NOTATION

PIPE SIZES SHOWN ON THE DRAWINGS CAN BE FOLLOWED BY PIPE SIZING CRITERIA. THIS CRITERIA CAN EITHER BE SQUARE FOOTAGE (FOR STORM DRAIN PIPING), FIXTURE UNIT VALUES (FOR DOMESTIC WATER PIPING, SANITARY WASTE PIPING, AND SANITARY VENT PIPING) OR IN THOUSAND'S OF BTUH - MBH (FOR NATURAL GAS PIPING). THE FOLLOWING LEGEND WILL AID IN UNDERSTANDING THE FOR EXAMPLE: THIS IS A 12" STORM DRAIN PIPE CARRYING 32,000 SQUARE FEET OF ROOF AREA.

THIS IS A 3" COLD WATER PIPE CARRYING 200 COLD WATER FIXTURE UNITS. 2" HW (50 HFU): THIS IS A 2" HOT WATER PIPE CARRYING 50 HOT WATER FIXTURE UNITS.

THIS IS A 1" HOT WATER RECIRCULATING PIPE CARRYING 5.0 GALLONS PER MINUTE FLOW

THIS IS A 4" SANITARY WASTE PIPE CARRYING 150 WASTE FIXTURE UNITS. 4" W (150 WFU):

THIS IS A 2" SANITARY VENT PIPE CARRYING 20 VENT FIXTURE UNITS.

1-1/4" G (600 CFH): THIS IS A 1-1/4" NATURAL GAS PIPE CARRYING 600,000 CFH.

MECHANICAL SHEET INDEX

MECHANICAL & PLUMBING SYMBOLS, ABBREVIATIONS & SCHEDULE MECHANICAL SITE PLAN MECHANICAL & PLUMBING DEMO & FLOOR PLAN - CENTRAL CORE MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 1 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 6 MP1-7.1A MECHANICAL & PLUMBING DEMO & FLOOR PLAN- HOUSING UNIT 7 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 8 MP1-8.1B MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 9 MP1-21.1B MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 21 MP1-22.1A MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 22 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 23 MP1-23.2 MP1-24.2 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 24 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 25 MP1-25.1C MP1-33.1A MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 33 MP1-34.1B MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 34 MECHANICAL & PLUMBING DEMO & FLOOR PLAN - HOUSING UNIT 35 MECHANICAL & PLUMBING ENLARGED PLANS MP2.1

MECHANICAL & PLUMBING ENLARGED PLANS

MECHANICAL & PLUMBING ENLARGED PLANS

MECHANICAL & PLUMBING DETAILS

MECHANICAL & PLUMBING DETAILS

GENERAL NOTES

DRAWINGS AND SPECIFICATIONS: THE MECHANICAL DRAWINGS INDICATE THE GENERAL DESIGN AND ARRANGEMENT OF PIPES, EQUIPMENT, SYSTEMS, ETC. INFORMATION SHOWN IS DIAGRAMMATIC IN CHARACTER AND DOES NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING, ETC. DO NOT SCALE DRAWINGS. REFER TO ARCHITECTURAL DRAWINGS AND FOUIPMENT TO BE FURNISHED FOR DIMENSIONS MEASUREMENTS FOUIPMENT LOCATIONS LEVELS FTC. REFER TO DIV 21,22 OR 23 SPECIFICATIONS (OR SPECIFICATIONS ON DRAWINGS).

CONFER AND COORDINATE WITH OTHER TRADES AND THEIR WORK. COORDINATE CEILING CAVITY SPACE CAREFULLY WITH OTHER TRADES. BRING ANY CONFLICTS TO

BASE FINAL INSTALLATION OF MATERIALS AND EQUIPMENT ON ACTUAL DIMENSIONS AND CONDITIONS AT THE PROJECT SITE. FIELD MEASURE FOR MATERIALS OR EQUIPMENT REQUIRING EXACT FIT

THE CONTRACTORS SHALL PROVIDE THE GENERAL CONTRACTOR WITH THE EXACT LOCATIONS AND SIZES OF ACCESS DOORS, WALL OPENINGS, CONCRETE SLEEVES OR ANY OTHER CONSTRUCTION REQUIREMENTS NEEDED TO ACCOMMODATE THE MECHANICAL EQUIPMENT. LOCATIONS OF THESE OPENINGS SHALL BE SUBMITTED IN SUFFICIENT TIME TO BE INSTALLED IN THE NORMAL COURSE OF WORK. MECHANICAL CONTRACTOR IS RESPONSIBLE FOR LOCATING CONCRETE SLEEVES IN INTERIOR GRADE BEAMS FOR ALL PIPING HUNG IN CRAWL SPACE

ALL DIMENSIONS SHOWN ON THE DRAWINGS FOR DUCTWORK ARE INSIDE CLEAR DIMENSIONS. SEE SPECIFICATIONS FOR INSULATION OR LINER REQUIRED FOR DUCT SYSTEMS. VERIFY THAT THE DUCTWORK SPECIFIED WILL FIT IN THE CEILING SPACE AVAILABLE USING THE ARCHITECTURAL, STRUCTURAL AND ELECTRICAL DRAWINGS AS REFERENCE PRIOR TO FABRICATION AND INSTALLATION.

THE MECHANICAL DESIGN AND COORDINATION WITH OTHER TRADES SUCH AS, BUT NOT LIMITED TO, ARCHITECTURAL, ELECTRICAL AND STRUCTURAL, IS BASED ON THE CHARACTERISTICS OF EQUIPMENT MANUFACTURED BY THOSE COMPANIES SPECIFICALLY LISTED IN THE SCHEDULES AND ON THE DRAWINGS. ANY AND ALL COSTS ASSOCIATED WITH CHANGES DUE TO THE USE OF OTHER MANUFACTURES EQUIPMENT, INCLUDING MANUFACTURERS LISTED IN THE APPROVED MANUFACTURERS LIST IN THE SPECIFICATIONS, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THESE CHANGES SHALL INCLUDE, BUT NOT BE LIMITED TO, AMPERAGE AND VOLTAGE CHANGES, ACCESS SPACE REQUIREMENTS, PIPING CHANGES, STRUCTURAL MODIFICATIONS, AND SPACE REQUIRED FOR PLACEMENT OF EQUIPMENT. ALL BRANCH DUCTWORK TO DIFFUSERS, REGISTERS, AND GRILLES SHALL BE THE SAME SIZE AS THE DIFFUSER NECK UNLESS NOTED OTHERWISE.

ALL DUCTWORK AND PIPING SHALL BE RESTRAINED AS SHOWN ON THE DRAWINGS OR PER SMACNA SEISMIC RESTRAINT MANUAL, LATEST EDITION AND PER LOCAL CODES. A COPY OF THE SMACNA SEISMIC RESTRAINT MANUAL AND LOCAL CODES SHALL BE KEPT AT THE PROJECT SITE DURING CONSTRUCTION FOR REFERENCE

UNLESS SPECIFICALLY SHOWN ON THE DRAWINGS NO STRUCTURAL MEMBER MAY BE CUT. DRILLED OR NOTCHED WITHOUT PRIOR WRITTEN AUTHORIZATION FROM THE THE ARCHITECT. NO DUCT PENETRATIONS SHALL BE MADE IN NEW OR EXISTING BEARING OR SHEAR WALLS UNLESS SPECIFICALLY SHOWN ON DRAWINGS AND COORDINATED WITH STRUCTURAL ENGINEER AND ARCHITECT.

MANUAL VOLUME DAMPERS SHALL BE INSTALLED ON ALL SUPPLY AND EXHAUST AIR BRANCH DUCTS REGARDLESS IF THEY ARE SHOWN ON THE DRAWING OR NOT. DAMPER SHALL BE INSTALLED IN AN ACCESSIBLE LOCATION UNLESS EXISTING TO REMAIN. AND AS CLOSE TO BRANCH TAKEOFF AS POSSIBLE

THE MECHANICAL CONTRACTOR SHALL PROVIDE FIELD SHOP DRAWINGS FOR ARCHITECT/ENGINEER REVIEW PRIOR TO FABRICATION AND INSTALLATION. SHOP DRAWINGS SHALL BE PREPARED TO INDUSTRY STANDARD, SHOWING ELEVATION HEIGHTS OF ALL NEW AND EXISTING EQUIPMENT. ALL SHOP DRAWINGS SHALL BE COORDINATED WITH ALL OTHER TRADES. ROUTING AND AND STRUCTURAL CONFLICTS SHALL BE RESOLVED PRIOR TO SUBMISSION

. THE CONTRACTOR SHALL CONDUCT PRETEST OF ALL AIR DISTRIBUTION DEVISES INVOLVES IN REMODELING.

GENERAL PLUMBING NOTES

PLUMBING PLANS INDICATE THE GENERAL DESIGN AND ARRANGEMENT OF PIPES, DUCTWORK, EQUIPMENT, SYSTEMS, ETC. DO NOT SCALE DRAWINGS. INFORMATION SHOWN IS DIAGRAMMATIC IN CHARACTER AND DOES NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING AND EXISTING CONDITION. LOCATION OF THESE ITEMS MAY BE ADJUSTED CONDITIONAL UPON THE SATISFACTORY COMPLIANCE WITH ALL OTHER REQUIREMENTS THE PLUMBING DESIGN AND COORDINATION WITH OTHER TRADES SUCH AS, BUT NOT LIMITED TO, ARCHITECTURAL, ELECTRICAL AND STRUCTURAL, IS BASED ON THE CHARACTERISTICS OF EQUIPMENT MANUFACTURED BY THOSE COMPANIES SPECIFICALLY LISTED IN THE SCHEDULES AND ON THE DRAWINGS. ANY AND ALL COSTS ASSOCIATED WITH CHANGES DUE TO THE USE OF OTHER MANUFACTURES EQUIPMENT, INCLUDING MANUFACTURERS LISTED IN THE APPROVED MANUFACTURERS

LIST IN THE SPECIFICATIONS, SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THESE CHANGES SHALL INCLUDE, BUT NOT BE LIMITED TO, AMPERAGE AND

ALL ASPECTS OF THE WORK AND ITEMS NOT SPECIFICALLY MENTIONED, BUT WHICH ARE NECESSARY TO MAKE A COMPLETE WORKING INSTALLATION, SHALL BE

INCLUDED, AND INDICATED IN THE CONTRACTORS BID. PLUMBING CONTRACTOR SHALL LOCATE ALL EQUIPMENT WHICH MUST BE SERVICED, OPERATED, OR MAINTAINED IN FULLY ACCESSIBLE POSITIONS. EQUIPMENT SHALL INCLUDE (BUT NOT BE LIMITED TO) VALVES, SHOCK ABSORBERS, TRAPS, CLEANOUTS, MOTORS, CONTROLLERS, SWITCH GEAR, AND DRAIN POINTS, MINOR DEVIATIONS FROM DRAWINGS MAY BE ALLOWED TO PROVIDE FOR BETTER ACCESSIBILITY. ANY CHANGES SHALL BE APPROVED BY THE ARCHITECT/ENGINEER PRIOR

THIS WORK SHALL BE REPAIRED OR REPLACED AT THE CONTRACTORS EXPENSE. THE GENERAL CONTRACTOR AND ALL SUBCONTRACTORS ARE RESPONSIBLE FOR PROPER REMOVAL AND DISPOSAL OF ALL DEBRIS GENERATED BY CONSTRUCTION

PLUMBING CONTRACTOR SHALL PROVIDE THE GENERAL CONTRACTOR WITH THE EXACT LOCATIONS AND SIZES OF ACCESS DOORS, WALL OPENINGS, ROOF OPENINGS, CONCRETE SLEEVES OR ANY OTHER CONSTRUCTION REQUIREMENTS NEEDED TO ACCOMMODATE THE PLUMBING EQUIPMENT. LOCATIONS OF THESE OPENINGS SHALL BE SUBMITTED IN SUFFICIENT TIME TO BE INSTALLED IN THE NORMAL COURSE OF WORK.

BE DONE PRIOR TO POURING OF GRADE BEAMS. I. PLUMBING CONTRACTOR SHALL COORDINATE ALL PLUMBING CHASE SIZES WITH GENERAL CONTRACTOR. 2. THE PLUMBING CONTRACTOR SHALL COORDINATE CUT-OUTS FOR CASEWORK, MILLWORK, OR OTHER EQUIPMENT AS REQUIRED WITH THE GENERAL CONTRACTOR.

14. FLOOR SPOT ELEVATIONS ARE SHOWN THUS: 0'-0". ARCHITECTURAL FINISH FLOOR ELEVATIONS 0'-0" EQUALS ACTUAL SITE REFERENCE OF FINISH FLOOR. NO ASBESTOS OR PCB CONTAINING MATERIALS SHALL BE USED ON THIS PROJECT.

19. ALL WALL PENETRATIONS AT RATED WALL LOCATIONS REQUIRED FOR PIPES, CONDUIT, DUCTWORK, ETC. SHALL BE SEALED TO STOP PASSAGE OF FIRE AND / OR SMOKE WITH FIRE SAFING AND APPROVED FIRESTOPPING SEALANT AS DETAILED BY INSTALLED MANUFACTURERS RECOMMENDATIONS BY THE GENERAL

SMOKE-DEVELOPED INDEX OF NOT MORE THAN 50.

EQUIPMENT REQUIRING EXACT FIT. 24. ALL DIMENSIONS SHOWN ON THE DRAWINGS FOR DUCTWORK ARE INSIDE CLEAR DIMENSIONS. SEE SPECIFICATIONS FOR INSULATION OR LINER REQUIRED FOR DUCT

SPACES IN ALL CASES UNLESS SPECIFICALLY NOTED OTHERWISE ON THE DRAWINGS. EXPOSED ITEMS MUST BE LOCATED IN AREAS APPROVED BY THE ARCHITECT AND ENGINEER. EXPOSED ITEMS SHALL BE INSTALLED AND FINISHED TO PROVIDE MINIMAL VISUAL IMPACT. ALL EXPOSED ITEMS ARE TO BE PAINTED TO MATCH THE

WHERE CEILING SPACE IS USED AS A RETURN AIR PLENUM. FOLLOW ALL APPLICABLE CODES AS TO MATERIALS ALLOWED FOR USE IN AIR PLENUMS. COORDINATE WITH THE GENERAL CONTRACTOR TO PROVIDE FREE RETURN OF AIR FROM ALL LOCATIONS.

REFERENCE ARCHITECTURAL DRAWINGS FOR LOCATION OF FULL HEIGHT WALLS INCLUDING SECURITY AND FIRE SEPARATION WALLS. PROVIDE THE GENERAL CONTRACTOR WITH LOCATIONS AND DIMENSIONS OF ALL REQUIRED RETURN AIR OPENINGS. PROVIDE FIRE/SMOKE DAMPERS, FIRE DAMPERS & SMOKE DAMPERS AS REQUIRED BY TYPE OF CONSTRUCTION. RETURN AIR VELOCITY THROUGH OPENINGS SHALL NOT EXCEED 750 FEET PER MINUTE.

33. SLOPE ALL STORM DRAIN PIPING 4" AND LARGER @ 1/8" PER MINIMUM. SLOPE ALL STORM DRAIN PIPING 3" AND SMALLER @ 1/4" PER FOOT MINIMUM. 34. SLOPE ALL SOIL PIPING 4" AND LARGER @ 1/8" PER MINIMUM. SLOPE ALL SOIL PIPING 3" AND SMALLER @ 1/4" PER FOOT MINIMUM.

FOR TYPES AND SIZES REQUIRED. OTHERWISE, PROVIDE ISOLATION AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER. 7. PLUMBING AND PLUMBING EQUIPMENT, PIPING, OR ACCESSORIES THAT DO NOT SERVE ELECTRICAL EQUIPMENT ROOMS MAY NOT ENTER OR PASS THROUGH THE

BRING ANY CONFLICTS TO THE ATTENTION OF THE ARCHITECT/ENGINEER

OF THIS PROJECT. THE REMOVAL AND DISPOSAL OF ALL CONSTRUCTION DEBRIS SHALL BE IN FULL COMPLIANCE WITH ALL FEDERAL, STATE AND LOCAL REGULATIONS.

10. PLUMBING CONTRACTOR IS RESPONSIBLE FOR LOCATING CONCRETE SLEEVES IN INTERIOR GRADE BEAMS FOR ALL PIPING HUNG IN CRAWL SPACE. THIS WORK SHALL

3. PLUMBING CONTRACTOR SHALL COORDINATE SIZES AND LOCATIONS OF CONCRETE HOUSEKEEPING PADS WITH THE PLUMBING EQUIPMENT SUPPLIERS AND

SEE CODE PLAN SHEETS FOR LOCATIONS OF RATED WALLS WHERE APPLICABLE. 17. COORDINATE THE LOCATION OF FIRE RATED & SMOKE AND RATED WALLS PRIOR TO ORDER AND INSTALLATION OF DAMPERS.

23. BASE FINAL INSTALLATION OF MATERIALS AND EQUIPMENT ON ACTUAL DIMENSIONS AND CONDITIONS AT THE PROJECT SITE. FIELD MEASURE FOR MATERIALS OR

SYSTEMS. VERIFY THAT THE DUCTWORK SPECIFIED WILL FIT IN THE CEILING SPACE AVAILABLE USING THE ARCHITECTURAL, STRUCTURAL AND ELECTRICAL DRAWINGS AS REFERENCE PRIOR TO FABRICATION AND INSTALLATION. 25. ALL PLUMBING AND PLUMBING SYSTEMS SHALL BE CONCEALED WITHIN WALLS, UNDERGROUND, ABOVE CEILINGS OR IN ARCHITECT AND ENGINEER APPROVED UTILITY

ADJACENT SURFACES UNLESS SCHEDULED FOR AN ACCENT COLOR. 26. CONFER AND COOPERATE WITH OTHER TRADES AND COORDINATE THE WORK WITH THEIRS. COORDINATE CEILING CAVITY SPACE CAREFULLY WITH OTHER TRADES.

28. PLUMBING CONTRACTOR IS TO PROVIDE AS INDICATED OR REQUIRED ADEQUATE RETURN AIR OUT OF ALL SPACES BACK TO THE APPROPRIATE AIR HANDLING UNIT.

35. OFFSET SOIL & ROOF DRAINAGE PIPING BELOW FLOOR SLAB TO AVOID FOOTING PENETRATIONS WHERE IMPOSSIBLE TO AVOID FOOTINGS SLEEVE PIPE PENETRATIONS

SPACE. REFERENCE NATIONAL ELECTRICAL CODE PROVISIONS FOR CONSTRUCTION OF ELECTRICAL ROOMS.

VOLTAGE CHANGES, ACCESS SPACE REQUIREMENTS, PIPING CHANGES, STRUCTURAL MODIFICATIONS, AND SPACE REQUIRED FOR PLACEMENT OF EQUIPMENT. REFERENCE DIVISION 21, 22 & 23 SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

CONTRACTORS SHALL PROTECT NEW CONSTRUCTION FROM DAMAGE BY ALL TRADES. ALL SUCH DAMAGE CAUSED BY THE CONTRACTOR DURING THE COURSE OF

THE PREMISES SHALL BE KEPT CLEAN AND FREE FROM ALL WASTE MATERIALS.

18. WALL OPENINGS FOR FIRE DAMPERS SHALL BE FRAMED AS REQUIRED BY THE FIRE DAMPER MANUFACTURER'S RECOMMENDATIONS. COORDINATE WITH GENERAL

CONTRACTOR. THE PLUMBING CONTRACTOR SHALL COORDINATE WITH THE GENERAL CONTRACTOR ALL WALL PENETRATIONS FOR CORRECT SIZES.

20. ALL MATERIALS PLACED IN PLENUMS SHALL COMPLY WITH IMC 602.2.1 TO BE NON-COMBUSTIBLE OR HAVE A FLAME SPREAD INDEX OF NOT MORE THAN 25 AND A REFER TO ARCHITECTURAL DRAWINGS AND EQUIPMENT TO BE FURNISHED FOR DIMENSIONS; MEASUREMENTS, EQUIPMENT LOCATIONS, LEVELS, ETC. ALL CONTRACTOR'S ARE RESPONSIBLE FOR FIELD VERIFICATION OF ALL DIMENSIONS AND FIELD CONDITIONS PRIOR TO ORDERING OR INSTALLING MATERIALS OR

). REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LOCATION OF DIFFUSERS AND GRILLES. 30. PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL 2" X 10" CONTINUOUS WOOD BLOCKING IN STUD PARTITIONS FOR ANCHORAGE OF WALL ATTACHED ITEMS, INCLUDING BUT NOT LIMITED TO, WALL MOUNTED FIXTURES. CONTRACTOR SHALL PROVIDE FOR EXPANSION OF PIPING. USE EXPANSION LOOPS, ANCHORS, GUIDES, EXPANSION JOINTS, ETC. AS INDICATED OR REQUIRED

32. ALL CONDENSATE DRAIN PIPES ARE TO BE INSULATED TYPE "M" COPPER PIPE WITH WROUGHT COPPER FITTINGS. SLOPE CONDENSATE DRAINS PIPES AT 1/8" PER

PER STRUCTURAL DRAWINGS AND SPECIFICATIONS. 36. PROVIDE VIBRATION ISOLATORS FOR MOTOR DRIVEN PLUMBING EQUIPMENT UNLESS SPECIFICALLY NOTED OTHERWISE. SEE SCHEDULES AND/OR SPECIFICATIONS

38. PLUMBING AND PLUMBING EQUIPMENT, PIPING, OR ACCESSORIES THAT DO NOT SERVE ELECTRONICS EQUIPMENT ROOMS ARE TO AVOID ENTERING OR PASSING

CO = CLEAN OUT **VALVES AND FITTINGS**

PLUMBING

_____NG_____ GAS

ABBREVIATIONS

EWC = ELECTRIC WATER COOLER

WC = WATER CLOSET

UR = URINAL L = LAVATORY

C = COMBY UNIT

CS = COUNTER SINK

FD = FLOOR DRIAN

T.P. = TRAP PRIMER

WCO = WALL CLEAN OUT

 \rightarrow

--0--

-

MS = MOP SINK

SH = SHOWER

CD CONDENSATE DRAIN

— CW — DOMESTIC COLD WATER

——————— DOMESTIC COLD WATER

——— 110 HW ——— 110°F DOMESTIC HOT WATER

——— 140 HW ———— 140°F DOMESTIC HOT WATER

DOMESTIC HOT WATER (GENERIC)

——— 110 HWR ——— 110°F DOMESTIC HOT WATER RECIRULATING

——— 140 HWR ——— 140°F DOMESTIC HOT WATER RECIRCULATING

DOMESTIC HOT WATER RECIRC (GENERIC)

___ EXPANSION LOOP WALL CLEAN OUT ———— BALANCING VALVE FLOOR CLEAN OUT ─────── WITH METERING POINTS (DOUBLE CLEAN OUT —⊣б⊢— BALL VALVE FLOOR DRAIN / FLOOR SINK BUTTERFLY VALVE

EXPANSION JOINT

PIPE CAP

PIPE DOWN

UNION

PIPE TEE, UP

PIPE TEE, DOWN

ROOF DRAIN / OVERFLOW ROOF DRAIN VALVE (GENERIC) DOWNSPOUT NOZZLE ____ WALL HYDRANT ____ HOSE BIB ____× ALIGNMENT GUIDE =PIPE ANCHOR \longrightarrow

FS = FLOOR SINK

HB = HOSF BIB

AD = ARFA DRAIN

FCO = FLOOR CLEAN OUT

VTR = VENT THRU ROOF

CFH = CUBIC FEET HOUR

I.F. = INVERT FLEVATION

ORD = OVERFLOW ROOD DRAIN

RD = ROOF DRAIN

2WGCO = 2-WAY GRADE CLEANOUT

EEWS = EMERGENCY EYEWASH SHOWER

PLUMBING LEGEND & ABBREVIATIONS

SD STORM DRAIN ABOVE FLOOR

— SD — STORM DRAIN BELOW FLOOR

OSD OVERFLOW STORM DRAIN ABOVE FLOOR

— OSD— OVERFLOW STORM DRAIN ABOVE FLOOR

SANITARY WASTE ABOVE FLOOR

— W — SANITARY WASTE BELOW FLOOR

— GW— GREASE WASTE BELOW FLOOR

BALANCING VALVE/FLOW CONTROL VALVE

PRESSURE GAUGE

______ AUTOMATIC CONTROL VALVE 2-WAY

_____|;| ____ AUTOMATIC FLOW CONTROL VALVE

RELIEF VALVE

───── FLOW MEASURING DEVICE

OS&Y VALVE (INDICATING)

—— EA —— EXHAUST AIR DUCT- SINGLE LINE

OA OUTSIDE AIR DUCT- SINGLE LINE

EXISTING DUCTWORK TO REMAIN

SINGLE LINE REDUCER

──✓✓✓✓✓ SINGLE LINE FLEX DUCT

← U.C. DOOR UNDER-CUT

> 24x12 (E) >

RATED WALL

AUTOMATIC CONTROL VALVE 3-WAY

-POINT REDUCED PRESSURE ZONE BACKFLOW PREVENTER

SOLENOID VALVE

ANGLE VALVE

---- VBF ---- VENT BELOW FLOOR

____CHECK VALVE _____ CONCENTRIC REDUCER ____ ECCENTRIC REDUCER ___⊗____ STEAM TRAP ____ FLEXIBLE CONNECTION _____ FLOW DIRECTION _____GATE VALVE GLOBE VALVE MANUAL AIR VENT ______ AUTOMATIC AIR VENT ——I
→—— PLUG VALVE

DIRECTION OF PIPE PITCH NEW TO EXISTING CONNECTION POINT PRESSURE AND TEMPURATURE TEST PORT

PRESSURE REGULATING VALVE (GAS SYSTEMS) FIRE PROTECTION

THERMOMETER


PUMP (GENERIC)

PRESSURE REDUCING VALVE (WATER SYSTEMS)

SPRINKLER HEAD, PENDANT

_____ F _____ FIRE PROTETION WATER SUPPLY ____Ø____ SPRINKLER HEAD, UPRIGHT ———— SM —————— SPRINKLER MAIN ______ SPRINKLER HEAD, SIDE WALL ALARM VALVE, WET FLOW SWITCH ALARM VALVE, DRY PRESSURE SWITCH FIRE PROTECTION RISER OS&Y VALVE FIRE DEPARTMENT CONNECTION

MECHANICAL SYMBOLS

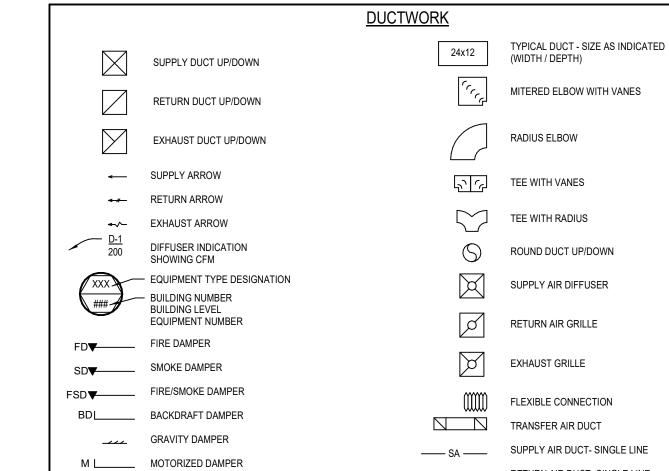

N.I.C. NOT IN CONTRACT

POINT OF CONNECTION POINT OF DISCONNECT

OPPOSED DAMPER

PARALLEL DAMPER

DETAIL NUMBER

SHEET NUMBER

24x12 \$ NEW DUCTWORK

(PER CBC SECTION 1018.1) --- 1-FB --- 1 HOUR RATED FIRE BARRIER

---2-FB--- 2 HOUR RATED FIRE BARRIER

DESIGN CRITERIA EXISTING DUCTWORK TO BE DEMOLISHED


| PROJECT LOCATION | PLEASANTON, CA |
|---|----------------|
| CALIFORNIA CLIMATE ZONE | 12 |
| PROJECT ALTITUDE (FT. ABOVE SEA LEVEL) | 350 |
| | |
| SUMMER DESIGN DRY-BULB TEMPERATURE (°F) | 94 |
| SUMMER DESIGN WET-BULB TEMPERATURE (°F) | 67 |
| WINTER DESIGN DRY BULB TEMPERATURE (°F) | 24 |







MP2.2





MONITOR REVIEWED FOR ACCESS COMPLIANCE PER SETTLEMENT AGREEMENT

HIBSER YAMAUCHI Architects, Inc.


DATE: 4/16/2018




MS1.1 SCALE: 1" = 80'-0"



DEMO. PLUMBING I MECHANICAL ALAMEDA C







DEMO & RITA J





AREA OF WORK - CELLS AND DORM BEDS

DEMO RITA



DEMO RITA






DEMO & RITA J MECHANICAL ALAMEDA C



31 32 33 34

AREA OF WORK - CELLS AND DORM BEDS

DEMO & RITA J MECHANICAL ALAMEDA C

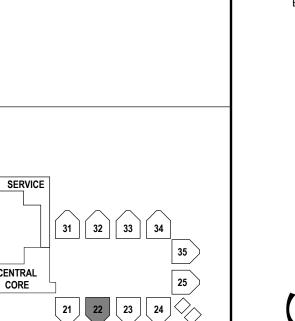



DEMO & RITA J

MECHANICAL ALAMEDA C



31 32 33 34

DEMO & RITA J


PLUMBING

31 32 33 34

LEGEND NOTES ARE COMMON TO ALL SOME NOTES MAY NOT APPLY TO THIS SHEET

AREA OF WORK - CELLS AND DORM BEDS

75-17108-00 MAY 01, 2018 Revisions





31 32 33 34

DEMO RITA

AREA OF WORK - CELLS AND DORM BEDS

75-17108-00 MAY 01, 2018 Revisions

DEMO RITA

PLUMBING |

MECHANICAL ALAMEDA C

DEMO & RITA J



LEGEND NOTES ARE COMMON TO ALL SOME NOTES MAY NOT APPLY TO THIS SHEET

AREA OF WORK - CELLS AND DORM BEDS





31 32 33 34

21 22 23 24

LEGEND NOTES

DEMO NOTES - PLUMBING

- EXISTING FIXTURE TO BE REMOVED INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE). WASTE, VENT AND WATER PIPING
- TO BE REMOVED BACK TO MAIN AS CLOSE AS POSSIBLE AND
- EXISTING FIXTURE TO BE REMOVED. WASTE, VENT AND WATER PIPING, INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE) SEE REMODEL NOTES FOR NEW INSTALLATION. (3) EXISTING FLOOR DRAIN TO REMAIN.
- 4 EXISTING FLOOR DRAIN TO BE REMOVED, INCLUDING ASSOCIATED TRAP PRIMER. REMOVE PIPE CLOSE TO MAIN AS
- DRAIN LOCATION. 5 EXISTING SHOWER ASSEMBLY TO BE REMOVED AND RELOCATED.
- 6 EXISTING SHOWER ASSEMBLY TO BE DEMOLISHED. SALVAGE SHOWER COMPONENTS TO OWNER.

POSSIBLE AND CAP UNLESS SAME PIPE WILL BE USED TO NEW

7 CUT AND CAP EXISTING HOT WATER PIPING IN CHASE.

REMODEL NOTES - PLUMBING

- DFCONNECT WASTE, VENT AND WATER PIPING INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE) STRAIGHT DOWN TO FLOOR TO
- CONNECT <u>C-1</u>, <u>C-2</u> & <u>C-3</u> TO NEW DOMESTIC WATER, IN CHASE. WASTE PIPING IS TO CONNECT STRAIGHT DOWN TO EXISTING PIPING. VERIFY THE SIZE OF THE EXISTING WASTE LINE IS 3"Ø MINIMUM, UPSIZE TO 3"Ø IF NECESSARY. VENT PIPING TO RUN BACK UP IN CHASE OR SHROUD.PROVIDE NEW ACTUATORS IF NECESSARY WITH WATER HAMMER ARRESTERS AND SHUT OFF VALVES. WHERE SHROUD IS EXTENDED INTO THE CORRIDOR, CONCEAL FLUSHOMETER VALVES IN THE SHROUD.
- 3 CONNECT <u>DF-1</u>, BF-1, <u>SL-1</u> & <u>L-1</u> TO DOMESTIC WATER, SEWER AND VENT IN CHASE.
- 4 EXISTING RELOCATED OR NEW SHOWER ASSEMBLY, RECONNECT WATER PIPING (HOT & COLD) BEHIND WALL.
- 5 RECONNECT NEW <u>FD-1</u> TO EXISTING WASTE AND VENT PIPING.
- 6 EXISTING FLOOR DRAIN TO REMAIN.
- EXTEND CW, HW TO FIXTURE IN CHASE.
 CONNECT (N) WASTE TO (E) WASTE PIPE BELOW
 AND (N) VENT TO (E) VENT IN CHASE.
- 8 HOT WATER BOTTLE FILLER <u>BF-1</u> WITH <u>EWH-1</u>.

DEMO NOTES - MECHANICAL


- 2 DEMO EXISTING EXHAUST WALL GRILLE WITH ASSOCIATED DUCTWORK.
- $\langle 3 \rangle$ DEMO EXISTING DUCTWORK TO POINT OF DISCONNECTION.
- 5 DEMO EXISTING EXHAUST GRILLE.
- 6 EXISTING GRILLE TO REMAIN.
- 7 CONTRACTOR TO PRE READ EXISTING AIR FLOW IN THE AREA OF WORK PRIOR TO DEMOLISION.
- 8 DEMO EXISTING DUCTWORK TO ABOVE SLAB.

REMODEL NOTES - MECHANICAL

- PROVIDE NEW MSGS ON WALL. NEW MSGS SIZE AND HEIGHT TO MATCH EXISTING.
- PROVIDE NEW MSGE ON WALL. NEW MSGE SIZE AND HEIGHT TO MATCH EXISTING.
- 3 CONNECT NEW DUCTWORK TO EXISTING AT POINT OF CONNECTION. NEW DUCTWORK SIZE TO MATCH EXISTING.
- 4 PROVIDE NEW CEILING DIFFUSER.
- 5 PROVIDE NEW EXHAUST GRILLE. > PROVIDE NEW MSGS ON METAL PANEL WALL.
- NEW MSG SIZE TO MATCH EXISTING. PROVIDE NEW MSGE ON METAL PANEL WALL.
- NEW MSG SIZE TO MATCH EXISTING. (8) PROVIDE NEW MSGS ON CEILING.
- PROVIDE NEW MSGE ON CEILING.
- BALANCE AIR FLOW TO PRE READ EXISTING CFM IN THE AREA OF WORK. CONNECT NEW DUCTWORK TO EXISTING ABOVE
- SLAB AT THE POINT OF CONNECTION. NEW DUCT SIZE TO MATCH EXISTING.



DATE: 4/16/2018





LEGEND NOTES

DEMO NOTES - PLUMBING

- EXISTING FIXTURE TO BE REMOVED INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE). WASTE, VENT AND WATER PIPING
- TO BE REMOVED BACK TO MAIN AS CLOSE AS POSSIBLE AND
- 2 EXISTING FIXTURE TO BE REMOVED. WASTE, VENT AND WATER PIPING, INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE) SEE REMODEL NOTES FOR NEW INSTALLATION.
- (3) EXISTING FLOOR DRAIN TO REMAIN.
- EXISTING FLOOR DRAIN TO BE REMOVED, INCLUDING ASSOCIATED TRAP PRIMER. REMOVE PIPE CLOSE TO MAIN AS POSSIBLE AND CAP UNLESS SAME PIPE WILL BE USED TO NEW
- DRAIN LOCATION. 5 EXISTING SHOWER ASSEMBLY TO BE REMOVED AND RELOCATED.
- 6 EXISTING SHOWER ASSEMBLY TO BE DEMOLISHED. SALVAGE SHOWER COMPONENTS TO OWNER.
- 7 CUT AND CAP EXISTING HOT WATER PIPING IN CHASE.


- DFCONNECT WASTE, VENT AND WATER PIPING INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE) STRAIGHT DOWN TO FLOOR TO
- 2 CONNECT <u>C-1</u>, <u>C-2</u> & <u>C-3</u> TO NEW DOMESTIC WATER, IN CHASE. WASTE PIPING IS TO CONNECT STRAIGHT DOWN TO EXISTING PIPING. VERIFY THE SIZE OF THE EXISTING WASTE LINE IS 3"Ø MINIMUM, UPSIZE TO 3"Ø IF NECESSARY. VENT PIPING TO RUN BACK UP IN CHASE OR SHROUD.PROVIDE NEW ACTUATORS IF NECESSARY WITH WATER HAMMER ARRESTERS AND SHUT OFF VALVES. WHERE SHROUD IS
- FLUSHOMETER VALVES IN THE SHROUD. CONNECT <u>DF-1</u>, BF-1, <u>SL-1</u> & <u>L-1</u> TO DOMESTIC WATER, SEWER AND VENT IN CHASE.
- 4 EXISTING RELOCATED OR NEW SHOWER ASSEMBLY, RECONNECT WATER PIPING (HOT & COLD) BEHIND WALL.
- RECONNECT NEW <u>FD-1</u> TO EXISTING WASTE AND VENT PIPING.
- 6 EXISTING FLOOR DRAIN TO REMAIN.
- 7 EXTEND CW, HW TO FIXTURE IN CHASE. CONNECT (N) WASTE TO (E) WASTE PIPE BELOW AND (N) VENT TO (E) VENT IN CHASE.
- 8 HOT WATER BOTTLE FILLER <u>BF-1</u> WITH <u>EWH-1</u>.

DEMO NOTES - MECHANICAL

- DEMO EXISTING SUPPLY WALL GRILLE WITH ASSOCIATED DUCTWORK.
- 2 DEMO EXISTING EXHAUST WALL GRILLE WITH ASSOCIATED
- \langle 3 \rangle DEMO EXISTING DUCTWORK TO POINT OF DISCONNECTION.
- 5 DEMO EXISTING EXHAUST GRILLE.
- $\langle 6 \rangle$ EXISTING GRILLE TO REMAIN.
- CONTRACTOR TO PRE READ EXISTING AIR FLOW IN THE AREA OF WORK BEFORE DEMOLISION.
- $\overline{\langle 8 \rangle}$ DEMO EXISTING DUCTWORK TO ABOVE SLAB.

REMODEL NOTES


- PROVIDE NEW MSGS ON WALL. NEW MSGS SIZE AND HEIGHT TO MATCH EXISTING.
- 2 PROVIDE NEW MSGE ON WALL. NEW MSGE SIZE AND HEIGHT TO MATCH EXISTING.
- (3) CONNECT NEW DUCTWORK TO EXISTING AT POINT OF CONNECTION. NEW DUCTWORK SIZE TO MATCH
- 4 PROVIDE NEW CEILING DIFFUSER.
- (5) PROVIDE NEW EXHAUST GRILLE.
- MSG SIZE TO MATCH EXISTING. > PROVIDE NEW MSGE ON METAL PANEL WALL. NEW
- MSG SIZE TO MATCH EXISTING.
- 8 PROVIDE NEW MSGS ON CEILING. PROVIDE NEW MSGE ON CEILING.
- (10) BALANCE AIR FLOW TO PRE READ EXISTING CFM IN THE AREA OF WORK.
- (11) CONNECT NEW DUCTWORK TO EXISTING ABOVE SLAB AT THE POINT OF CONNECTION. NEW DUCT
- SIZE TO MATCH EXISTING.
- (12) REBALANCE (E) GRILLE TO CFM INDICATED.





MONITOR REVIEWED FOR ACCESS COMPLIANCE PER SETTLEMENT AGREEMENT DATE: 4/16/2018





DEMO NOTES - PLUMBING

LEGEND NOTES

6 EXISTING SHOWER ASSEMBLY TO BE DEMOLISHED. SALVAGE SHOWER COMPONENTS TO OWNER.

(7) CUT AND CAP EXISTING HOT WATER PIPING IN CHASE.

REMODEL NOTES - PLUMBING


- DFCONNECT WASTE, VENT AND WATER PIPING INCLUDING PNEUMATIC ACTUATORS (IF APPLICABLE) STRAIGHT DOWN TO FLOOR TO
- 2 CONNECT <u>C-1</u>, <u>C-2</u> & <u>C-3</u> TO NEW DOMESTIC WATER, IN CHASE. WASTE PIPING IS TO CONNECT STRAIGHT DOWN TO EXISTING PIPING. VERIFY THE SIZE OF THE EXISTING WASTE LINE IS 3"Ø MINIMUM, UPSIZE TO 3"Ø IF NECESSARY. VENT PIPING TO RUN BACK UP IN CHASE OR SHROUD.PROVIDE NEW ACTUATORS IF NECESSARY WITH WATER HAMMER ARRESTERS AND SHUT OFF VALVES. WHERE SHROUD IS EXTENDED INTO THE CORRIDOR, CONCEAL FLUSHOMETER VALVES IN THE SHROUD.
- 3 CONNECT <u>DF-1</u>, BF-1, <u>SL-1</u> & <u>L-1</u> TO DOMESTIC WATER, SEWER AND VENT IN CHASE.
- 4 EXISTING RELOCATED OR NEW SHOWER ASSEMBLY, RECONNECT WATER PIPING (HOT & COLD) BEHIND WALL.
- 5 RECONNECT NEW <u>FD-1</u> TO EXISTING WASTE AND ─ VENT PIPING.
- 6 EXISTING FLOOR DRAIN TO REMAIN.
- 7 EXTEND CW, HW TO FIXTURE IN CHASE. CONNECT (N) WASTE TO (E) WASTE PIPE BELOW AND (N) VENT TO (E) VENT IN CHASE.
- 8 HOT WATER BOTTLE FILLER <u>BF-1</u> WITH <u>EWH-1</u>.


DEMO NOTES - MECHANICAL $\overline{\left\langle 1 \right\rangle}$ DEMO EXISTING SUPPLY WALL GRILLE WITH ASSOCIATED

- DUCTWORK. 2 DEMO EXISTING EXHAUST WALL GRILLE WITH ASSOCIATED
- \langle 3 \rangle DEMO EXISTING DUCTWORK TO POINT OF DISCONNECTION. 4 DEMO EXISTING CEILING DIFFUSER.
- $\langle 5 \rangle$ DEMO EXISTING EXHAUST GRILLE.
- $\langle 6 \rangle$ EXISTING GRILLE TO REMAIN.
- 7 CONTRACTOR TO PRE READ EXISTING AIR FLOW IN THE AREA OF WORK BEFORE DEMOLISION.
- $\overline{\langle 8 \rangle}$ DEMO EXISTING DUCTWORK TO ABOVE SLAB.

REMODEL NOTES

- PROVIDE NEW MSGS ON WALL. NEW MSGS SIZE AND HEIGHT TO MATCH EXISTING.
- 2 PROVIDE NEW MSGE ON WALL. NEW MSGE SIZE AND HEIGHT TO MATCH EXISTING.
- CONNECT NEW DUCTWORK TO EXISTING AT POINT OF CONNECTION. NEW DUCTWORK SIZE TO MATCH EXISTING.
- 4 PROVIDE NEW CEILING DIFFUSER.
- PROVIDE NEW EXHAUST GRILLE.
- (6) PROVIDE NEW MSGS ON METAL PANEL WALL. NEW MSG SIZE TO MATCH EXISTING.
- PROVIDE NEW MSGE ON METAL PANEL WALL. NEW MSG SIZE TO MATCH EXISTING.
- (8) PROVIDE NEW MSGS ON CEILING.
- PROVIDE NEW MSGE ON CEILING. (10) BALANCE AIR FLOW TO PRE READ EXISTING CFM
- IN THE AREA OF WORK. (11) CONNECT NEW DUCTWORK TO EXISTING ABOVE
- SLAB AT THE POINT OF CONNECTION. NEW DUCT SIZE TO MATCH EXISTING.
- (12) REBALANCE (E) GRILLE TO CFM INDICATED.

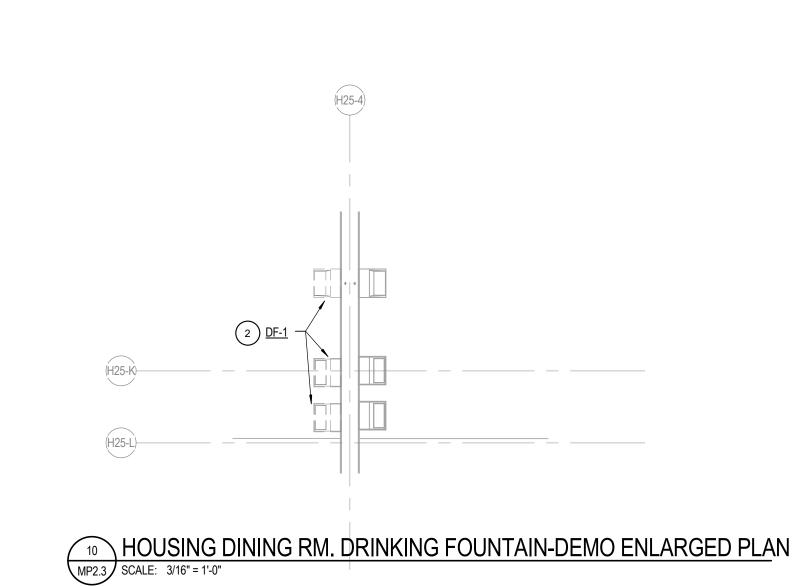

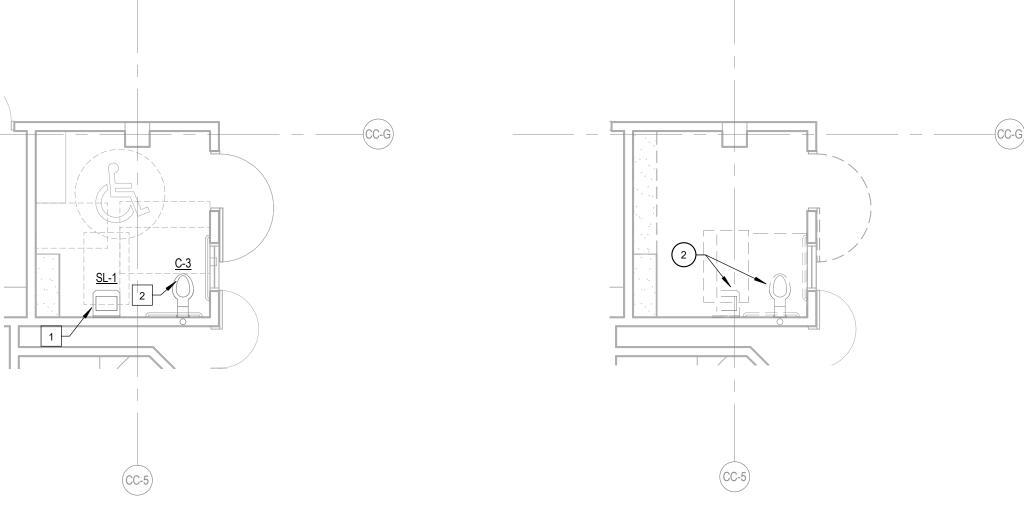


MP2.3 SCALE: 3/16" = 1'-0"


TRANSFER CELL #531A - ENLARGED PLAN

HOUSING SHOWER #142 - ENLARGED PLAN

SCALE: 3/16" = 1'-0"


MP2.3 | SCALE: 3/16" = 1'-0"

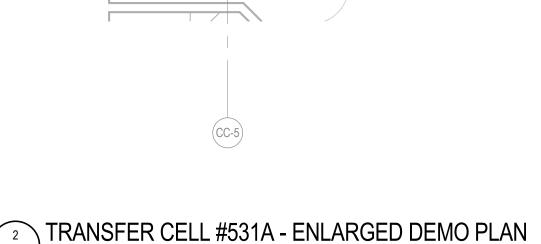


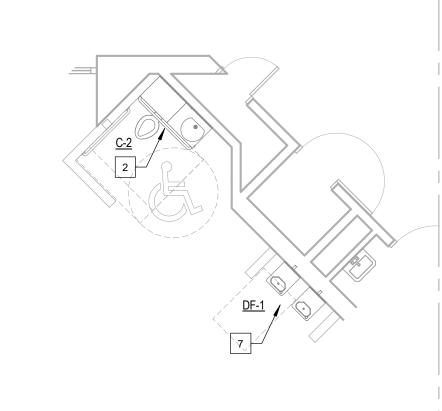




7 HOUSING SHOWER #141 - ENLARGED PLAN
MP2.3 SCALE: 3/16" = 1'-0"

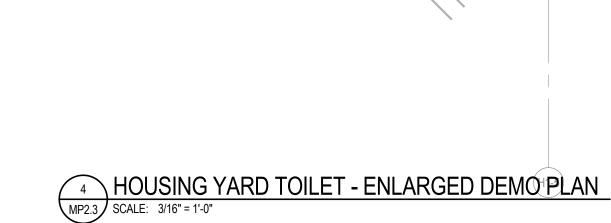


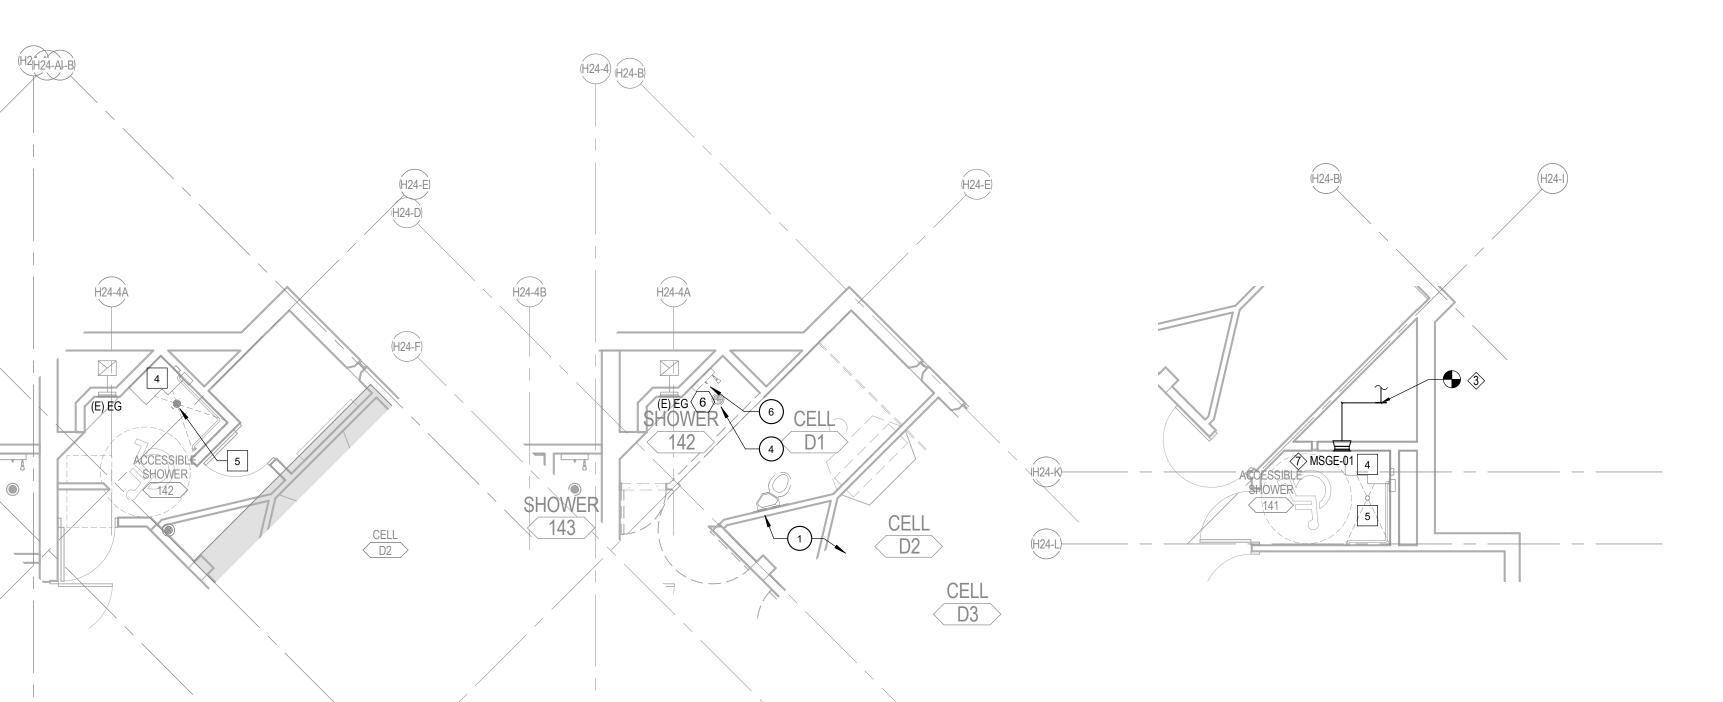



6 HOUSING SHOWER #142 - ENLARGED DEMO PLAN

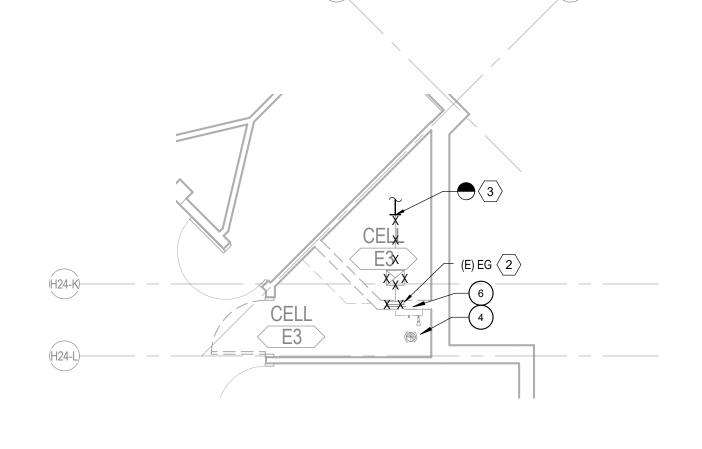




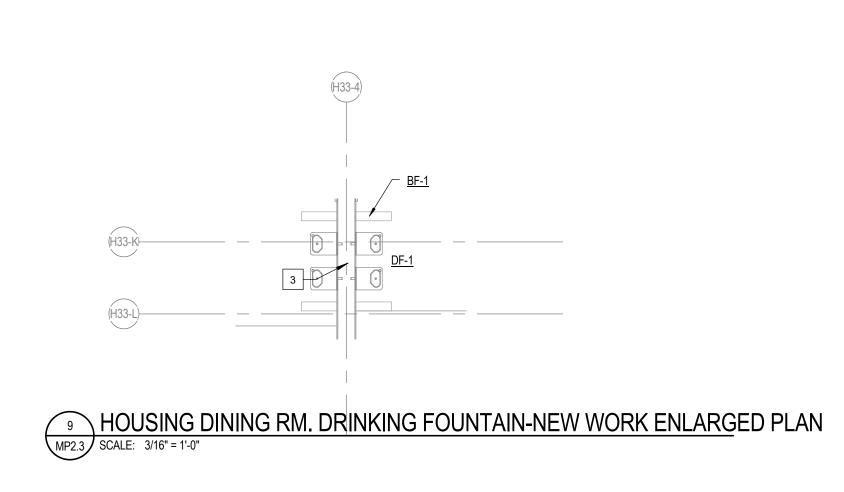

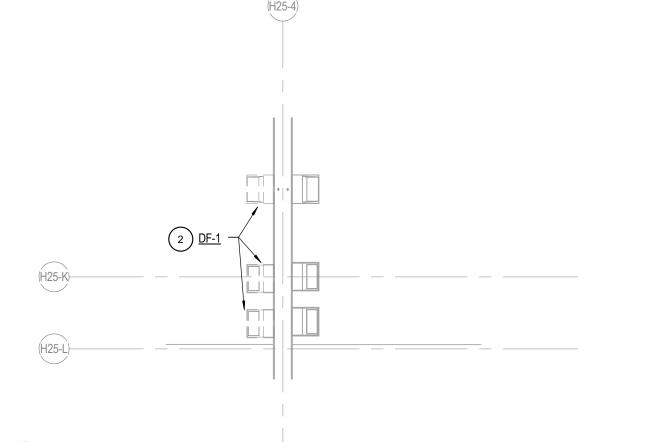

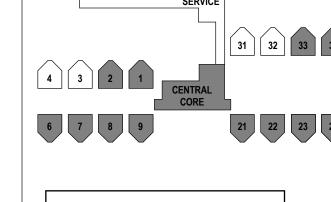

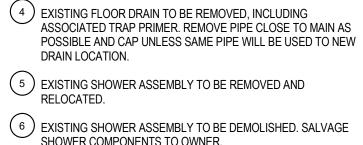

(3) EXISTING FLOOR DRAIN TO REMAIN.

